

**PETROSAFE**

Petroleum Safety & Environmental Services Co.  
An Egyptian Oil Sector Company



**بترو سيف**

شركة الخدمات البترولية للسلامة والبيئة  
إحدى شركات قطاع البترول



The Egyptian Natural Gas Holding Company "EGAS"

# Quantitative Risk Assessment "QRA" Study For EI- Kasasin Pressure Reduction Station



Prepared By  
Petroleum Safety and Environmental Services Company  
PETROSAFE

May 2022

**Document Title:** Quantitative Risk Assessment "QRA" Study for El- Kasasin Pressure Reduction & Metering Station

<b>Title</b>	Quantitative Risk Assessment Study for El- Kasasin Pressure Reduction Station – Ismailia Governorate
<b>Customer</b>	Egyptian Natural Gas Holding Company "EGAS"
<b>Customer Reference</b>	EGAS/QRA/21/2019-MG/MS
<b>Confidentiality, Copyright and Reproduction</b>	This document has been prepared by PETROSAFE in connection with a contract to supply services and is submitted only on the basis of strict confidentiality. The contents must not be disclosed to third parties other than in accordance with the terms of the contract.
<b>Report Number</b>	EGAS.HSE.QRA.Study.04/El-Kasasin-Town.Gas/PRMS.No.05/2022/QRA/MG/MS/MY-DNV-PHAST.8.6 -PETROSAFE-Draft.Report-Rev.00
<b>Report Status</b>	Revision 00
PETROSAFE 6w/4 Hassan Nassar St. - Takseem El-Laselky - New Maadi, Cairo, Egypt Telephone: +(202) 2517 6935 / 2517 6936 / 2517 6937 Facsimile: +(202) 2517 6938 / 2517 6958 e-mail: <a href="mailto:mohamed.ghazaly@petrosafe.com.eg">mohamed.ghazaly@petrosafe.com.eg</a> <a href="mailto:mohamed.samy@petrosafe.com.eg">mohamed.samy@petrosafe.com.eg</a> / <a href="mailto:mohamed.yousry@petrosafe.com.eg">mohamed.yousry@petrosafe.com.eg</a>	

	Name	Signature	Date
<b>Team Work</b>	Eng. Mohamad Yousry Loss Prevention Specialist	PETROSAFE	May 2022
	Chem. Mohamad Samy Safety Consultations Assist. GM	PETROSAFE	May 2022
	Geo. Mohamad Al-Ghazaly Saf. & Env. Consultations GM	PETROSAFE	May 2022
<b>Reviewed by</b>	Dr. Emad Kilany Safety Gen. Mgr.	EGAS	May 2022
	Eng. Tarek Mansour World Bank Project Gen. Mgr.	EGAS	May 2022
<b>Approved by</b>	Dr. Ashraf Ramadan Assistant Chairman for Environment and Supervising on Health & Safety Department	EGAS	May 2022
	Eng. Ahmed Mahmoud Vice Chairman for Planning & Gas Projects & Business Development	EGAS	May 2022
<b>Distribution</b>			

- Client: EGAS
- File: EGAS / PETROSAFE
- Library: EGAS / PETROSAFE



## CONTENTS

<b>Executive Summary</b>	<b>6</b>
<b>Introduction</b>	<b>15</b>
<b>Technical Definitions</b>	<b>16</b>
<b>Objectives</b>	<b>21</b>
<b>Quantitative Risk Assessment Study Scope</b>	<b>22</b>
<b>Quantitative Risk Assessment "QRA" Studies</b>	<b>23</b>
Method of Assessment	23
1.General Method Used	23
2.Risk Assessment	23
Modelling the Consequences	25
Criterion for Risk Tolerability	26
Personnel Vulnerability and Structural Damage	29
Quantification of the Frequency of Occurrence	32
Identification of Scenarios Leading to Selected Failures	32
Relevant Weather Data for the Study	33
-Weather Data	33
-Stability Categories	37
<b>El- Kasasin PRMS Description</b>	<b>38</b>
Background	38
The PRMS Location Coordinates (Town Gas Data)	38
PRMS Brief Description and Component list (Town Gas Data)	38
El- Kasasin PRMS Units (Town Gas Data)	39
Process Condition Data (Town Gas Company Data)	45
Gas Odorant Specifications	46
Fire Fighting and Protection Systems and Facilities	47
Emergency Response Plan "ERP"	47
<b>Analytical Results of Consequence Modeling</b>	<b>48</b>
1.0.Pressure Reduction Station Inlet Pipeline (6 inch)	48
1/1- Consequence Modeling for 1 inch (Pin Hole) Gas Release	48
1/2- Consequence Modeling for 3 inch (Half Rup.) Gas Release	52
1/3- Consequence Modeling for 6 inch (Full Rupture) Gas Release	56
2.0.Pressure Reduction Station Outlet Pipeline (8 inch)	60
2/1- Consequence Modeling for 1 inch (Pin Hole) Gas Release	60
2/2- Consequence Modeling for 4 inch (Half Rup.) Gas Release	63
2/3- Consequence Modeling for 8 inch (Full Rup.) Gas Release	67



3.0.Pressure Reduction Station Odorant Tank (Spotleak)	72
4.0. Gas Heater (Water Bath Heating System)	79
5.0.Pressure Reduction Station Off-Take Pipeline (6 inch)	85
5/1- Consequence Modeling for 1 inch (Pin Hole) Gas Release	85
5/2- Consequence Modeling for 3 inch (Half Rup.) Gas Release	88
5/3- Consequence Modeling for 6 inch (Full Rup.) Gas Release	91
<b>Individual Risk Evaluation</b>	<b>94</b>
-Risk Calculation	94
-Event Tree Analysis	97
<b>Summary of Modelling Results and Conclusion</b>	<b>109</b>
<b>Recommendations</b>	<b>114</b>

## FIGURES

<i>Figure 1 Risk Assessment Framework</i>	24
<i>Figure 2. Criteria for Individual Risk Tolerability</i>	26
<i>Figure 3. Proposed Individual Risk Criteria</i>	27
<i>Figure 4. Monthly Variations of the Maximum Temperature for El- Kasasin Area</i>	34
<i>Figure 5. Monthly Variation of the Wind Speed for El- Kasasin Area</i>	35
<i>Figure 6. Wind Rose for El- Kasasin Area</i>	35
<i>Figure 7. Monthly Variations of the Sunny, Cloudy and Precipitation days for El- Kasasin Area</i>	36
<i>Figure 8. El- Kasasin PRMS Layout</i>	41
<i>Figure 9. El- Kasasin PRMS Piping and Instrumentation Diagram "P&amp;ID"</i>	42
<i>Figure 10 El- Kasasin Odorant Piping and Instrumentation Diagram "P&amp;ID"</i>	43
<i>Figure 11. El- Kasasin PRMS and Surroundings Plotted on Google Earth Photo</i>	44
<i>Figure 12. Gas Cloud Side View (UFL/LFL) (1" hole in 6" Inlet Pipeline)</i>	49
<i>Figure 13. Heat Radiation Contours from Jet Fire (1" hole in 6" Inlet Pipeline)</i>	50
<i>Figure 14 Worst-Case Explosion Overpressure Waves (1" hole in 6" Inlet Pipeline)</i>	51
<i>Figure 15. Gas Cloud Side View (UFL/LFL) (3" hole in 6" Inlet Pipeline)</i>	53
<i>Figure 16. Heat Radiation Contours from Jet Fire (3" hole in 6" Inlet Pipeline)</i>	54
<i>Figure 17. Worst-Case Explosion Overpressure Waves (3" hole in 6" Inlet Pipeline)</i>	55
<i>Figure 18. Gas Cloud Side View (UFL/LFL) (6" Inlet Pipeline Full Rupture)</i>	57
<i>Figure 19. Heat Radiation Contours from Jet Fire (6" Inlet Pipeline Full Rupture)</i>	58
<i>Figure 20. Worst-Case Explosion Overpressure Waves (6" Inlet Pipeline Full Rupture)</i>	59
<i>Figure 21. Gas Cloud Side View (UFL/LFL) (1" hole in 8" Outlet Pipeline)</i>	61
<i>Figure 22. Heat Radiation Contours from Jet Fire (1" hole in 8" Outlet Pipeline)</i>	62



<b>Figure 23. Gas Cloud Side View (UFL/LFL) (4" hole in 8" Outlet Pipeline)</b>	<b>64</b>
<b>Figure 24. Heat Radiation Contours from Jet Fire (4" hole in 8" Outlet Pipeline)</b>	<b>65</b>
<b>Figure 25. Worst-Case Explosion Overpressure Waves (4" hole in 8" Outlet Pipeline)</b>	<b>66</b>
<b>Figure 26. Gas Cloud Side View (UFL/LFL) (8" Outlet Pipeline Full Rupture)</b>	<b>68</b>
<b>Figure 27. Heat Radiation Contours from Jet Fire (8" Outlet Pipeline Full Rupture)</b>	<b>69</b>
<b>Figure 28. Worst-Case Explosion Overpressure Waves (8" Outlet Pipeline Full Rupture)</b>	<b>70</b>
<b>Figure 29. Heat Radiation Contours from Fireball (8" Outlet Pipeline Full Rupture)</b>	<b>71</b>
<b>Figure 30. Vapor Cloud (UFL/LFL) Side View Graph (Odorant leak)</b>	<b>73</b>
<b>Figure 31. Cloud Footprint (UFL/LFL) on site (Odorant leak)</b>	<b>73</b>
<b>Figure 32. Heat Radiation Contours - Jet Fire Graph (Odorant Leak)</b>	<b>75</b>
<b>Figure 33. Heat Radiation Contours - Jet Fire on Site (Odorant Leak)</b>	<b>75</b>
<b>Figure 34. Worst-Case Explosion Overpressure Waves Graph (Odorant Leak)</b>	<b>77</b>
<b>Figure 35. Explosion Overpressure Waves on Site (Odorant Leak)</b>	<b>77</b>
<b>Figure 36. Vapor Cloud (UFL/LFL) Side View Graph (Gas Heater)</b>	<b>80</b>
<b>Figure 37. Heat Radiation Contours - Fire Graph (Gas Heater)</b>	<b>81</b>
<b>Figure 38. Heat Radiation Contours - Fire on Site (Gas Heater)</b>	<b>81</b>
<b>Figure 39. Explosion Overpressure Waves Graph (Gas Heater)</b>	<b>83</b>
<b>Figure 40. Explosion Overpressure Waves on Site (Gas Heater)</b>	<b>83</b>
<b>Figure 41. Gas Cloud Side View (UFL/LFL) (1" hole in 6" off-take Pipeline)</b>	<b>86</b>
<b>Figure 42. Heat Radiation Contours from Jet Fire (1" hole in 6" off-take Pipeline)</b>	<b>87</b>
<b>Figure 43. Gas Cloud Side View (UFL/LFL) (3" hole in 6" off-take Pipeline)</b>	<b>89</b>
<b>Figure 44. Heat Radiation Contours from Jet Fire (3" hole in 6" off-take Pipeline)</b>	<b>90</b>
<b>Figure 45. Gas Cloud Side View (UFL/LFL) (6" off-take Pipeline Full Rupture)</b>	<b>92</b>
<b>Figure 46. Heat Radiation Contours from Jet Fire (6" off-take Pipeline Full Rupture)</b>	<b>93</b>
<b>Figure 47 Evaluation of Individual Risk</b>	<b>108</b>

## TABLES

<b>Table 1. Description of Modeling of the Different Scenario</b>	<b>25</b>
<b>Table 2. Proposed Individual Risk (IR) Criteria (per person/year)</b>	<b>27</b>
<b>Table 3. Criteria for Personnel Vulnerability and Structural Damage</b>	<b>29</b>
<b>Table 4. Heat Radiation Effects on Structures (International Data Bank)*</b>	<b>30</b>
<b>Table 5. Heat Radiation Effects on People</b>	<b>30</b>
<b>Table 6. Effects of Overpressure</b>	<b>31</b>
<b>Table 7. Annual Average Temperature, Relative Humidity and Wind Speed / Direction</b>	<b>33</b>
<b>Table 8. Mean of Monthly Air Temperature (°C) - El- Kasasin Area</b>	<b>34</b>
<b>Table 9. Mean of Monthly Wind Speed (m/sec) - El- Kasasin Area</b>	<b>34</b>



<b>Table 10. Mean of Monthly Average Relative Humidity - El- Kasasin Area</b>	<b>34</b>
<b>Table 11. Pasqual Stability Categories</b>	<b>37</b>
<b>Table 12. Relationship between Wind Speed and Stability</b>	<b>37</b>
<b>Table 13. Sets of Weather Conditions Selected for Current Study</b>	<b>37</b>
<b>Table 14. Location Coordinates of PRMS</b>	<b>38</b>
<b>Table 15. El- Kasasin PRMS Units</b>	<b>39</b>
<b>Table 16. Process Conditions / Gas Components and Specifications</b>	<b>45</b>
<b>Table 17. Dispersion Modeling for Inlet - 1" / 6" Gas Release</b>	<b>48</b>
<b>Table 18. Dispersion Modeling for Inlet - 3" / 6" Gas Release</b>	<b>52</b>
<b>Table 19. Dispersion Modeling for Inlet - 6" Gas Release</b>	<b>56</b>
<b>Table 20. Dispersion Modeling for Outlet - 1" / 8" Gas Release</b>	<b>60</b>
<b>Table 21. Dispersion Modeling for Outlet - 4" / 8" Gas Release</b>	<b>63</b>
<b>Table 22. Dispersion Modeling for Outlet - 8" Gas Release</b>	<b>67</b>
<b>Table 23. Dispersion Modeling for Odorant Tank</b>	<b>72</b>
<b>Table 24. Dispersion Modeling for Heater Tank</b>	<b>79</b>
<b>Table 25. Dispersion Modeling for Off-take - 1" / 6" Gas Release</b>	<b>85</b>
<b>Table 26. Dispersion Modeling for Off-take - 3" / 6" Gas Release</b>	<b>88</b>
<b>Table 27. Dispersion Modeling for Off-take - 6" Gas Release</b>	<b>91</b>
<b>Table 28. Failure Frequency for Each Scenario</b>	<b>96</b>
<b>Table 29. Inlet 6" / Outlet 8" / Off-Take 6" / Waterbath 4" Pipeline Scenarios (Pin Hole Crack - 1" Release) – ETA</b>	<b>99</b>
<b>Table 30. Inlet 6" / Off-Take 6" Pipeline Scenarios (Half Rupture Release) – ETA</b>	<b>100</b>
<b>Table 31. Outlet 8" Pipeline Scenario (Half Rupture Release) – ETA</b>	<b>101</b>
<b>Table 32. Inlet 6" / Off-Take 6" / Outlet 8" Pipeline Scenarios (Full rupture Release) – ETA</b>	<b>102</b>
<b>Table 33. Odorant Tank Release – ETA</b>	<b>103</b>
<b>Table 34. Total Frequencies for Each Scenario</b>	<b>104</b>
<b>Table 35. Summarization of Risk on Workers / Public (Occupancy)</b>	<b>104</b>
<b>Table 36. Individual Risk (IR) Calculation for the Public Near to the PRMS</b>	<b>106</b>
<b>Table 37. Individual Risk (IR) Calculation for the Workers Near to the PRMS</b>	<b>107</b>



## Executive Summary

This report summarizes the Quantitative Risk Assessment (QRA) analysis study undertaken for the New Natural Gas Pressure Reduction & Metering Station "PRMS" with an Odorant at El- Kasasin City – Ismailia Governorate – Egypt. The PRMS owned by The Egyptian Natural Gas Holding Company "EGAS" and operated by Town Gas Company.

The scope of work includes performing frequency assessment, consequence modeling analysis and Quantitative Risk Assessment of El- Kasasin PRMS in order to assess its impacts on the surroundings.

The main objective of the Quantitative Risk Assessment (QRA) study is to demonstrate that Individual Risk "IR" for workers and for public fall within the ALARP region of Risk Acceptance Criteria, and the El- Kasasin PRMS does not lead to any unacceptable risks to workers or the public.

QRA Study has been undertaken in accordance with the methodology outlined in the UKHSE as well as international regulations and standards.

QRA starts by Hazard Identification (HAZID) study, which determines the Major Accident Hazards (MAH) that requires consequence modelling, frequency analysis, and risk calculation.

In order to perform consequence-modelling analysis of the potential hazardous scenarios resulting from loss of containment, some assumptions and design basis have been proposed. Four scenarios of the release have been proposed:

1. Gas Release from the inlet / outlet pipeline.
2. Gas Release from the off-take point.
3. Leak from odorant tank.
4. Leak from water bath heater (WBH).

The QRA has been performed using DNV PHAST software (Ver. 8.6) for consequence modelling of different types of hazardous consequences.

Weather conditions have been selected based on wind speed and stability class for the area detailed weather statistics.

The average weather conditions have been selected; represented by wind speed of 3.3 m/s and stability class "D" representing "Neutral" weather conditions, in order to obtain conservative results. The prevailing wind direction is North (N).

Additional scenario was discussed to highlight the effect of different weather conditions "low wind speed", where the differences between the two weather conditions were negligible. Please refer to Annex "1" for additional scenario.



As per results from modeling the consequences of each scenario, the following table summarizes the study, and as follows:

Event	Scenario	Effects
<b>Pin hole (1") gas release 6" inlet pipeline</b>		
	Gas cloud UFL LFL 50 % LFL	<i>The modeling shows that the gas cloud effects will be limited inside the PRMS fence.</i>
	Heat radiation / Jet fire 9.5 kW/m <sup>2</sup> 12.5 kW/m <sup>2</sup>	<i>The modeling shows that the heat radiation values will extend outside the PRMS southern fence with no effects outside.</i>
	Explosion 0.020 bar 0.137 bar 0.206 bar	<i>The modeling shows that the value of 0.137 &amp; 0.206 bar will be limited inside the PRMS boundary while 0.020 bar extend outside the PRMS south fence with no effects outside.</i>
<b>Half Rupture (3") gas release 6" inlet pipeline</b>		
	Gas cloud UFL LFL 50 % LFL	<i>The modeling shows that the gas clouds 50 % LFL &amp; LFL will extend to reach the southern fence and extend outside. The UFL will be limited inside the PRS boundary.</i>
	Heat radiation / Jet fire 9.5 kW/m <sup>2</sup> 12.5 kW/m <sup>2</sup>	<i>The modeling shows that the values of 9.5, 12.5, 25 &amp; 37.5 kW/m<sup>2</sup> will extend outside the PRMS southern fence with no effects outside.</i>
	Explosion 0.020 bar 0.137 bar 0.206 bar	<i>The modeling shows that the value of 0.020, 0.137 &amp; 0.206 bar will extend outside the PRMS southern fence.</i>
<b>Full Rupture gas release 6" inlet pipeline</b>		
	Gas cloud UFL LFL 50 % LFL	<i>The modeling shows that the gas cloud effects (LFL &amp; 50 % LFL) will extend outside the PRMS southern fence with no effects outside.</i>
	Heat radiation / Jet fire	<i>The modeling shows that the heat radiation values 9.5, 12.5, 25 &amp; 37.5 kW/m<sup>2</sup> will</i>





Event	Scenario	Effects
	9.5 kW/m <sup>2</sup> 12.5 kW/m <sup>2</sup>	<i>extend outside the PRMS southern fence, where the 9.5 &amp; 12.5 kW/m<sup>2</sup> reach parts of the neighboring GASCO room.</i>
	Explosion 0.020 bar 0.137 bar 0.206 bar	<i>The modeling shows that the value of 0.137 &amp; 0.206 bar will extend outside the PRMS southern fence.</i>
<b>Pin hole (1") gas release 8" outlet pipeline</b>		
	Gas cloud UFL LFL 50 % LFL	<i>The modeling shows that the gas cloud will be limited inside the PRS boundary.</i>
	Heat radiation / Jet fire 9.5 kW/m <sup>2</sup> 12.5 kW/m <sup>2</sup>	<i>The modeling shows that the heat radiation value 1.6 &amp; 4 kW/m<sup>2</sup> effects will be limited inside the PRS boundary with no effects. The values of 9.5, 12.5, 25 &amp; 37.5 kW/m<sup>2</sup> are not determined by the software due to small leakage.</i>
	Explosion 0.020 bar 0.137 bar 0.206 bar	<i>N/D</i>
<b>Half Rupture (4") gas release 8" outlet pipeline</b>		
	Gas cloud UFL LFL 50 % LFL	<i>The modeling shows that the gas cloud will be limited inside the PRS boundary.</i>
	Heat radiation / Jet fire 9.5 kW/m <sup>2</sup> 12.5 kW/m <sup>2</sup>	<i>The modeling shows that the heat radiation values of 9.5, 12.5, 25 &amp; 37.5 kW/m<sup>2</sup> are limited to the PRMS boundary, where 9.5 &amp; 12.5 kW/m<sup>2</sup> cover parts of the control rooms and neighboring rooms in the building.</i>
	Explosion 0.020 bar 0.137 bar 0.206 bar	<i>The modeling shows that the overpressure values 0.137 &amp; 0.206 bar will be limited inside the PRMS boundary.</i>
<b>Full Rupture gas release 8" outlet pipeline</b>		
	Gas cloud UFL	<i>The modeling shows that the gas cloud effects will be limited inside the PRS</i>



Event	Scenario	Effects
	LFL 50 % LFL	boundary
	Heat radiation / Jet fire 9.5 kW/m <sup>2</sup> 12.5 kW/m <sup>2</sup>	The modeling shows that the heat radiation values of 9.5, 12.5, 25 & 37.5 kW/m <sup>2</sup> will extend outside the PRMS southern fence affecting the security and the control room and neighboring rooms.
	Explosion 0.020 bar 0.137 bar 0.206 bar	The modeling shows that the overpressure values 0.137 and 0.206 bar will be limited inside the PRMS boundary.
	Heat radiation / Fireball 9.5 kW/m <sup>2</sup> 12.5 kW/m <sup>2</sup>	The modeling shows that the heat radiation values of 4, 12.5 & 37.5 kW/m <sup>2</sup> will be extend outside the PRS boundary from northern fence side.
<b>Odorant tank 1" leak</b>		
	Gas cloud UFL LFL 50 % LFL	The modeling shows that the vapor cloud will extend outside the PRS fence from the south side. Consideration should be taken when deal with liquid, vapors and smokes according to the MSDS for the material.
	Heat radiation / Jet fire 9.5 kW/m <sup>2</sup> 12.5 kW/m <sup>2</sup>	The modeling shows that all values of heat radiation 9.5, 12.5, 25 & 37.5 kW/m <sup>2</sup> will be limited inside the PRS boundary down and crosswind.
	Explosion 0.020 bar 0.137 bar 0.206 bar	The modeling shows that the value of 0.020 bar will cover most parts of the PRS and extend outside the PRS boundary . The values of 0.137 & 0.206 bar will extend outside the PRS boundary.
<b>Gas heater (water bath heating system)</b>		
	Gas cloud UFL LFL 50 % LFL	The modeling shows that the vapor cloud will be limited inside the PRS boundary downwind.
	Heat radiation / Jet fire 9.5 kW/m <sup>2</sup> 12.5 kW/m <sup>2</sup>	The modeling shows that the heat radiation value 9.5, 12.5, 25 & 37.5 kW/m <sup>2</sup> effects will be limited inside the PRS boundary affecting some of the PRMS components.
	Explosion 0.020 bar 0.137 bar	The modeling shows that the overpressure values will be limited inside the PRMS boundary.



Event	Scenario	Effects
	0.206 bar	
<b>Pin hole (1") gas release 6" off-take pipeline</b>		
	Gas cloud UFL LFL 50 % LFL	<i>The modeling shows that the gas cloud effects will be limited inside the Off-take boundary (GASCO's room).</i>
	Heat radiation / Jet fire 9.5 kW/m <sup>2</sup> 12.5 kW/m <sup>2</sup>	<i>The modeling shows that the heat radiation values are limited inside GASCO's room boundary while the 1.6 kW/m<sup>2</sup> extend outside the Northern fence with no effects outside. The values of 12.5, 25 &amp; 37.5 kW/m<sup>2</sup> are not determined by the software as they are very small values.</i>
	Explosion 0.020 bar 0.137 bar 0.206 bar	N/D
<b>Half Rupture (3") gas release 6" off-take pipeline</b>		
	Gas cloud UFL LFL 50 % LFL	<i>The modeling shows that the gas cloud effects will be limited inside the Off-take boundary (GASCO's room).</i>
	Heat radiation / Jet fire 9.5 kW/m <sup>2</sup> 12.5 kW/m <sup>2</sup>	<i>The modeling shows that the heat radiation values of 1.6 &amp; 4 kW/m<sup>2</sup> will extend outside GASCO's room. While the 9.5 &amp; 12.5 kW/m<sup>2</sup> will be limited inside GASCO's room. The values of 25 &amp; 37.5 kW/m<sup>2</sup> are not determined by the software as they are very small values.</i>
	Explosion 0.020 bar 0.137 bar 0.206 bar	N/D
<b>Full Rupture gas release 6" off-take pipeline</b>		
	Gas cloud UFL LFL 50 % LFL	<i>The modeling shows that the gas cloud will be limited inside the PRS boundary.</i>
	Heat radiation / Jet fire 9.5 kW/m <sup>2</sup>	<i>The modeling shows that the heat radiation values of 1.6, 4 &amp; 9.5 kW/m<sup>2</sup> will cover the PRS boundary and extend outside from all</i>



Event	Scenario	Effects
	12.5 kW/m <sup>2</sup>	<i>directions. While the 12.5 kW/m<sup>2</sup> will cover most parts of the PRS affecting the heater. The values of 25 &amp; 37.5 kW/m<sup>2</sup> are not determined by the software as they are very small values.</i>
	Explosion 0.020 bar 0.137 bar 0.206 bar	<i>N/D</i>

The previous table shows that there are some of potential hazards with heat radiation (12.5 kW/m<sup>2</sup>) resulting from jet fire and explosion overpressure waves (0.137 bar) from late explosion events.

These risks (Jet fire, Fireball & overpressure waves) will affect the workers at the PRMS, and reach the surrounding near to the station.

The major hazards that extend over site boundary and/or effect on workers / public were used for Risk Calculations.

Event Tree Analysis (ETA) is an analysis technique for identifying and evaluating the sequence of events in a potential accident scenario following the occurrence of an initiating event. ETA utilizes a visual logic tree structure known as an event tree (ET). ETA provides a Probabilistic Risk Assessment (PRA) of the risk associated with each potential outcome. ETA has been used for scenario development.

The following data and assumptions have been considered in the Event tree analysis (ETA):

- Failure frequency data (mainly E&P Forum/OGP),
- Risk reduction factors (if available),
- Ignition probabilities (both immediate and delayed),
- Vulnerability data.

Risks have been assessed for workers / public using International Risk Management Guidelines as a reference.

The resulting risks have been compared with International Risk Acceptance Criteria.

Risk evaluation for Individual Risk "IR" for the major hazards presented in the following tables:



**Individual Risk (IR) Calculation for the Public Near to the PRMS**

Source of Event	Frequency <b>1</b>	Heat Radiation (kW/m <sup>2</sup> ) & Overpressure (Bar)	Vulnerability <b>2</b>	Time Exposed <b>3</b>	IR = <b>1 x 2 x 3</b>
Gas Release from 3"/6" Inlet pipeline	<b>2.89E-05</b>	Jet Fire 12.5	<b>0.7</b> (Outdoor)	<b>0.04</b> <sup>1 Pers</sup>	<b>8.10E-07</b>
		Explosion 0.137	<b>0.3</b> (Outdoor)		<b>3.47E-07</b>
Gas Release from 6" Off-take pipeline	<b>6.45E-07</b>	Jet Fire 12.5	<b>0.7</b> (Outdoor)	<b>0.04</b> <sup>1 Pers</sup>	<b>1.81E-08</b>
Gas Release from 6" Inlet pipeline		Jet Fire 12.5	<b>0.7</b> (Outdoor)	<b>0.04</b> <sup>1 Pers</sup>	<b>1.81E-08</b>
		Explosion 0.137	<b>0.3</b> (Outdoor)		<b>7.74E-09</b>
Gas Release from 8" Outlet pipeline		Jet Fire 12.5	<b>0.7</b> (Outdoor)	<b>0.04</b> <sup>1 Pers</sup>	<b>1.81E-08</b>
	Fireball 12.5	<b>0.7</b> (Outdoor)	<b>0.04</b> <sup>1 Pers</sup>	<b>1.81E-08</b>	
Odorant tank 1" leak	<b>1.23E-05</b>	Explosion 0.137	<b>0.3</b> (Outdoor)	<b>0.04</b> <sup>1 Pers</sup>	<b>7.74E-09</b>
<b>TOTAL Risk for the Public (PRMS)</b>					<b>1.24E-06</b>

**Document Title:** Quantitative Risk Assessment "QRA" Study for El- Kasasin Pressure Reduction & Metering Station

***Individual Risk (IR) Calculation for the Workers Near to the PRMS***


Source of Event	Frequency <b>1</b>	Heat Radiation (kW/m <sup>2</sup> ) & Overpressure (Bar)	Vulnerability <b>2</b>	Time Exposed <b>3</b>	IR = <b>1 x 2 x 3</b>
Gas Release from 4"/8" Outlet pipeline	<i>1.47E-05</i>	Jet Fire 12.5	<b>0.1</b> (Indoor)	<b>1</b> <sup>3 Pers</sup>	<i>4.40E-06</i>
Gas Release from 8" Outlet pipeline	<i>6.45E-07</i>	Jet Fire 12.5	<b>0.1</b> (Indoor)	<b>1</b> <sup>5 Pers</sup>	<i>3.22E-07</i>
<b>TOTAL Risk for the Workers</b>					<b><i>4.72E-06</i></b>

The previous table shows that there are some effects on PRMS workers & surrounding public, it was assumed that:

- One person "as public" works as a farmer (in the agricultural land around the PRS) for one hour / day light.
- Five Persons "as Workers" are available in the PRS for 24 hrs/ day (two operators in control room & one in admin building + Two persons in the security room),



The following figure shows the Individual Risk "IR" for El- Kasasin PRMS:

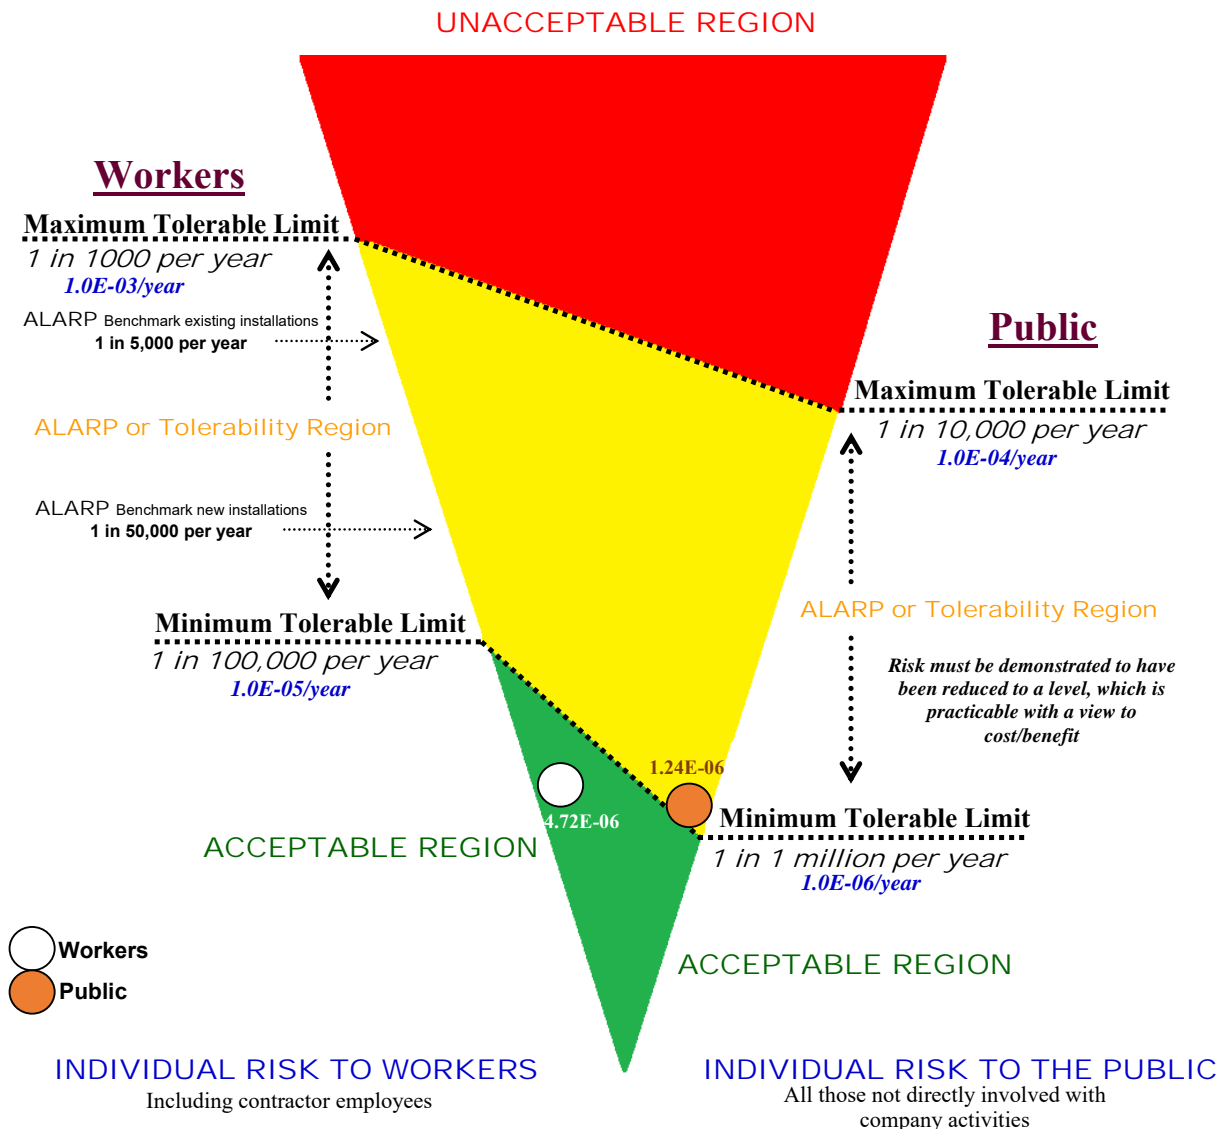

### Evaluation of Individual Risk

**The level of Individual Risk to the exposed workers at El- Kasasin PRMS, based on the risk tolerability criterion used is Acceptable.**

**The level of Individual Risk to the exposed Public at El- Kasasin PRMS area, based on the risk tolerability criterion used is ALARP.**

Referring to the ALARP risk; all efforts had been considered and additional control measures have been deemed not "Practicable" to prevent incidents and to mitigate chronic and acute effects and to bring the risk from the "ALARP" Region to the acceptable region.



## Introduction

The Egyptian Natural Gas Holding Company "EGAS" has engaged Petroleum Safety and Environmental Services Company "PETROSAFE" to identify and evaluate hazards generated from the "Natural Gas Pressure Reduction and Odorant Station – PRMS" at **El- Kasasin** City – Ismailia Governorate – Egypt. The PRMS operated by Town Gas Company in order to advise protective measures for minimizing risk up to acceptable level.

As part of this review, a QRA study conducted for the following objectives:

- Identify hazardous scenarios related to the most critical unexpected event(s).
- Determine the likelihood of the identified scenarios;
- Model the potential consequences of the identified scenarios;
- Determine the Potential risk of fatality resulting from the identified hazardous scenarios.

The proposed study should also identify existing arrangements for the prevention of major accidents and their mitigation. This would involve emergency plan and procedure for dealing with such events.

PETROSAFE selected to carry out this study, as it has the experience in conducting this type of work.

PETROSAFE is also empowered by the Egyptian General Petroleum Corporation "EGPC" to identify and evaluate factors that relate to Occupational Health & Safety and Environmental Protection.





## Technical Definitions

ALARP	<i>Stands for "As Low As Reasonably Practicable", and is a term often used in the milieu of safety-critical and safety-involved systems. The ALARP principle is that the residual risk shall be as low as reasonably practicable.</i>
API	<i>American Petroleum Institute.</i>
Confinement	<i>A qualitative or quantitative measure of the enclosure or partial enclosure areas where vapors cloud may be contained.</i>
Congestion	<i>A qualitative or quantitative measure of the physical layout, spacing, and obstructions within a facility that promote development of a vapor cloud explosion.</i>
DNV PHAST	<i>Process Hazard Analysis Software Tool "PHAST" established by Det Norske Veritas "DNV". Phast examines the progress of a potential incident from the initial release to far-field dispersion including modelling of pool spreading and evaporation, and flammable and toxic effects.</i>
E&P Forum	<i>Exploration and Production "E&amp;P" Forum is the international association of oil companies and petroleum industry organizations formed in 1974. It was established to represent its members' interests at the specialized agencies of the United Nations, governmental and other international bodies concerned with regulating the exploration and production of oil and gas.</i>
EGAS	<i>The Egyptian Natural Gas Holding Company.</i>
EGPC	<i>The Egyptian General Petroleum Corporation.</i>
EX	<i>Explosion Proof Type Equipment.</i>
EERA	<i>Escape, Evacuation and Rescue Assessment.</i>
ESD	<i>Emergency Shut Down.</i>
Explosion	<i>Explosion is the delayed ignition of gas in a confined or congested area resulting in high overpressure waves. Once the explosion occurs, it creates a blast wave that has a very steep pressure rise at the wave front and a blast wind that is a transient flow behind the blast wave. The impact of the blast wave</i>

	<p><i>on structure near the explosion known as blast loading. The two important aspects of the blast loading concern are the prediction of the magnitude of the blast and of the pressure loading onto the local structures. Pressure loading predication as result of a blast; resemble a pulse of trapezoidal or triangular shape. They normally have duration of between approximately 40 msec and 400 msec. The time to maximum pressure is typically 20 msec.</i></p> <p><i>Primary damage from an explosion may result from several events:</i></p> <ol style="list-style-type: none"> <li><i>1. Overpressure - the pressure developed between the expanding gas and its surrounding atmosphere.</i></li> <li><i>2. Pulse - the differential pressure across a plant; as a pressure wave passes; might cause collapse or movement, both positive and negative.</i></li> <li><i>3. Missiles and Shrapnel - are whole or partial items that are thrown by the blast of expanding gases that might cause damage or event escalation. In general, these "missiles" from atmospheric vapor cloud explosions cause minor impacts to process equipment since insufficient energy is available to lift heavy objects and cause major impacts. Small projectile objects are still a hazard to personnel and may cause injuries and fatalities. Impacts from rupture incidents may produce catastrophic results.</i></li> </ol>
(ETA) Event Tree Analysis	<p><i>Is a forward, bottom up, logical modeling technique for both success and failure that explores responses through a single initiating event and lays a path for assessing probabilities of the outcomes and overall system analysis. This analysis technique used to analyze the effects of functioning or failed systems, given that an event has occurred.</i></p>
Failure Rate	<p><i>Is the frequency with which an engineered system or component fails, expressed in failures per unit of time. It is highly used in reliability engineering.</i></p>
GASCO	<p><i>The Egyptian Natural Gas Company.</i></p>
Gas Cloud Dispersion	<p><i>Gas cloud air dilution naturally reduces the concentration to below the LEL or no longer considered ignitable (typically defined as 50 % of the LEL).</i></p>

HSE Policy	<i>Health, Safety and Environmental Policy.</i>
Hazard	<i>An inherent physical or chemical characteristic (flammability, toxicity, corrosively, stored chemical or mechanical energy) or set of conditions that has the potential for causing harm to people, property, or the environment.</i>
(HAZOP) Hazard And Operability Study	<i>Is a structured and systematic examination of a planned or existing process or operation in order to identify and evaluate problems that may represent risks to personnel or equipment, or prevent efficient operation. The HAZOP technique is qualitative, and aims to stimulate the imagination of participants to identify potential hazards and operability problems; structure and completeness given by using guideword prompts.</i>
(HAZID) Hazard Identification Study	<i>Is a tool for hazard identification, used early in a project as soon as process flow diagrams, draft heat and mass balances, and plot layouts are available. Existing site infrastructure, weather, and Geotechnical data also required, these being a source of external hazards.</i>
(HAC) Hazardous Area Classification	<i>When electrical equipment is used in, around, or near an atmosphere that has flammable gases or vapors, flammable liquids, combustible dusts, ignitable fibers or flying's, there is always a possibility or risk that a fire or explosion might occur. Those areas where the possibility or risk of fire or explosion might occur due to an explosive atmosphere and/or mixture is often called a hazardous (or classified) location/area.</i>
(IR) Individual Risk	<i>The risk to a single person inside a particular building. Maximum individual risk is the risk to the most-exposed person and assumes that the person is exposed.</i>
Jet Fire	<i>A jet fire is a pressurized stream of combustible gas or atomized liquid (such as a high-pressure release from a gas pipe or wellhead blowout event) that is burning. If such a release is ignited soon after it occurs, (i.e., within 2 - 3 minutes), the result is an intense jet flame. This jet fire stabilizes to a point that is close to the source of release, until the release stopped. A jet fire is usually a very localized, but very destructive to anything close to it. This is partly because as well as producing thermal radiation, the jet fire causes considerable convective heating in the region</i>



*beyond the tip of the flame. The high velocity of the escaping gas entrains air into the gas "jet" causing more efficient combustion to occur than in pool fires.*

*Consequentially, a much higher heat transfer rate occurs to any object immersed in the flame, i.e., over 200 kW/m<sup>2</sup> (62,500 Btdsq. ft) for a jet fire than in a pool fire flame. Typically, the first 10% of a jet fire length is conservatively considered un-ignited gas, as a result of the exit velocity causing the flame to lift off the gas point of release. This effect has been measured on hydrocarbon facility flares at 20% of the jet length, but a value of 10% is used to account for the extra turbulence around the edges of a real release point as compared to the smooth gas release from a flare tip. Jet flames have a relatively cool core near the source. The greatest heat flux usually occurs at impingement distances beyond 40% of the flame length, from its source. The greatest heat flux is not necessarily on the directly impinged side.*

kW/m<sup>2</sup>

*Kilowatt per square meter – unit for measuring the heat radiation (or heat flux).*

LFL / LEL

*Lower Flammable Limit / Lower Explosive Limit - The lowest concentration (percentage) of a gas or a vapor in air capable of producing a flash of fire in presence of an ignition source.*

MSDS

*Material Safety Data Sheet.*

mm Hg

*A millimeter of mercury is a manometric unit of pressure, formerly defined as the extra pressure generated by a column of mercury one millimeter high.*

MEL

*Maximum Exposure Limit.*

NFPA

*National Fire Protection Association.*

N

*North Direction.*

NE

*Northern East Direction.*

NW

*Northern West Direction.*

N/D

*Not Determined. (It means not getting results from the software's calculations)*



N/R	<i>Not Reached. (It means the resulting consequence doesn't reach the surrounding receptors "if any")</i>
OGP	<i>Oil and Gas Producers.</i>
ppm	<i>Part Per Million.</i>
PRMS	<i>Pressure Reduction and Metering Station.</i>
P&ID's	<i>Piping and Instrumentation Diagrams.</i>
PETROSAFE	<i>Petroleum Safety and Environmental Services Company.</i>
QRA	<i>Quantitative Risk Assessment Study is a formal and systematic approach to estimating the likelihood and consequences of hazardous events, and expressing the results quantitatively as risk to people, the environment or your business.</i>
Risk	<i>Relates to the probability of exposure to a hazard, which could result in harm to personnel, the environment or public. Risk is a measure of potential for human injury or economic loss in terms of both the incident likelihood and the magnitude of the injury / loss.</i>
Risk Assessment	<i>The identification and analysis, either qualitative or quantitative, of the likelihood and outcome of specific events or scenarios with judgments of probability and consequences.</i>
scm/hr	<i>Standard Cubic Meter Per Hour.</i>
SCBA	<i>Self-Contained Breathing Apparatus.</i>
SE	<i>Southern East Direction.</i>
SW	<i>Southern West Direction.</i>
TWA	<i>Time Weighted Averages.</i>
UFL/UEL	<i>Upper flammable limit, the flammability limit describing the richest flammable mixture of a combustible gas.</i>
UVCE	<i>When a flammable vapor is released, its mixture with air will form a flammable vapor cloud. If ignited, the flame speed may accelerate to high velocities and produce significant blast overpressure.</i>
V	<i>Volume.</i>
Vapor Cloud Explosion (VCE)	<i>An explosion in air of a flammable material cloud.</i>



## Objectives

The objectives of this QRA for the unit facilities are:

- Identify hazardous scenarios related to the facilities based on historical data recorded;
- Determine the likelihood (frequencies) of the identified scenarios;
- Model the potential consequences of the identified scenarios;
- Determine the Potential risk of fatality resulting from the identified hazardous scenarios;
- Evaluate the risk against the acceptable risk level to ensure that it is within As Low As Reasonably Practicable "ALARP", otherwise additional control measures and recommendations will be provided at this study to reduce the Risk, (*ALARP*).



## Quantitative Risk Assessment Study Scope

The scope of work of this QRA study is limited to the following:

- Identification of the Most Critical Event<sub>(s)</sub> or scenarios that may lead to fatal accidents as well as to ensure that the expected risk will not exceed the Acceptable Risk Level as per national and international standards;
- To assess and quantify the risks associated with El- Kasasin PRMS and the off-take point on the neighboring / surrounding community;
- The study determines Frequencies, Consequences (Including Associated Effect Contours) and Potential Risk of Fatality for the identified hazardous scenarios;
- Normal operations of the facilities (e.g. Construction and specific maintenance activities) are excluded from this analysis.



## Quantitative Risk Assessment "QRA" Studies

### Method of Assessment

#### *1.General Method Used*

Attention mainly focussed on those accidents where a gross failure of containment could result in the generation of a large vapour cloud of flammable or toxic material. The approach adopted has involved the following stages:

- Identification of hazardous materials,
- Establishment of maximum total inventories and location.

During the site visit by the study team, the overall functioning of the site discussed in some detail and the Companies asked to provide a complete list of holdings of hazardous materials. A preliminary survey notes was issued by the team, as a private communication to the company concerned, and this formed the basis for subsequent more discussion and analysis.

From the PRMS design model provided by the client, it was impractical to examine in depth all possible failure modes for all parts within the time allowed for this study. Instead, only those potential failures, which might contribute, either directly or indirectly, to off-site risks were examined.

#### *2.Risk Assessment*

As the PRMS designed and prepared for construction, so it was therefore necessary for the study team to identify and analyse the hazards potential from first principles the routes by which a single or multiple accident could affect the community or neighbouring.

The terms of reference required the team to investigate and determine the overall risk to health and safety both from individual installations and then foreseeable interactions.

The assessment of risk in a complex situation is difficult. No method is perfect as all have advantages and limitations.

It was agreed that the quantitative approach was the most meaningful way of comparing and evaluating different risks. The risk assessment framework shown in Figure (1) used for the study.



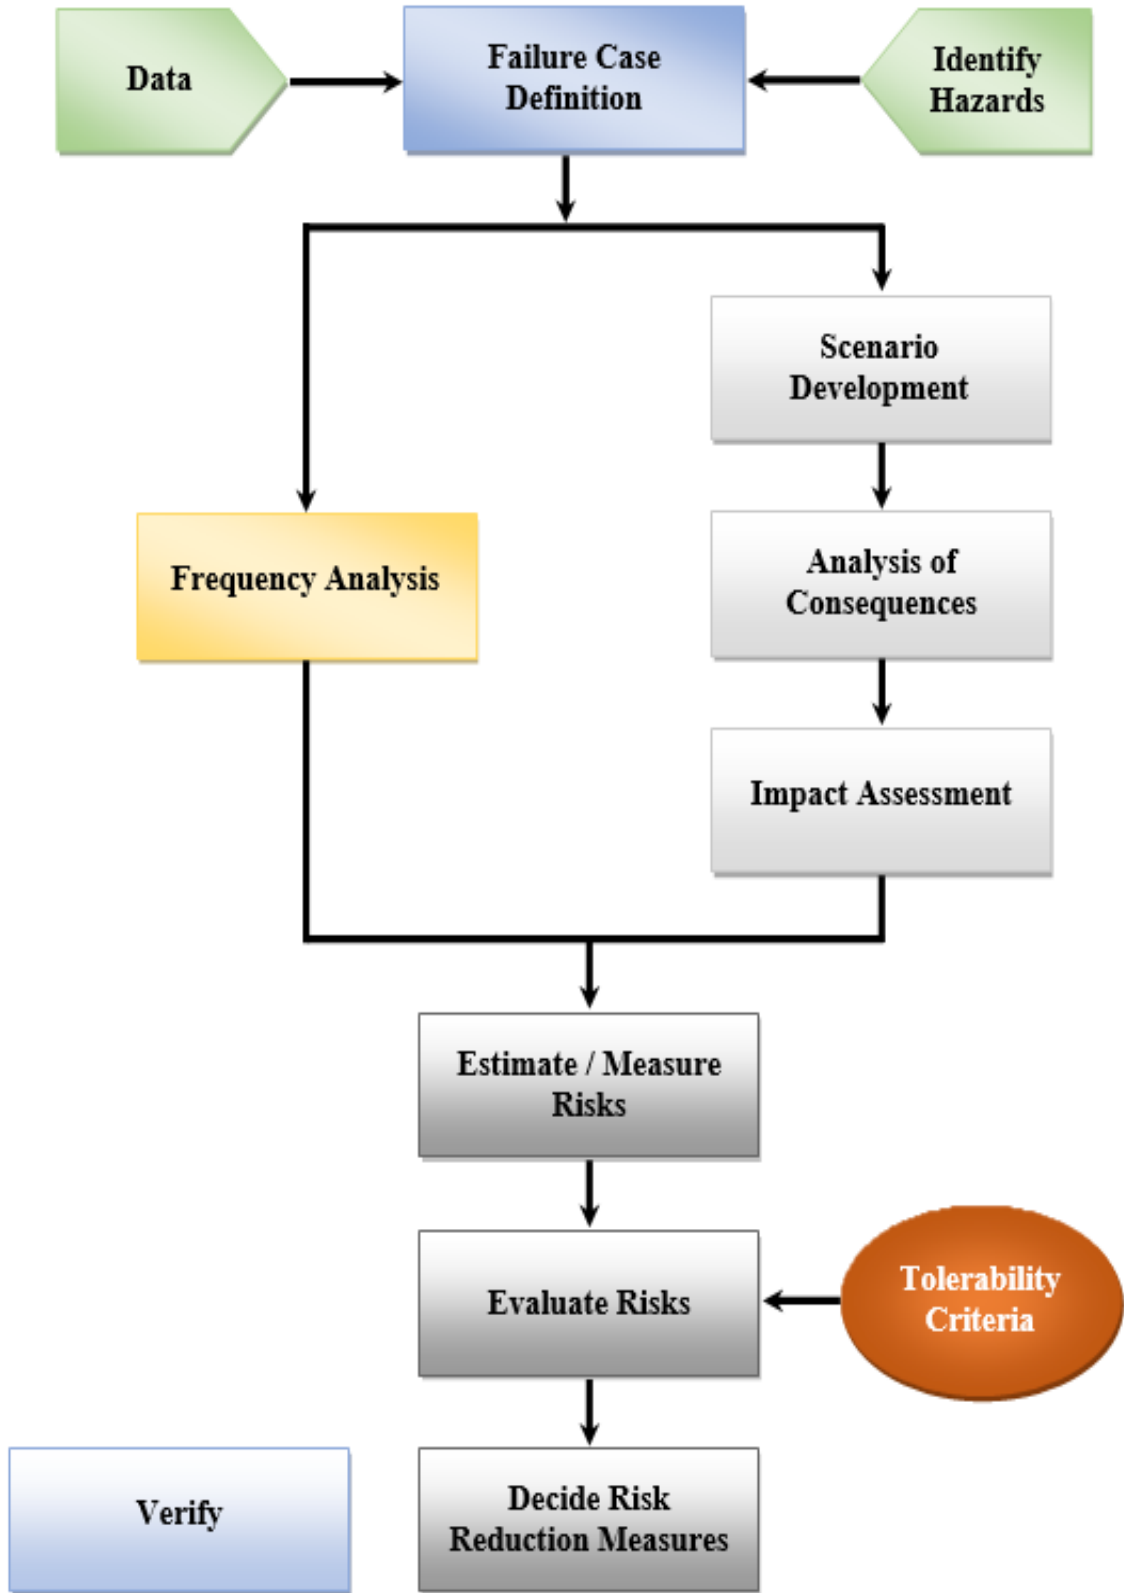


Figure 1 Risk Assessment Framework



## Modelling the Consequences

Modelling of the consequences is one of the key steps in Quantitative Risk Assessment "QRA", as it provides the link between hazard identification (in this study Potential Loss of Containment Incidents) and the determination of possible impact of those incidents on People (Worker / Public), Asset and the Environment.

In this study, Natural Gas (Mainly Methane CH<sub>4</sub>) was considered. There are several types of consequences to be considered for modelling, these include Gas Dispersion (UFL - LFL - 50 % LFL) / Heat Radiation / Explosion Overpressure modelling, also each of these scenarios described in the following table:

*Table 1. Description of Modeling of the Different Scenario*

<b><i>Discharge Modeling</i></b>	<i>Modeling of the mass release rate and its variation overtime.</i>
<b><i>Radiation Modeling</i></b>	<i>Modeling of the Thermal radiation from fires.</i>
<b><i>Dispersion Modeling</i></b>	<i>Modeling of the Gas and two-phase releases.</i>
<b><i>Overpressure</i></b>	<i>Associated with explosions or pressure burst.</i>

Toxic hazards are considered as result of releases / loss of containment for which discharge modeling and gas dispersion modeling are required. The hazard ranges are dependent upon the condition of the release pressure and rate of release.

There are a number of commercial software for modeling gas dispersion, fire, explosion and toxic releases. PETROSAFE select the DNV PHAST Ver. 8.6 Software package in modeling scenarios.

The software developed by DNV in order to provide a standard and validated set of consequence models that can be used to predict the effects of a release of hydrocarbon or chemical liquid or vapour. (Results of the modeling presented in pages from 48 to 93)



## Criterion for Risk Tolerability

The main function of this phase of the work was to assess the effectiveness of the proposed arrangement for managing risks against performance standards.

In order to do this, we need firstly to define a performance standard and secondly, to be able to analyse the effectiveness of the arrangements in a manner which permits a direct comparison with these standards.


The defining of performance standards undertakes at the following three levels:

- Policy-based
- System
- Technical

Where the present work is mainly concerned with the assessment against the standards associated with the first two levels.

The policy-based performance standard relates to this objective to provide a working environment, where the risk to the individual reduced to a level that is ALARP.

This performance standard is therefore, expressed in the form of individual risk and the arrangements for managing this risk should result in a level of 'Individual Risk', based on a proposed Tolerability Criteria, Figure (2).

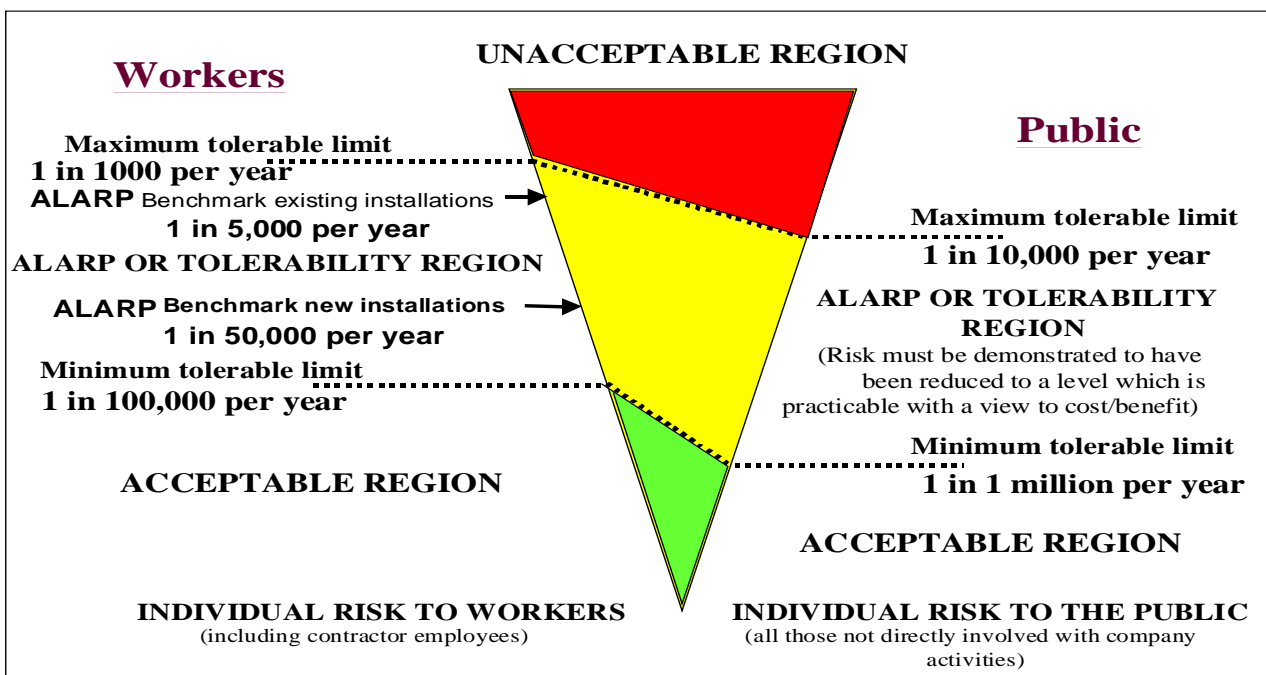

**Figure 2. Criteria for Individual Risk Tolerability**




The criterion for IR tolerability for workers and to the public outlined in Table (2) and Figure (3).

It should be noted that these criteria proposed only as a guideline. Risk assessment is no substitute to professional judgement.

**Table 2. Proposed Individual Risk (IR) Criteria (per person/year)**

Risk Level	Workers	Public
<i>Intolerable</i>	$> 10^{-3}$ per person/yr.	$> 10^{-4}$ per person/yr.
<i>Negligible</i>	$> 10^{-5}$ per person/yr.	$> 10^{-6}$ per person/yr.

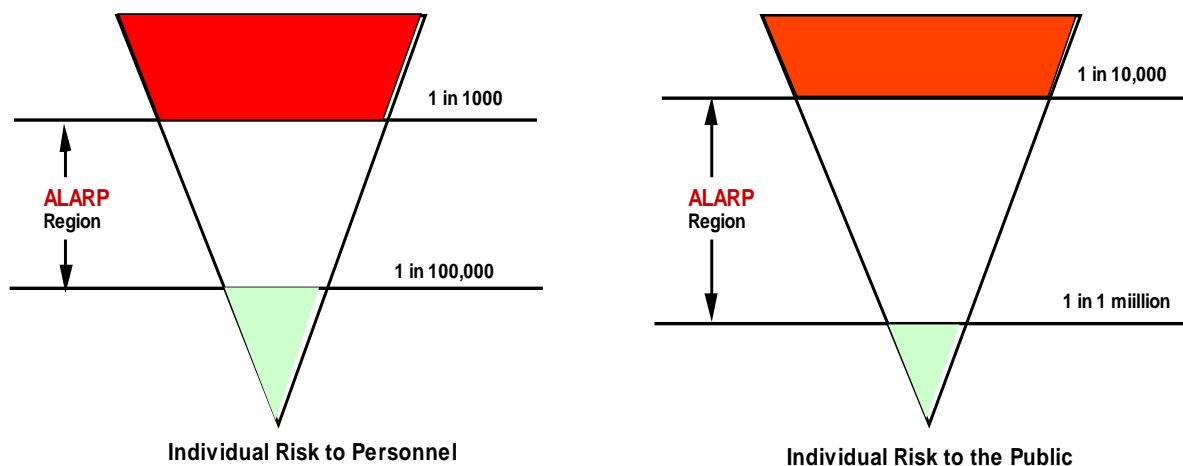

**Figure 3. Proposed Individual Risk Criteria**

Workers would include the Company employees and contractors. The public includes the public, visitors, and any third party who is not directly involved in the Company work activities.

On this basis, we have chosen to set our level of intolerability at Individual Risk for workers of 1 in 1,000 per year, and we define an individual risk of 1 in 100,000 per year as broadly acceptable. Consequently, our ALARP region is between 1 in 1,000 and 1 in 100,000 per person/year.

It is important to ensure that conflict between these subordinate standards and those stemming from international codes and standards are avoided and that any subordinate standards introduced are at least on a par with or augment those standards, which are associated with compliance with these international requirements. These system level performance standards are included as part of the summaries from the QRA. These used as the basis for assessing the



suitability and sufficiency of Town Gas Site arrangements for both protecting personnel on site and members of public from major hazards and securing effective response in an emergency. Failure to meet acceptance criteria at this level results in the identification of remedial measures for assessment both qualitatively and quantitatively.

The analytical work uses a system analysis approach and divided into a number of distinct phases:

- Data collection, including results from site-based qualitative assessments.
- Definition of arrangements.
- Qualitative evaluation of arrangements against a catalogue of fire and explosion hazards from other major accident hazards.
- Preparing of event tree analysis models.
- Consolidation of list of design events.
- Analysis of the effect of design events on fire, explosion and toxic hazard management and emergency response arrangements.
- Quantification of that impact in terms of individual risk.

The main model would base on a systems approach, and it takes the following form:

- Estimates of incremental individual risk (IIR) per person/yr.
- Is caused-consequences based.
- Uses event tree analysis to calculate the frequency of occurrence.
- Estimates incremental individual risk utilizing event tree analysis, based on modeling the emergency response arrangements from detection through to recovery to a place of safety.



### Personnel Vulnerability and Structural Damage

A criterion used in the QRA study for the calculation of personnel vulnerability and structural / asset damage because of fire, explosion and toxic release shown in Table (3).

The criteria shown below provide some assumptions for the impairment effects of hydrocarbon releases on personnel and structures, which based on Health and Safety Executive: Methods of approximation and determination of human vulnerability for offshore major accident hazard assessment.

*Table 3. Criteria for Personnel Vulnerability and Structural Damage*

Event Type	Threshold of Fatality	Asset/Structural Damage
Jet and Diffusive Fire Impingement	6.3 kW/ m <sup>2</sup> (1)	- Flame impingement 10 minutes.
	12.5 kW/m <sup>2</sup> (2)	- 300 - 500 kW/m <sup>2</sup> Structural Failure within 20 minutes.
Pool Fire Impingement	6.3 kW/ m <sup>2</sup> (1)	- Flame impingement 20 minutes
	12.5 kW/m <sup>2</sup> (2)	- 100 - 150 kW/m <sup>2</sup> Structural Failure within 30 minutes.
Smoke	2.3% v/v (3)	
	15% v/v (4)	
Explosion Overpressure	300 mbar	100 mbar

- (1) Fatality within 1 - 2 minutes
- (2) Fatal < 1 minute
- (3) Above 2.3%, escape possible but difficult
- (4) No escape possible, fatal in a few seconds

The effects of exposure to fire expressed in terms of heat radiation (kW/m<sup>2</sup>) and overpressure waves shown in Tables (4), (5) and (6).



**Table 4. Heat Radiation Effects on Structures (International Data Bank)\***

Radiation Level kW/m <sup>2</sup>	Observed Effect
<b>37.5</b>	Sufficient to cause damage to process equipment.
<b>25</b>	Minimum energy to ignite wood at indefinitely long exposure (non-piloted).
<b>12.5</b>	Minimum energy required to ignite wood, melting of plastic tubing.

**Table 5. Heat Radiation Effects on People**

Radiation Level kW/m <sup>2</sup>	Effects on People
<b>1.2</b>	Equivalent to heat from sun at midday summer.
<b>1.6</b>	Minimum level at which pain can be sensed.
<b>4 - 6</b>	Pain caused in 15 - 20 seconds, Second Degree burns after 30 seconds.
<b>12</b>	20 % chance of fatality for 60 seconds exposure.
<b>25</b>	100 % chance of fatality for continuous exposure. 50 % chance of fatality for 30 seconds exposure.
<b>40</b>	30 % chance of fatality for 15 seconds exposure.
<b>50</b>	100 % chance of fatality for 20 seconds exposure.

\*Ref.1- OGP, International Association of Oil & Gas Producers, March 2010.

\*Ref.2- API 521.

*Table 6. Effects of Overpressure*

Pressure		Effects / Damage
bar	psig	
0.002	0.03	Occasional breakage of glass windows.
0.006	0.1	Breakage of some small windows.
0.021	0.3	Probability of serious damage beyond this point = 0.05. 10 % glass broken.
0.027	0.4	Minor structural damage of buildings.
0.068	1.0	Partial collapse of walls and roofs, possible injuries.
0.137	2.0	Some severe injuries, death unlikely.
0.206	3.0	Steel frame buildings distorted / pulled from foundation.
0.275	4.0	Oil storage tanks ruptured.
0.344	5.0	Wooden utilities poles snapped / Fatalities.
0.41	6.0	Nearly complete destruction of building.
0.48	7.0	Loaded wagon train overturned.
0.689	10.0	Total destruction of buildings.





## Quantification of the Frequency of Occurrence

The probability of a sequence of events leading to a major hazard is dependent on the probability of each event in a sequence occurring; usually these probabilities may be multiplied together to obtain the end event probability or frequency.

The technique of Quantified Risk Assessment 'QRA' requires data in the form of probability or frequency to be estimated for each input event.

Ideally, data relating to hardware failures and human error that are specific to each plant should be obtained from the company's maintenance and historical records.

Unfortunately, records available were not in the form that allows data relevant to this study to be obtained. Therefore, other sources of data were used as a basis for failure/error scenarios. The sources of information and data are shown in the References section of this report.

## Identification of Scenarios Leading to Selected Failures

For each selected failure scenario, the potential contributory factors were examined, taking into account any protective features available. Typically, the factors examined included:

- Operator error
- Metallurgical fatigue or ageing of materials
- Internal or external Corrosion
- Loss of process control, e.g. pressure, temperature or flow, etc.
- Overfilling of vessels
- Introduction of impurities
- Fire and/or explosion
- Missiles
- Flooding

Account was taken at this stage of those limited releases, which, although in themselves did not constitute a significant off-site hazard could, under some circumstances, initiate a sequence leading to a larger release, as a knock-on effect.

It was noted that the proposed criterion for risk tolerability was used in Egypt by the following organizations: British Gas / British Petroleum / Shell / Total.



## Relevant Weather Data for the Study

### -Weather Data

The Weather Data relevant to this study consists of a list of weather conditions in the form of different combinations of wind-speed/direction, temperature, humidity and atmospheric stability. Table (7)

The weather conditions are an important input into the dispersion calculations and results for a single set of conditions could give a misleading picture of potential hazard.

Met-oceanographic data gathered from Weather base for El- Kasasin Area – Ismailia Governorate over a period of some years.

These data included wind speed, wind direction, air temperature and humidity, as well as current speed, direction and wave height.

*Table 7. Annual Average Temperature, Relative Humidity and Wind Speed / Direction*

<b>• Air Temperature °C</b>		
	Min. Recorded	<b>13.0 °C</b>
	Max. Recorded	<b>28.0 °C</b>
	<i>Annual Average</i>	<b>21.0 °C</b>
<b>• Relative Humidity %</b>		
	Annual Average Morning	<b>80.0 %</b>
	Annual Average Evening	<b>45.0 %</b>
	<i>Annual Average</i>	<b>63 %</b>
<b>• Wind Speed m/s</b>		
	<i>Annual Average</i>	<b>3.3 m / sec.</b>
<b>• Wind Direction</b>		
	<i>Annual Average</i>	<b>N</b>

The general climatic conditions at El- Kasasin Area (Ismailia Governorate) are summarized in Tables No. (8, 9 & 10) Below.



**Table 8. Mean of Monthly Air Temperature (°C) - El- Kasasin Area**

Months	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Temp. (c°)	13	14	17	21	23	27	28	28	26	23	19	15


**Table 9. Mean of Monthly Wind Speed (m/sec) - El- Kasasin Area**

Months	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Wind Speed (m/sec)	2.5	3.9	3.3	3.3	3.9	3.3	2.5	2.5	3.3	2.5	2.2	3.3

**Table 10. Mean of Monthly Average Relative Humidity - El- Kasasin Area**

Months	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Relative Humidity (%)	68.5	64	60	54	53	55	59	62	64	68	69	70

Figure (4) shows the maximum temperatures diagram for Ismailia Governorate (El- Kasasin Area)

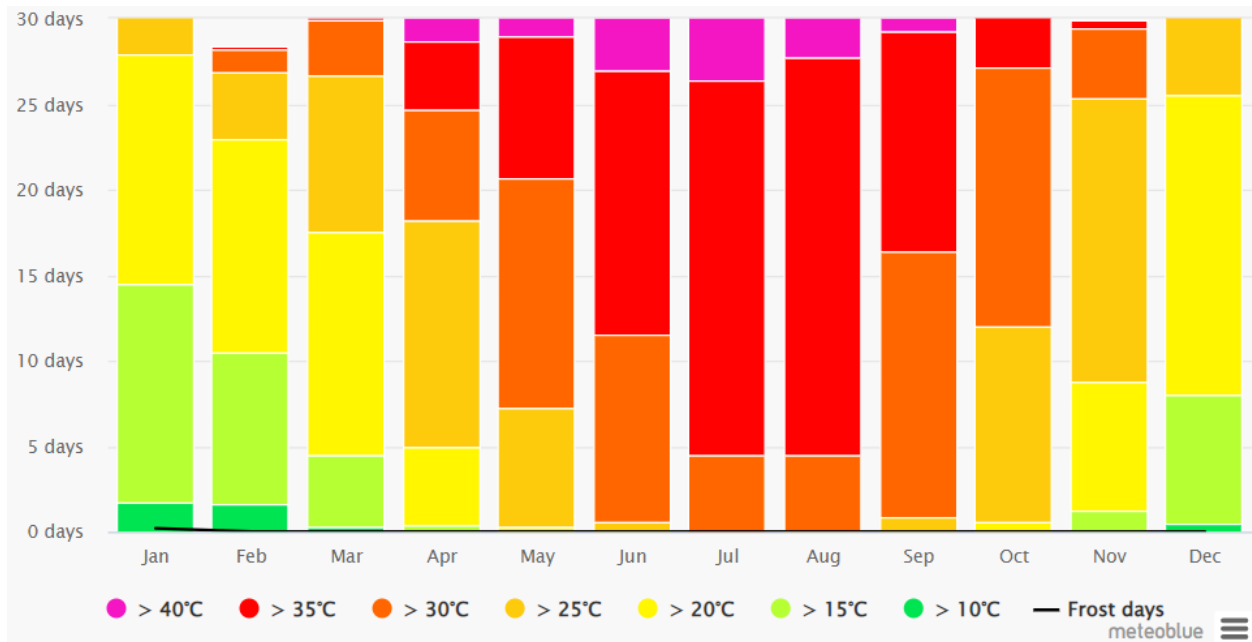

**Figure 4. Monthly Variations of the Maximum Temperature for El- Kasasin Area**

Figures (5 & 6) show the monthly variations of the wind speed as well as wind rose for Ismailia Governorate (El- Kasasin Area) respectively.

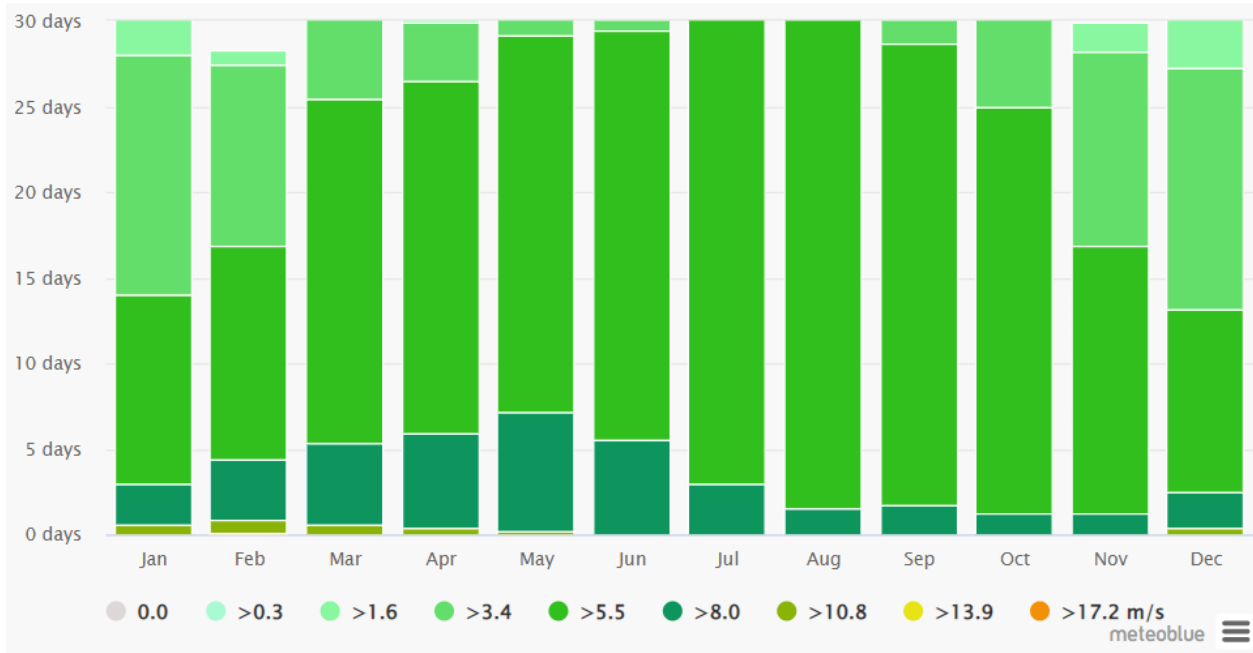


Figure 5. Monthly Variation of the Wind Speed for El- Kasasin Area


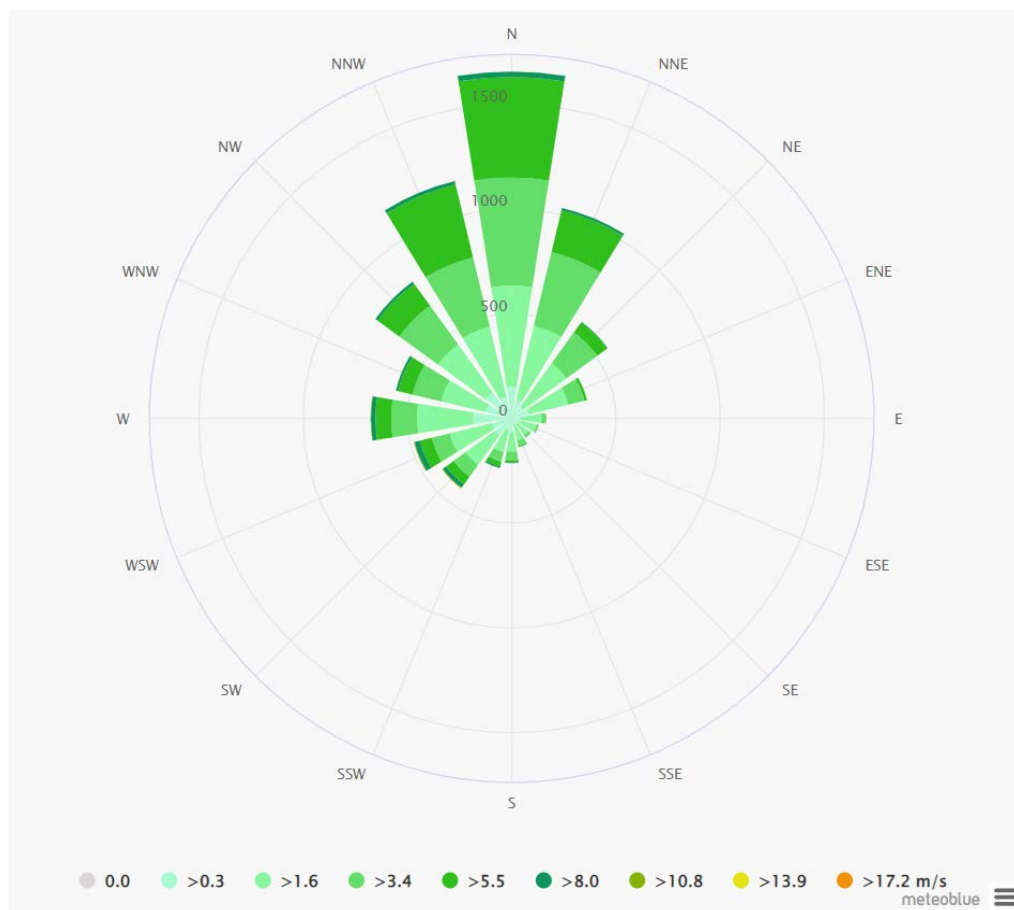


Figure 6. Wind Rose for El- Kasasin Area



Figure (7) shows the monthly variations of the sunny, cloudy and precipitation days for Ismailia Governorate (El- Kasasin Area).

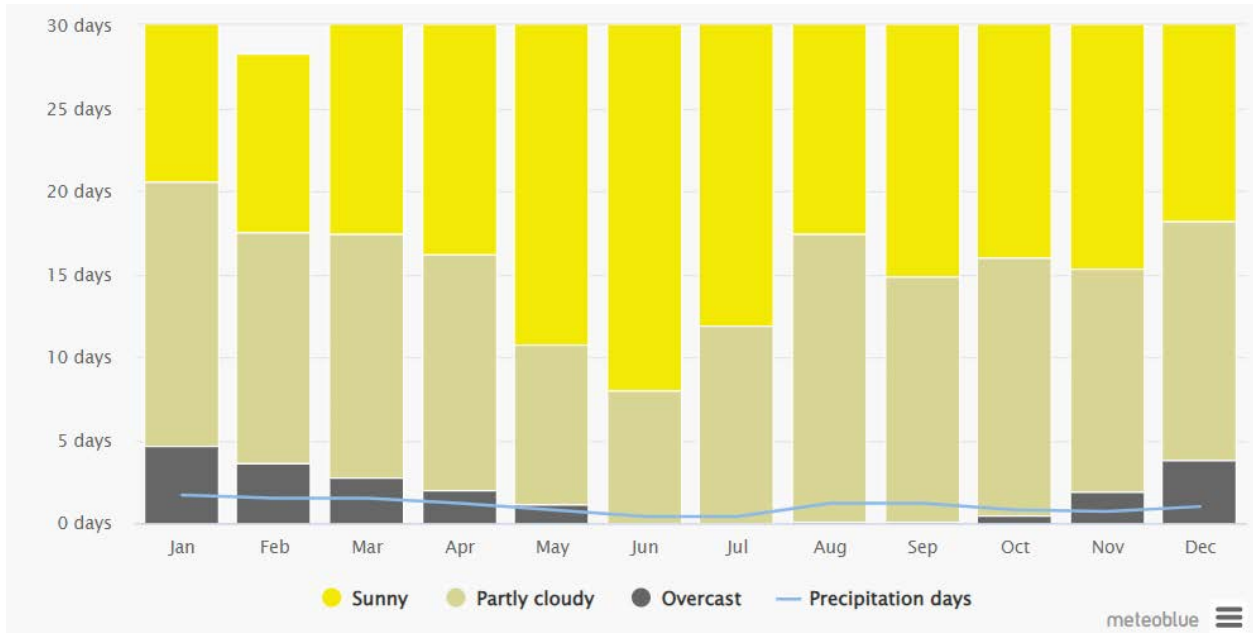

**Figure 7. Monthly Variations of the Sunny, Cloudy and Precipitation days for El- Kasasin Area**



### *-Stability Categories*

The two most significant variables, which would affect the dispersion calculations, are Wind-speed and atmospheric stability. The stability class is a measure of the atmospheric turbulence caused by thermal gradients. Pasqual Stability identifies six main categories, which shown in the Tables (11 & 12) and summarized in Table (13).

*Table 11. Pasqual Stability Categories*

A	B	C	D	E	F
Very Unstable	Unstable	Moderately Unstable	Neutral	Moderately Stable	Stable

Neutral conditions correspond to a vertical temperature gradient of about 1° C per 100 m.

*Table 12. Relationship between Wind Speed and Stability*

Wind speed (m/s)	Day-time Solar Radiation			Night-time Cloud Cover		
	Strong	Medium	Slight	Thin <3/8	Medium >3/8	Overcast >4/5
<2	A	A-B	B	-	-	D
2-3	A-B	B	C	E	F	D
3-5	B	B-C	C	D	E	D
5-6	C	C-D	D	D	D	D
>6	C	D	D	D	D	D

*Table 13. Sets of Weather Conditions Selected for Current Study*

Set for Wind Speed and Stability	
Wind speed	Stability
3.3 m/sec.	D



## El- Kasasin PRMS Description

### Background

El- Kasasin Pressure Reduction and Metering Station is Operated by Town Gas Company. It is located at 5.7 km from Abu-Sweir area and 11.5 km from El-Kasasin area, and 315 m from 30<sup>th</sup> June axis Road. The PRMS will provide the natural gas to El- Kasasin and Abu- Sweir areas and surrounding area public housing.

The PRMS feeding will be from the National Gas Pipeline owned by GASCO and the off-take point is located next to the PRMS premises. The off-take point pressure will be from 20 to 70 bar, later the pressure is reduced to 7 bar at the PRMS facilities following the adding of odorant. As for the last step of the station, the pipeline is connected to the internal distribution network to public housing at El- Kasasin / Abu-Sweir and surrounding areas.

### The PRMS Location Coordinates (Town Gas Data)

*Table 14. Location Coordinates of PRMS*

Point	Off-take		PRMS	
	North (N)	East (E)	North (N)	East (E)
1	30°33'39.57"	32° 3'25.41"	30°33'41.16"	32° 3'23.08"
2	30°33'39.55"	32° 3'26.45"	30°33'41.23"	32° 3'24.93"
3	30°33'41.19"	32° 3'26.52"	30°33'42.85"	32° 3'24.93"
4	30°33'41.19"	32° 3'25.45"	30°33'42.78"	32° 3'23.06"

### PRMS Brief Description and Component list (Town Gas Data)

The PRMS will be surrounded by 3 m height fence and mainly consist of the following:

- Inlet module: which contains 6" pipeline #600 RF isolation inlet manual ball valve.
- Filter module: two identical streams each contain required instrumentation and valves + 1m<sup>3</sup> Condensate tank + one future connections with manual ball valve DN4" #600.
- Heating system module: Inlet and outlet header DN4" #600.
- Metering module: two identical existing each with one inlet manual isolation ball valve DN3" #600 + one future connection DN3" #600.



- Regulating module: two identical regulating lines existing each with one inlet manual isolation ball valve DN3" #600 + one future connection DN3" #600 to WBH.
- Outlet module: contains DN8" #150 butterfly valve/ manual ball valve.
- Odorant module: 600 lit. capacity bulk tank / 50 lit. daily usage
- Off-take point from up-ground GASCO room surrounded by 3 m height brick wall fence next to the PRMS.
- Security Office (one floor)
- Administration office (one floor)
- Firefighting Facilities (Fire Water Tank / Pumps / Fire water Network / Powder Fire Extinguishers)

### El- Kasasin PRMS Units (Town Gas Data)

*Table 15. El- Kasasin PRMS Units*

No	PRMS Units	Capacity	Size
1	<b><i>Inlet unit</i></b>		
	Inlet valve	20000 scmh	6"
	Inlet valve bypass (ball + plug)		2"
2	<b><i>Filter units</i></b>		
	Line F1	10000 scmh	4" * 3"
	Line F2	10000 scmh	4" * 3"
	Line F3(only two valves)	10000 scmh	4" * 3"
3	<b><i>Meter unit</i></b>		
	Line M1	10000 scmh	3" * 4" * 3"
	Line M2	10000 scmh	3" * 4" * 3"
	Line M3(only two valves)	10000 scmh	3" * 3"
	Line M3 (only blind flange)	----	---
	Line M4 (only blind flange)	----	---
	One extension ball valve on outlet header (future heater)	20000 scmh	4"





	One ball valve full bore for heater bypass	20000 scmh	4"
4	<b>Heater unit</b>		
	Line H1 (150 kw)	----	----
	Heater bypass Line	----	----
	Line H2 (only two valves)	----	----
5	<b>Regulator unit</b>		
	Line R1	10000 scmh	3" * 6"
	Line R2	10000 scmh	3" * 6"
	Line R3(only two valves)	10000 scmh	3" * 6"
	Line R3(only blind flange)	-----	---
	Line R4(only blind flange)	-----	---
	One extension ball valve on inlet header (future heater)	20000 scmh	4"
6	<b>Odorant unit</b>		
	Electrical pumps		
	Lapping system		
7	<b>Outlet unit</b>		
	Outlet valve	20000 scmh	8"
	Extension valve (future)		
8	<b>Monitoring and Control unit</b>		
9	<b>Generator (15 KVA)</b>		
10	<b>UPS</b>		

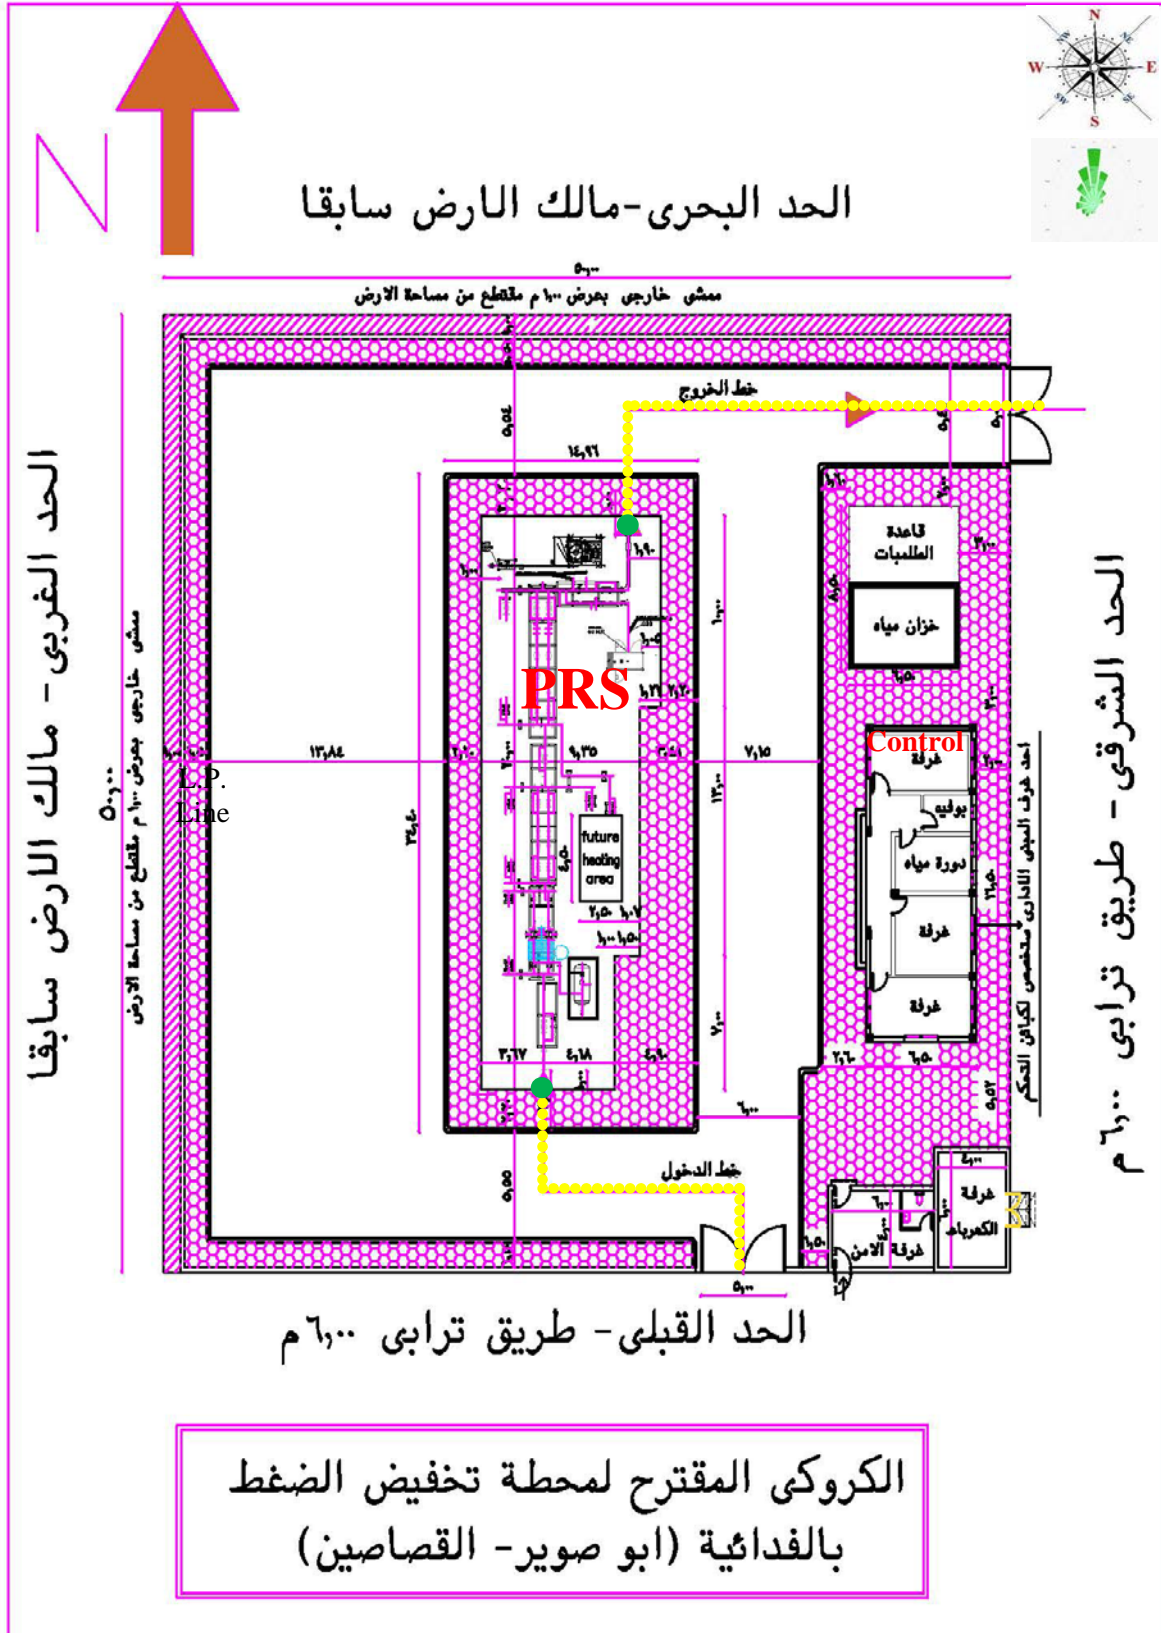


Figure 8. El- Kasasin PRMS Layout

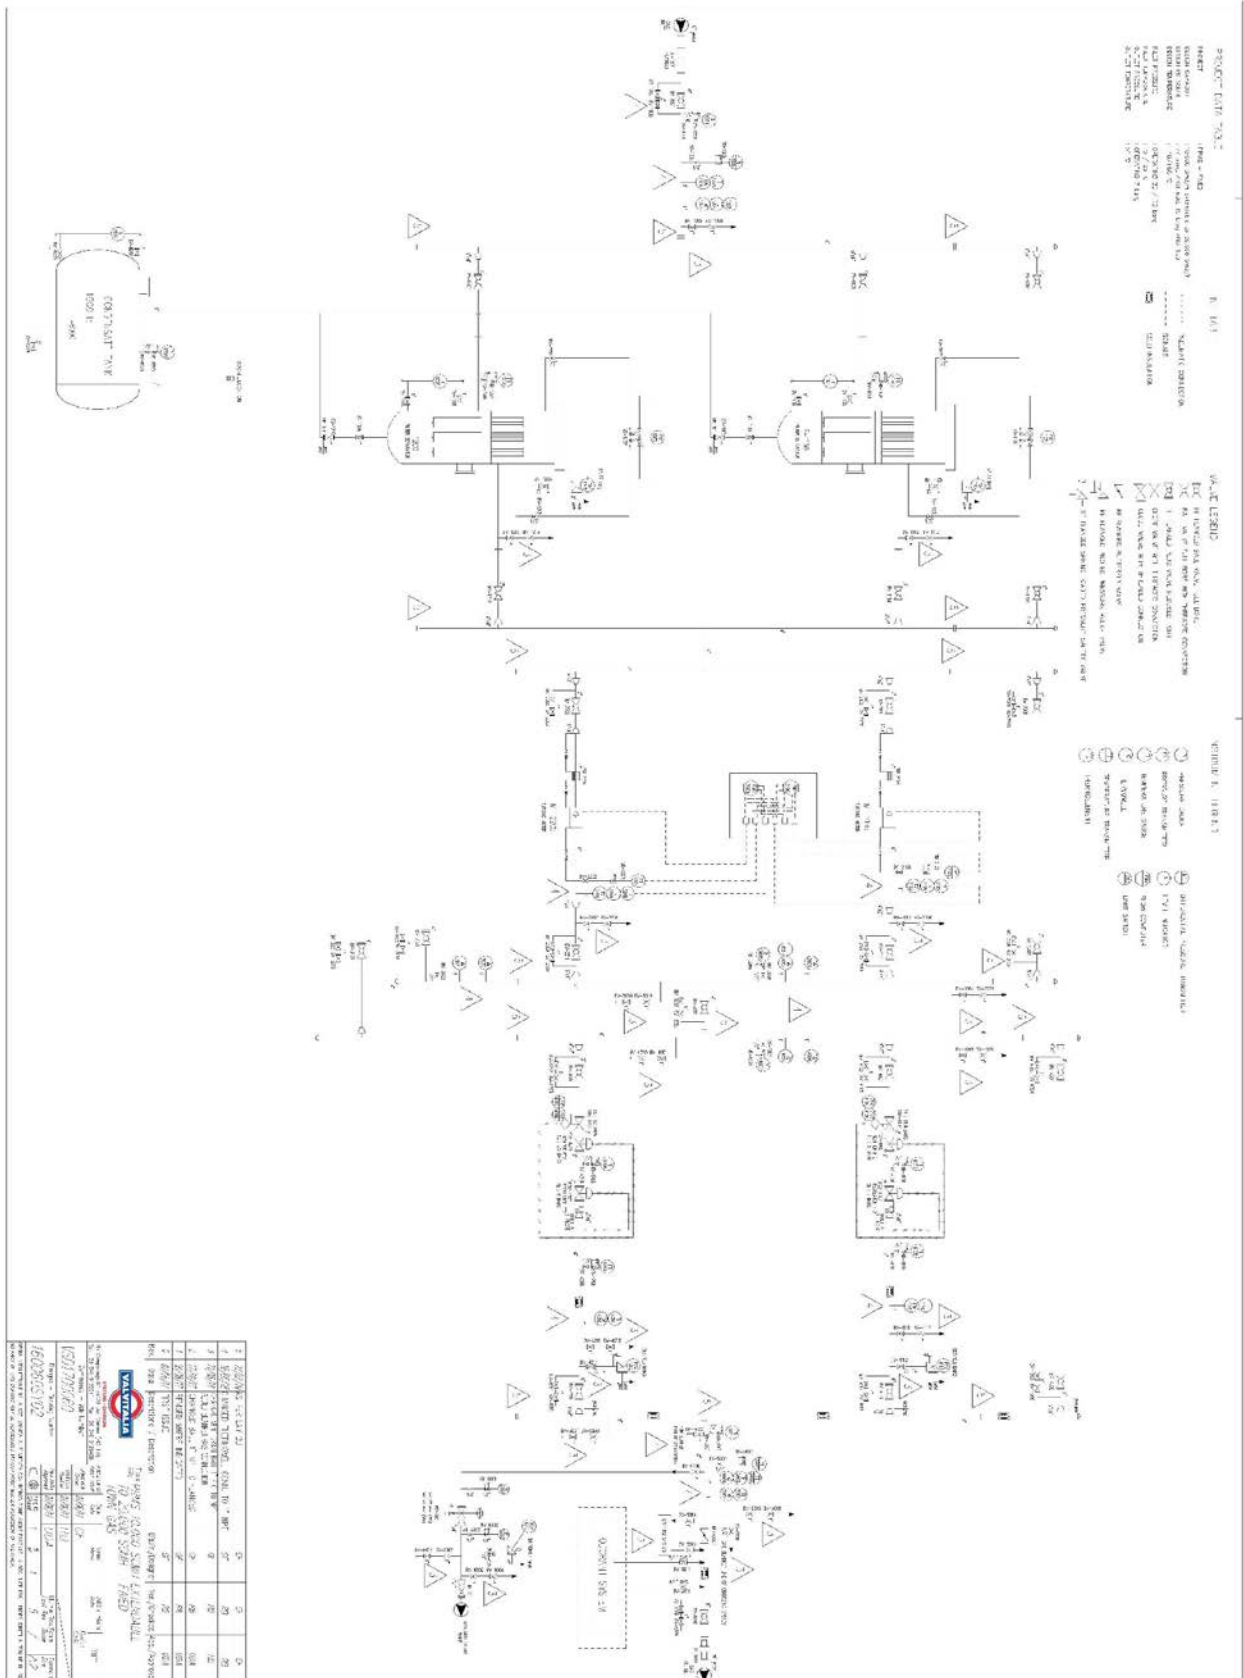


Figure 9. El- Kasasin PRMS Piping and Instrumentation Diagram "P&ID"

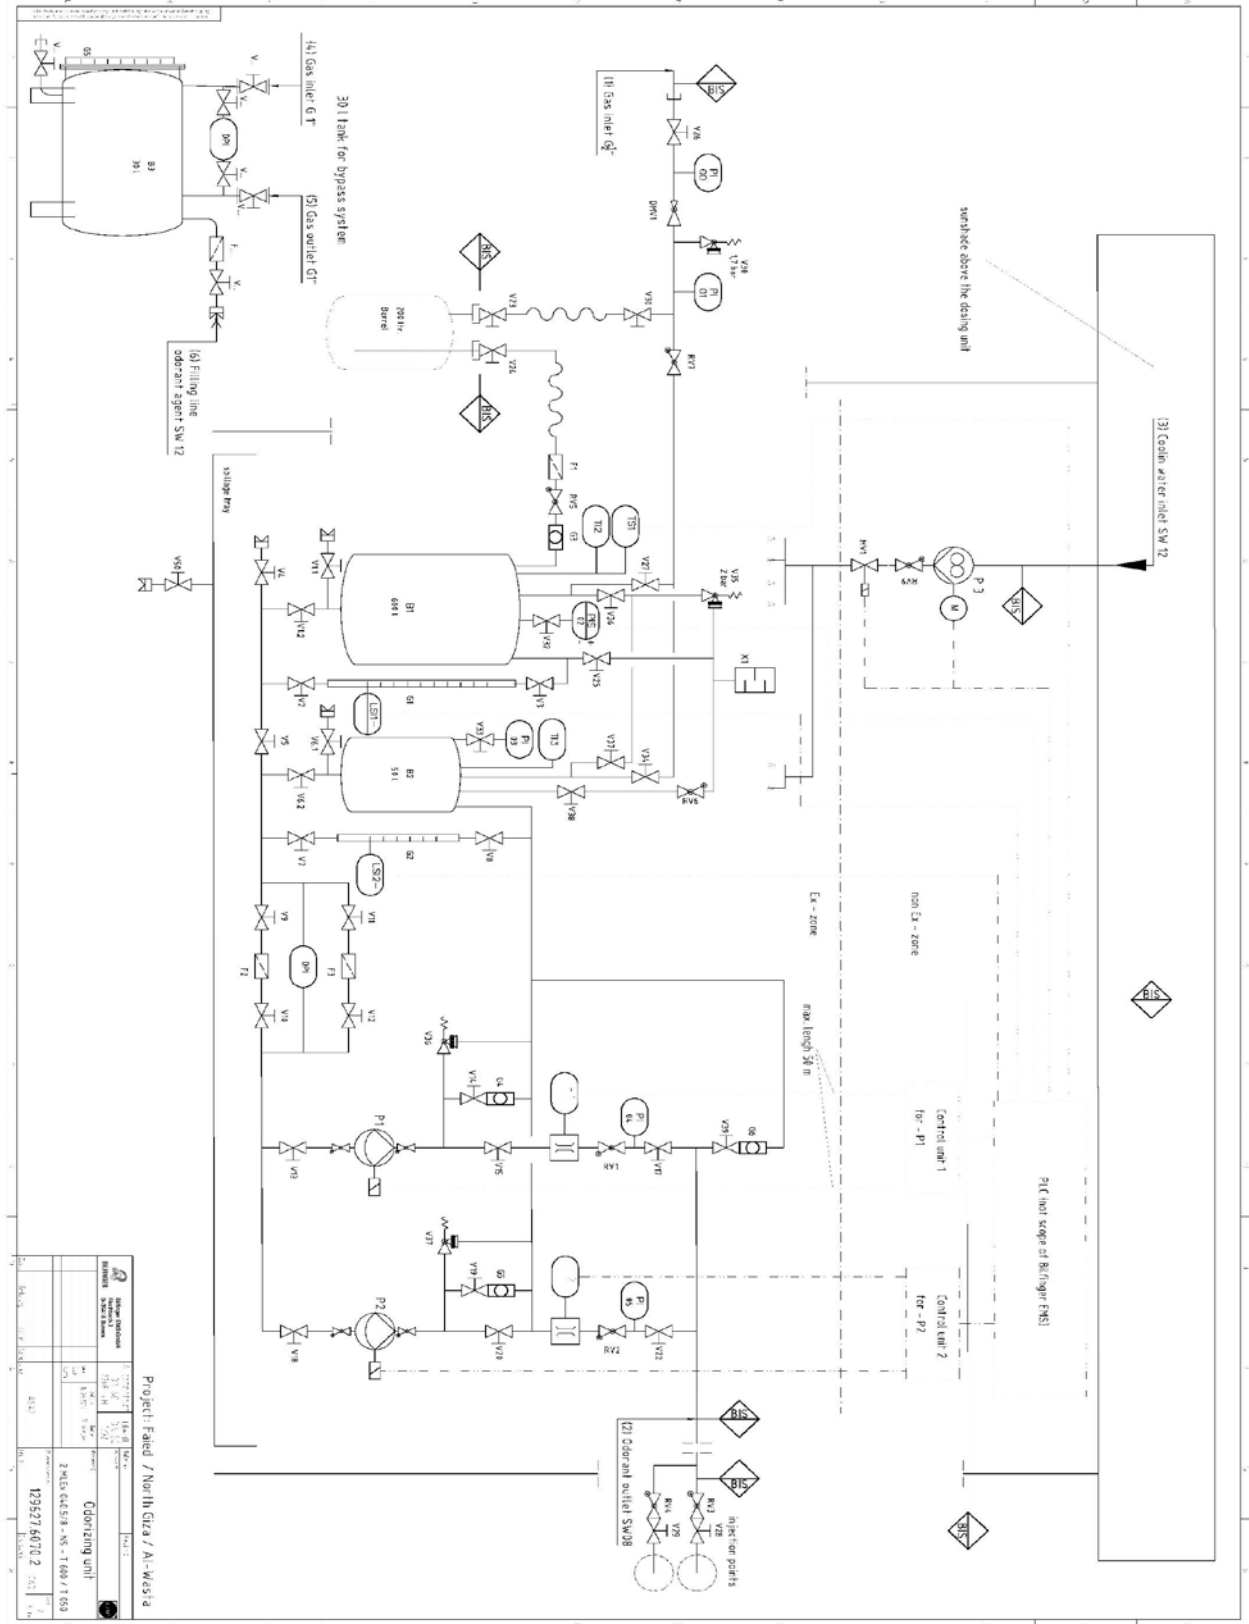


Figure 10 El- Kasasin Odorant Piping and Instrumentation Diagram "P&ID"



Figure 11. El-Kasasin PRMS and Surroundings Plotted on Google Earth Photo



### Process Condition Data (Town Gas Company Data)

The following *Table 16*. describes the process conditions for El- Kasasin PRMS:

*Table 16. Process Conditions / Gas Components and Specifications*

Process Conditions	
Maximum flow rate scm / hr	10,000
future flow rate scm / hr	20,000
Design pressure bar g	70
Min / Max inlet pressure bar g	70/20
Min / Max outlet pressure bar g	7
Min / Max inlet temperature °C	15 – 25
Outlet temperature °C	Not less than 1

Gas Components	
Gas composition % Mol	
Water	0
H <sub>2</sub> S	4 ppm
Nitrogen	0.2 - 0.83
Carbon Dioxide	0.07 - 3
Methane	77.73 - 99.82
Ethane	0.03 - 15.68
Propane	0.01 - 4.39
I-Butane	0.0 - 1.14
N-Butane	0.0 - 1.01
I-Pentane	0.0 - 0.19
N-Butane	0.0 - 0.26
C6+	0.0 - 0.25

Gas Specifications	
Specific gravity	0.5 - 0.69



## Gas Odorant Specifications

The odorant supplied with a Hazard Data Sheet and identified as Spotleak 1009. Spotleak is an aliphatic mixture in clear liquid form that is extremely flammable, with the following characteristics:

- |                                  |                 |
|----------------------------------|-----------------|
| - Boiling Range                  | 60-70° C        |
| - Flash Point                    | -17.8° C        |
| - Freezing Point                 | -45.5° C        |
| - Density (H <sub>2</sub> O = 1) | 0.812 @ 15.5° C |
| - Vapor Density                  | 3.0 (air = 1)   |
| - Vapor Pressure (mm Hg)         | 6.6 @ 37.8° C   |

### Health Hazards

Spotleak is not carcinogenic, but the major health hazards as a result of exposure to Spotleak include the following:

#### Inhalation

- Short-term exposure: Irritation and central nervous system effects
- Long-term exposure: Irritation

#### Skin Contact

- Short-term: Irritation
- Long-term: Dermatitis

#### Eye Contact

- Short-term: Irritation and tearing
- Long-term: Irritation

#### Ingestion

- Short-term: nausea, vomiting, central nervous system effects
- Long-term: no effects are known

### Hygiene Standards and Limits

PEL: 10 PPM according to OSHA, TWA (NIOSH): 0.5 ppm not to be exceeded during any 15 minute work period. "Refer to Annex 5 of PRS ESIA"

### Fire and Explosion Hazards

Spotleak is a severe fire hazard. Vapor/air mixtures are explosive. Vapor is 3 times heavier than air. Vapor may ignite at distant ignition sources and flash back.

Thermal decomposition products include oxides of sulphur and hydrogen sulphide.



## Fire Fighting and Protection Systems and Facilities

The PRMS will provided by the following fire protection facilities:

- Firewater tank with a capacity of 40 cubic meters.
- Firewater pumps (1 Electrical & 1 Diesel with capacity of 250 gpm each) + one Jockey pump.
- Firewater main with a diameter of 4 inch.
- Four Firewater hydrants (each with a diameter of 3 inch)
- Firewater monitors.
- Smoke detectors in control rooms according to the area.
- Different sizes of fire extinguishers will be distributed at PRMS site.

## Emergency Response Plan "ERP"

There is a general Emergency Response Plan "ERP" for Town Gas PRMS, including the following items:

- Emergency Definitions
- Emergency Cases and Scenarios at the PRS
- Possible causes of these scenarios and their precaution procedures
- ESD conditions and procedures for the PRS.





## Analytical Results of Consequence Modeling


### 1.0. Pressure Reduction Station Inlet Pipeline (6 inch)

#### 1/1- Consequence Modeling for 1 inch (Pin Hole) Gas Release

The following table no. (17) Shows that:

*Table 17. Dispersion Modeling for Inlet - 1" / 6" Gas Release*

Gas Release (Inlet / PRV "High Pressure")					
Wind Category	Flammability Limits	Distance (m)	Height (m)	Cloud Width (m)	
3.3 D	UFL	1.8	1.1	0.1 @ 1.4 m	
	LFL	5.4	1.3	0.5 @ 3 m	
	50 % LFL	10	1.5	1 @ 6 m	
Jet Fire					
Wind Category	Flame Length (m)	Heat Radiation (kW/m <sup>2</sup> )	Distance Downwind (m)	Distance Crosswind (m)	Lethality Level (%)
3.3 D	10	1.6	15.4	10	0
		4	13	6.1	0
		9.5	11.2	3.4	0
		12.5	10.6	2.7	20% /60 sec.
		25	9.1	0.8	80.34
		37.5	Not Reached	Not Reached	98.74
Unconfined Vapor Cloud Explosion - UVCE (Open Air)					
Wind Category	Pressure Value (bar)	Overpressure Radius (m)	Overpressure Waves Effect / Damage		
3.3 D	0.020	10.8	0.021 bar	<i>Probability of serious damage beyond this point = 0.05 - 10 % glass broken</i>	
	0.137	2.8	0.137 bar	<i>Some severe injuries, death unlikely</i>	
	0.206	2.2	0.206 bar	<i>Steel frame buildings distorted / pulled from foundation</i>	

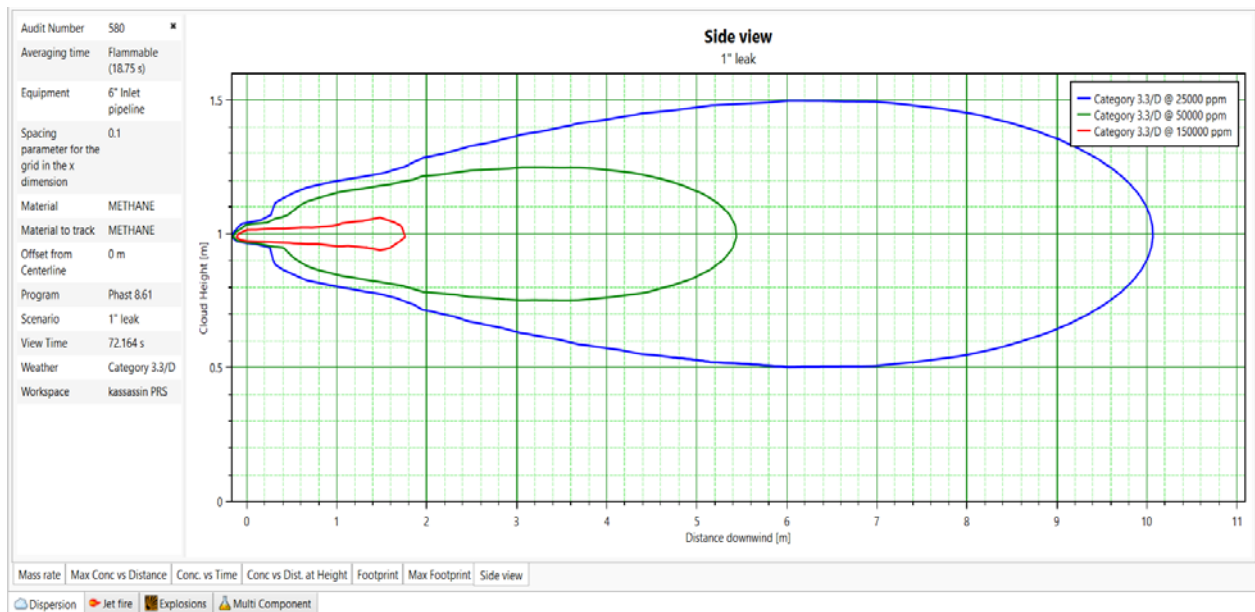

**Figure 12. Gas Cloud Side View (UFL/LFL) (1" hole in 6" Inlet Pipeline)**

- The previous figure shows that if there is a gas release from 1" hole size without ignition the flammable vapors will reach a distance about 10 m downwind and about 1.5 m height.
- The UFL will reach a distance of about 1.8 m downwind with a height of 1.1 m. The cloud large width will be 0.1 m crosswind at a distance of 1.4 m from the source.
- The LFL will reach a distance of about 5.4 m downwind with a height of 1.3 m. The cloud large width will be 0.5 m crosswind at a distance of 3 m from the source.
- The 50 % LFL will reach a distance of about 10 m downwind with a height of 1.5 m. The cloud large width will be 1 m crosswind at a distance of 6 m from the source.

*The modeling shows that the gas cloud effects will be limited inside the PRMS fence.*



**Figure 13. Heat Radiation Contours from Jet Fire (1" hole in 6" Inlet Pipeline)**

- The previous figure shows that if there is a gas release from 1" hole size and ignited the expected flame length is about 10 meters downwind.
- The 4 kW/m<sup>2</sup> heat radiation contours extend about 15.4 meters downwind and 10 meters crosswind.
- The 9.5 kW/m<sup>2</sup> heat radiation contours extend about 13 meters downwind and 6.1 meters crosswind.
- The 12.5 kW/m<sup>2</sup> heat radiation contours extend about 11.2 meters downwind 3.4 meters crosswind.
- The 25 kW/m<sup>2</sup> heat radiation contours extend about 10.6 meters downwind and 2.7 meters crosswind
- The 37.5 kW/m<sup>2</sup> heat radiation contours extend about 9.1 meters downwind and 0.8 meters crosswind

*The modeling shows that the heat radiation values will extend outside the PRMS southern fence with no effects outside.*



**Figure 14 Worst-Case Explosion Overpressure Waves (1" hole in 6" Inlet Pipeline)**

- The previous figure shows that if there is a gas release from 1" hole size and late ignited this will give an explosion with different values of overpressure waves.
- The 0.020 bar overpressure waves will extend about 10.8 meters downwind.
- The 0.137 bar overpressure waves will extend about 2.8 meters downwind.
- The 0.206 bar overpressure waves will extend about 2.2 meters downwind.

*The modeling shows that the value of 0.137 & 0.206 bar will be limited inside the PRMS boundary while 0.020 bar extend outside the PRMS south fence with no effects outside.*



### 1/2- Consequence Modeling for 3 inch (Half Rup.) Gas Release


The following table no. (18) Shows that:

*Table 18. Dispersion Modeling for Inlet - 3" / 6" Gas Release*

Gas Release (Inlet / PRV "High Pressure")				
Wind Category	Flammability Limits	Distance (m)	Height (m)	Cloud Width (m)
3.3 D	UFL	7	1.4	0.6 @ 4 m
	LFL	27	0 – 2.2	2.2 @ 15 m
	50 % LFL	61	0 – 3.6	3.6 @ 35 m

Jet Fire					
Wind Category	Flame Length (m)	Heat Radiation (kW/m <sup>2</sup> )	Distance Downwind (m)	Distance Crosswind (m)	Lethality Level (%)
3.3 D	34.9	1.6	74.4	60	0
		4	58.4	38.3	0
		9.5	48.8	24.7	0
		12.5	46.3	21.4	20% /60 sec.
		25	40.9	14.2	80.34
		37.5	37.6	10.4	98.74


Unconfined Vapor Cloud Explosion - UVCE (Open Air)				
Wind Category	Pressure Value (bar)	Overpressure Radius (m)	Overpressure Waves Effect / Damage	
3.3 D	0.020	48.8	0.021 bar	<i>Probability of serious damage beyond this point = 0.05 - 10 % glass broken</i>
	0.137	12.6	0.137 bar	<i>Some severe injuries, death unlikely</i>
	0.206	9.8	0.206 bar	<i>Steel frame buildings distorted / pulled from foundation</i>

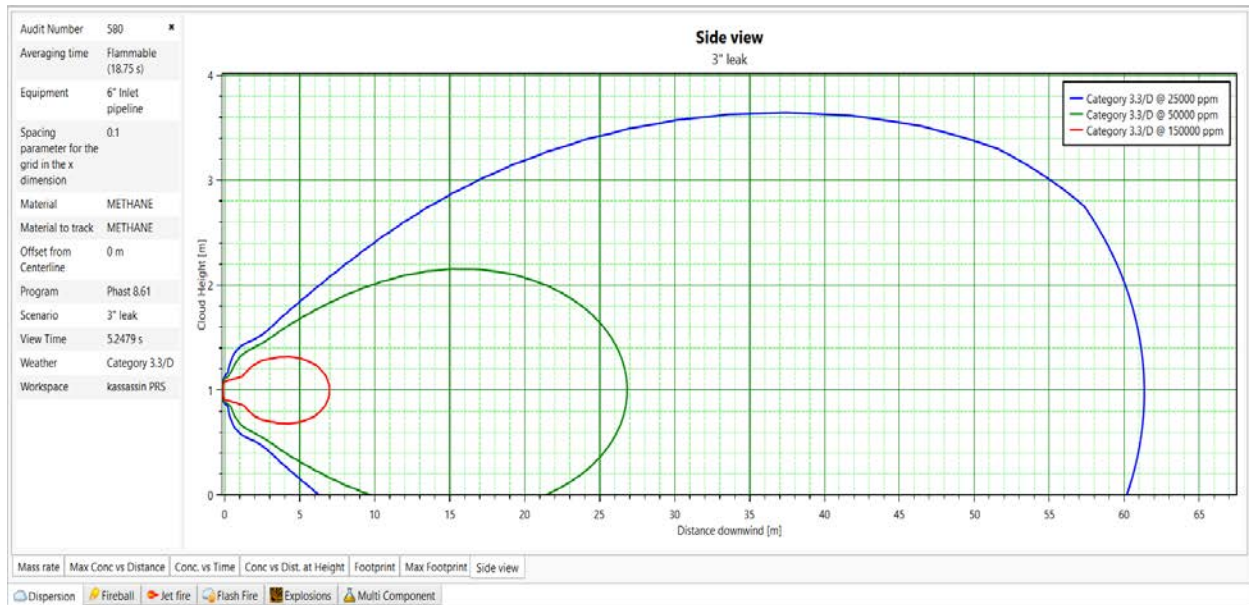

**Figure 15. Gas Cloud Side View (UFL/LFL) (3" hole in 6" Inlet Pipeline)**

- The previous figure shows that if there is a gas release from 3" hole size without ignition the flammable vapors will reach a distance about 61 m downwind and from 0 to 3.6 m height.
- The UFL will reach a distance of about 7 m downwind with a height of 1.4 m. The cloud large width will be 0.6 m crosswind at a distance of 4 m from the source.
- The LFL will reach a distance of about 27 m downwind with a height from 0 to 2.2 m. The cloud large width will be 2.2 m crosswind at a distance of 15 m from the source.
- The 50 % LFL will reach a distance of about 61 m downwind with a height from 0 to 3.6 m. The cloud large width will be 3.6 m crosswind at a distance of 35 m from the source.

*The modeling shows that the gas clouds 50 % LFL & LFL will extend to reach the southern fence and extend outside. The UFL will be limited inside the PRS boundary.*

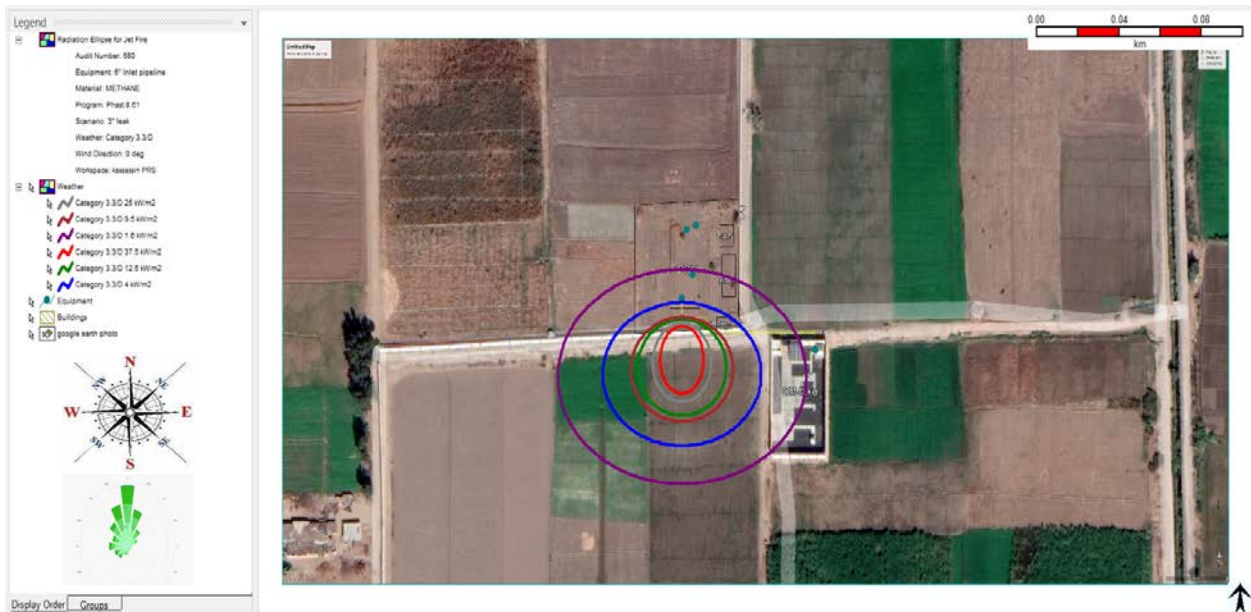

**Figure 16. Heat Radiation Contours from Jet Fire (3" hole in 6" Inlet Pipeline)**

- The previous figure shows that if there is a gas release from 3" hole size and ignited the expected flame length is about 34.9 meters downwind.
- The  $9.5 \text{ kW/m}^2$  heat radiation contours extend about 48.8 meters downwind and 24.7 meters crosswind.
- The  $12.5 \text{ kW/m}^2$  heat radiation contours extend about 46.3 meters downwind and 21.4 meters crosswind.
- The  $25 \text{ kW/m}^2$  heat radiation contours extend about 40.9 meters downwind and 14.2 meters crosswind.
- The  $37.5 \text{ kW/m}^2$  heat radiation contours extend about 37.6 meters downwind and 10.4 meters crosswind.

*The modeling shows that the values of 9.5, 12.5, 25 & 37.5  $\text{kW/m}^2$  will extend outside the PRMS southern fence with no effects outside.*



**Figure 17. Worst-Case Explosion Overpressure Waves (3" hole in 6" Inlet Pipeline)**

- The previous figure shows that if there is a gas release from 3" hole size and late ignited this will give an explosion with different values of overpressure waves.
- The 0.020 bar overpressure waves will extend about 48.8 meters downwind.
- The 0.137 bar overpressure waves will extend about 12.6 meters downwind.
- The 0.206 bar overpressure waves will extend about 9.8 meters downwind.

*The modeling shows that the value of 0.020, 0.137 & 0.206 bar will extend outside the PRMS southern fence.*






### 1/3- Consequence Modeling for 6 inch (Full Rupture) Gas Release

The following table no. (19) Shows that:

*Table 19. Dispersion Modeling for Inlet - 6" Gas Release*

Gas Release					
Wind Category	Flammability Limits	Distance (m)	Height (m)	Cloud Width (m)	
3.3 D	UFL	18	1.8	1.4 @ 10 m	
	LFL	53	0 – 4.2	4.2 @ 35 m	
	50 % LFL	60	0 – 6.2	6.2 @ 45 m	
Jet Fire					
Wind Category	Flame Length (m)	Heat Radiation (kW/m <sup>2</sup> )	Distance Downwind (m)	Distance Crosswind (m)	Lethality Level (%)
3.3 D	73.4	1.6	176.5	143.2	0
		4	136.2	92.4	0
		9.5	110.4	60.4	0
		12.5	104	52.5	20 %/60 sec.
		25	90	35.8	80.34
		37.5	82	27.6	98.74
Unconfined Vapor Cloud Explosion - UVCE (Open Air)					
Wind Category	Pressure Value (bar)	Overpressure Radius (m)	Overpressure Waves Effect / Damage		
3.3 D	0.020	119.8	<b>0.021 bar</b>	<i>Probability of serious damage beyond this point = 0.05 - 10 % glass broken</i>	
	0.137	13	<b>0.137 bar</b>	<i>Some severe injuries, death unlikely</i>	
	0.206	10	<b>0.206 bar</b>	<i>Steel frame buildings distorted / pulled from foundation</i>	

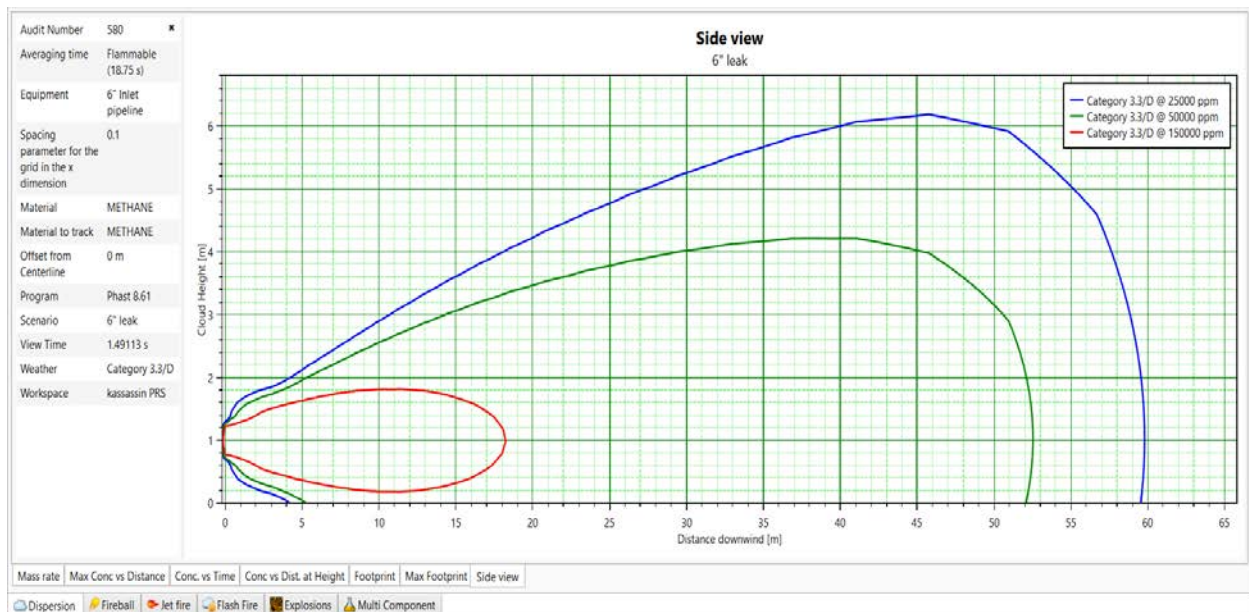

**Figure 18. Gas Cloud Side View (UFL/LFL) (6'' Inlet Pipeline Full Rupture)**

- The previous figure shows that if there is a gas release from 6'' pipeline full rupture without ignition, the flammable vapors will reach a distance of about 60 m downwind and about 6.2 m height.
- The UFL will reach a distance of about 18 downwind with a height of 1.8 m. The cloud large width will be 1.4 m crosswind at a distance of 10 m from the source.
- The LFL will reach a distance of about 53 m downwind with a height from 0 to 4.2 m. The cloud large width will be 4.2 m crosswind at a distance of 35 m from the source.
- The 50 % LFL will reach a distance of about 60 m downwind with a height from 0 to 6.2 m. The large width will be 6.2 m crosswind at a distance of 45 m from the source.

*The modeling shows that the gas cloud effects (LFL & 50 % LFL) will extend outside the PRMS southern fence with no effects outside.*



**Figure 19. Heat Radiation Contours from Jet Fire (6'' Inlet Pipeline Full Rupture**

- The previous figure shows that if there is a gas release from 6'' pipeline full rupture and ignited the expected flame length is about 73.4 meters downwind.
- The 9.5 kW/m<sup>2</sup> heat radiation contours extend about 110.4 meters downwind and 60.4 meters crosswind.
- The 12.5 kW/m<sup>2</sup> heat radiation contours extend about 104 meters downwind and 52.5 meters crosswind.
- The 25 kW/m<sup>2</sup> heat radiation contours extend about 90 meters downwind and 35.8 meters crosswind.
- The 37.5 kW/m<sup>2</sup> heat radiation contours extend about 82 meters downwind and 27.6 meters crosswind.

*The modeling shows that the heat radiation values 9.5, 12.5, 25 & 37.5 kW/m<sup>2</sup> will extend outside the PRMS southern fence, where the 9.5 & 12.5 kW/m<sup>2</sup> reach parts of the neighboring GASCO room.*



**Figure 20. Worst-Case Explosion Overpressure Waves (6" Inlet Pipeline Full Rupture)**

- The previous figure shows that if there is gas release from 6" pipeline full rupture and late ignited this will give an explosion with different values of overpressure waves.
- The 0.020 bar overpressure waves will extend about 119.8 meters radius.
- The 0.137 bar overpressure waves will extend about 13 meters radius.
- The 0.206 bar overpressure waves will extend about 10 meters radius.

*The modeling shows that the value of 0.137 & 0.206 bar will extend outside the PRMS southern fence.*



## 2.0. Pressure Reduction Station Outlet Pipeline (8 inch)

### 2/1- Consequence Modeling for 1 inch (Pin Hole) Gas Release


The following table no. (20) Shows that:

*Table 20. Dispersion Modeling for Outlet - 1" / 8" Gas Release*

Gas Release (Outlet / PRV "Low Pressure")				
Wind Category	Flammability Limits	Distance (m)	Height (m)	Cloud Width (m)
3.3 D	UFL	1	1.05	0.05 @ 0.5 m
	LFL	3.1	1.15	0.3 @ 1.5 m
	50 % LFL	5.5	1.3	0.6 @ 3 m

Jet Fire					
Wind Category	Flame Length (m)	Heat Radiation (kW/m <sup>2</sup> )	Distance Downwind (m)	Distance Crosswind (m)	Lethality Level (%)
3.3 D	6	1.6	8	4.2	0
		4	6.6	2.2	0
		9.5	Not Reached	Not Reached	0
		12.5	Not Reached	Not Reached	20% /60 sec.
		25	Not Reached	Not Reached	80.34
		37.5	Not Reached	Not Reached	98.74

Unconfined Vapor Cloud Explosion - UVCE (Open Air)				
Wind Category	Pressure Value (bar)	Overpressure Radius (m)	Overpressure Waves Effect / Damage	
3.3 D	0.020	N/D	0.021 bar	<i>Probability of serious damage beyond this point = 0.05 - 10 % glass broken</i>
	0.137	N/D	0.137 bar	<i>Some severe injuries, death unlikely</i>
	0.206	N/D	0.206 bar	<i>Steel frame buildings distorted / pulled from foundation</i>

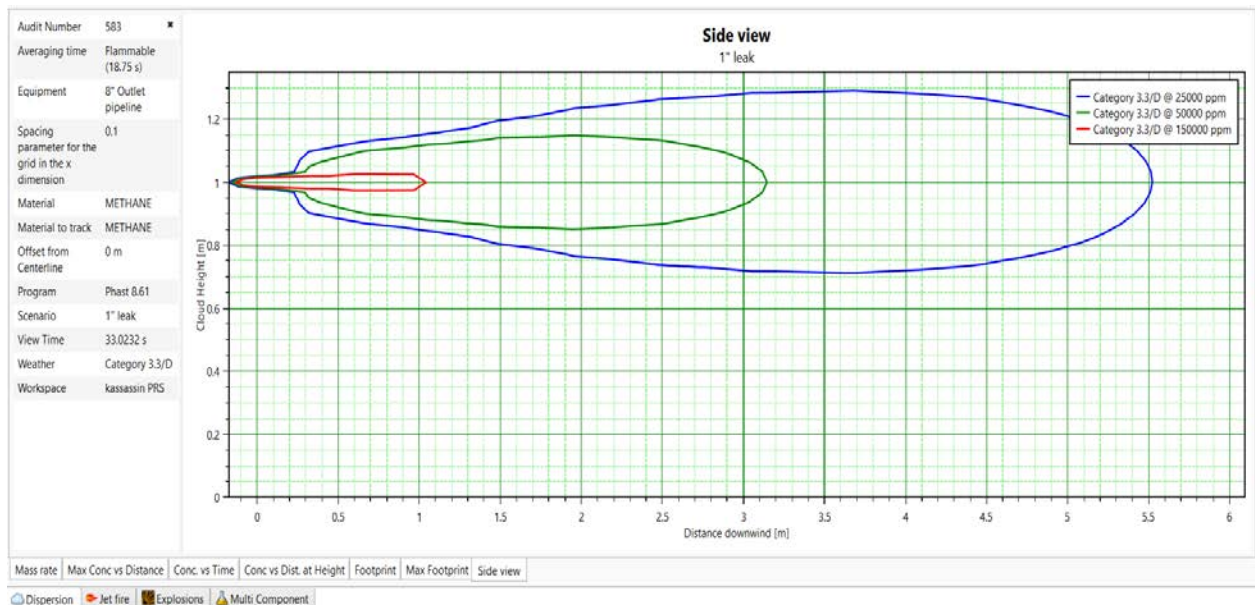

**Figure 21. Gas Cloud Side View (UFL/LFL) (1" hole in 8" Outlet Pipeline)**

- The previous figure shows that if there is a gas release from 1" hole size without ignition the flammable vapors will reach a distance about 5.5 m downwind and over 1.3 m height.
- The UFL will reach a distance of about 1 m downwind with a height of 1.02 m. The cloud large width will be 0.05 m crosswind at a distance of 0.5 m from the source.
- The LFL will reach a distance of about 3.1 m downwind with a height of 1.15 m. The cloud large width will be 0.3 m crosswind at a distance of 1.5 m from the source.
- The 50 % LFL will reach a distance of about 5.5 m downwind with a height of 1.3 m. The cloud large width will be 0.6 m crosswind at a distance of 3 m from the source.

*The modeling shows that the gas cloud will be limited inside the PRS boundary.*



**Figure 22. Heat Radiation Contours from Jet Fire (1" hole in 8" Outlet Pipeline)**

- The previous figure shows that if there is a gas release from 1" hole size and ignited the expected flame length is about 6 meters downwind.
- The 1.6 kW/m<sup>2</sup> heat radiation contours extend about 8 meters downwind and 4.2 meters crosswind.
- The 4 kW/m<sup>2</sup> heat radiation contours extend about 6.6 meters downwind and 2.2 meters crosswind.
- The 25 kW/m<sup>2</sup> heat radiation not reached.
- The 37.5 kW/m<sup>2</sup> heat radiation not reached.

*The modeling shows that the heat radiation value 1.6 & 4 kW/m<sup>2</sup> effects will be limited inside the PRS boundary with no effects.*

*The values of 9.5, 12.5, 25 & 37.5 kW/m<sup>2</sup> are not determined by the software due to small leakage.*



## 2/2- Consequence Modeling for 4 inch (Half Rup.) Gas Release

The following table no. (21) Shows that:

**Table 21. Dispersion Modeling for Outlet - 4" / 8" Gas Release**

Gas Release					
Wind Category	Flammability Limits	Distance (m)	Height (m)	Cloud Width (m)	
3.3 D	UFL	5	1.2	0.4 @ 3 m	
	LFL	17.5	1.8	1.6 @ 10 m	
	50 % LFL	26	0 - 2.7	2.7 @ 18 m	
Jet Fire					
Wind Category	Flame Length (m)	Heat Radiation (kW/m <sup>2</sup> )	Distance Downwind (m)	Distance Crosswind (m)	Lethality Level (%)
3.3 D	26.3	1.6	52.3	41	0
		4	41.6	26	0
		9.5	35	16.7	0
		12.5	33.4	14.3	20% /60 sec.
		25	29.4	9	80.34
		37.5	26.9	6.3	98.74
Unconfined Vapor Cloud Explosion - UVCE (Open Air)					
Wind Category	Pressure Value (bar)	Overpressure Radius (m)	Overpressure Waves Effect / Damage		
3.3 D	0.020	33.5	<b>0.021 bar</b>	<i>Probability of serious damage beyond this point = 0.05 - 10 % glass broken</i>	
	0.137	3.1	<b>0.137 bar</b>	<i>Some severe injuries, death unlikely</i>	
	0.206	2.4	<b>0.206 bar</b>	<i>Steel frame buildings distorted / pulled from foundation</i>	






**Figure 23. Gas Cloud Side View (UFL/LFL) (4" hole in 8" Outlet Pipeline)**

- The previous figure shows that if there is a gas release from 4" hole size without ignition the flammable vapors will reach a distance more than 26 m downwind and 2.7 m height.
- The UFL will reach a distance of about 5 m downwind with a height of 1.2 m. The cloud large width will be 0.4 m crosswind at a distance of 3 m from the source.
- The LFL will reach a distance of about 17.5 m downwind with a height of 1.8 m. The cloud large width will be 1.6 m crosswind at a distance of 10 m from the source.
- The 50 % LFL will reach a distance of about 26 m downwind with a height from 2.7 m. The cloud large width will be 2.7 m crosswind at a distance of 18 m from the source.

*The modeling shows that the gas cloud will be limited inside the PRS boundary.*

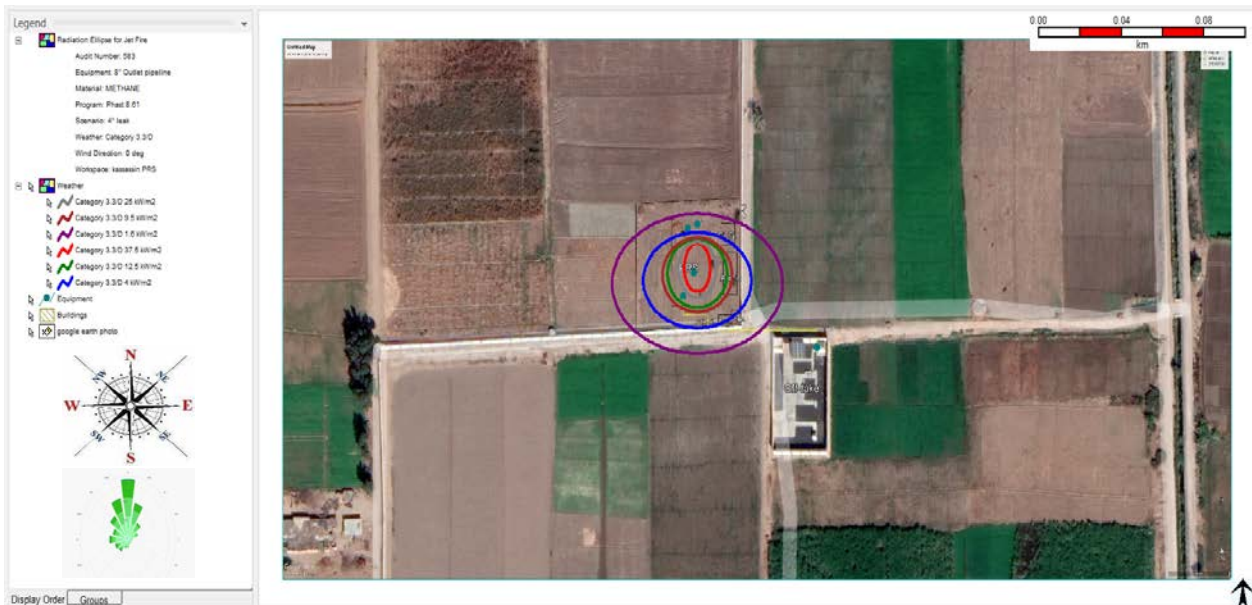

**Figure 24. Heat Radiation Contours from Jet Fire (4'' hole in 8'' Outlet Pipeline)**

- The previous figure shows that if there is a gas release from 4'' hole size and ignited the expected flame length is about 26.3 meters downwind.
- The 9.5 kW/m<sup>2</sup> heat radiation contours extend about 35 meters downwind and 16.7 meters crosswind.
- The 12.5 kW/m<sup>2</sup> heat radiation contours extend about 33.4 meters downwind and 14.3 meters crosswind.
- The 25 kW/m<sup>2</sup> heat radiation contours extend about 29.4 meters downwind and 9 meters crosswind.
- The 37.5 kW/m<sup>2</sup> heat radiation contours extend about 26.9 meters downwind and 6.3 meters crosswind.

*The modeling shows that the heat radiation values of 9.5, 12.5, 25 & 37.5 kW/m<sup>2</sup> are limited to the PRMS boundary, where 9.5 & 12.5 kW/m<sup>2</sup> cover parts of the control rooms and neighboring rooms in the building.*



**Figure 25. Worst-Case Explosion Overpressure Waves (4'' hole in 8'' Outlet Pipeline)**

- The previous figure shows that if there is a gas release from 4'' hole size and late ignited this will give an explosion with different values of overpressure waves.
- The 0.020 bar overpressure waves will extend about 33.5 meters radius.
- The 0.137 bar overpressure waves will extend about 3.1 meters radius.
- The 0.206 bar overpressure waves will extend about 2.4 meters radius.

*The modeling shows that the overpressure values 0.137 & 0.206 bar will be limited inside the PRMS boundary.*



### 2/3- Consequence Modeling for 8 inch (Full Rup.) Gas Release

The following table no. (22) Shows that:


**Table 22. Dispersion Modeling for Outlet - 8" Gas Release**

Gas Release				
Wind Category	Flammability Limits	Distance (m)	Height (m)	Cloud Width (m)
3.3 D	UFL	7	1.3	0.6 @ 4 m
	LFL	16.5	2.1	2.1 @ 12 m
	50 % LFL	18.5	2.7	2.7 @ 14 m

Jet Fire					
Wind Category	Flame Length (m)	Heat Radiation (kW/m <sup>2</sup> )	Distance Downwind (m)	Distance Crosswind (m)	Lethality Level (%)
3.3 D	53.2	1.6	121	99	0
		4	94	63.4	0
		9.5	77	41.2	0
		12.5	73	35.7	20% /60 sec.
		25	63.5	24	80.34
		37.5	58	18	98.74

Unconfined Vapor Cloud Explosion - UVCE (Open Air)				
Wind Category	Pressure Value (bar)	Overpressure Radius (m)	Overpressure Waves Effect / Damage	
3.3 D	0.020	47.4	<b>0.021 bar</b>	<i>Probability of serious damage beyond this point = 0.05 - 10 % glass broken</i>
	0.137	12.3	<b>0.137 bar</b>	<i>Some severe injuries, death unlikely</i>
	0.206	9.5	<b>0.206 bar</b>	<i>Steel frame buildings distorted / pulled from foundation</i>

Fireball			
Wind Category	Heat Radiation (kW/m <sup>2</sup> )	Distance (m)	Heat Radiation (kW/m <sup>2</sup> ) Effects on People & Structures
3.3 D	4	38.6	<b>12.5</b> <i>20 % Chance of fatality for 60 sec exposure</i>
	12.5	21.8	<b>25</b> <i>100 % Chance of fatality for continuous exposure 50 % Chance of fatality for 30 sec exposure</i>
	37.5	11.8	<b>37.5</b> <i>Sufficient of cause process equipment damage</i>

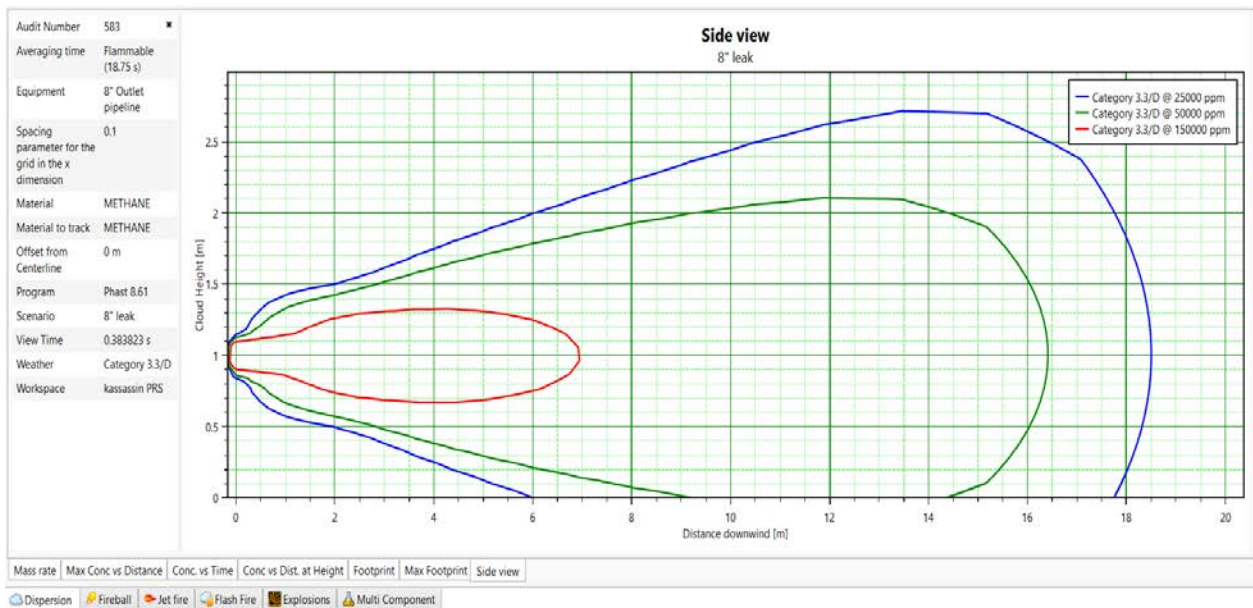

**Figure 26. Gas Cloud Side View (UFL/LFL) (8'' Outlet Pipeline Full Rupture)**

- The previous figure shows that if there is a gas release from 8'' pipeline full rupture without ignition the flammable vapors will reach a distance more than 18 m downwind and about 2.7 m height.
- The UFL will reach a distance of about 7 m downwind with a height of 1.3 m. The cloud large width will be 0.6 m crosswind at a distance of 4 m from the source.
- The LFL will reach a distance of about 16.5 m downwind with a height of 2.1 m. The cloud large width will be 2.1 m crosswind at a distance of 12 m from the source.
- The 50 % LFL will reach a distance of about 18.5 m downwind with a height of 2.7 m. The cloud large width will be 2.7 m crosswind at a distance of 14 m from the source.

*The modeling shows that the gas cloud effects will be limited inside the PRS boundary.*



**Figure 27. Heat Radiation Contours from Jet Fire (8'' Outlet Pipeline Full Rupture)**

- The previous figure shows that if there is a gas release from 8'' pipeline full rupture and ignited the expected flame length is about 53.2 meters downwind.
- The 9.5 kW/m<sup>2</sup> heat radiation contours extend about 77 meters downwind and 41.2 meters crosswind.
- The 12.5 kW/m<sup>2</sup> heat radiation contours extend about 73 meters downwind and 35.7 meters crosswind.
- The 25 kW/m<sup>2</sup> heat radiation contours extend about 63.5 meters downwind and 24 meters crosswind.
- The 37.5 kW/m<sup>2</sup> heat radiation contours extend about 58 meters downwind and 18 meters crosswind.

*The modeling shows that the heat radiation values of 9.5, 12.5, 25 & 37.5 kW/m<sup>2</sup> will extend outside the PRMS southern fence affecting the security and the control room and neighboring rooms.*



**Figure 28. Worst-Case Explosion Overpressure Waves (8" Outlet Pipeline Full Rupture)**

- The previous figure shows that if there is a gas release from 8" hole size and late ignited this will give an explosion with different values of overpressure waves.
- The 0.020 bar overpressure waves will extend about 47.4 meters radius.
- The 0.137 bar overpressure waves will extend about 12.3 meters radius.
- The 0.206 bar overpressure waves will extend about 9.5 meters radius.

*The modeling shows that the overpressure values 0.137 and 0.206 bar will be limited inside the PRMS boundary.*



**Figure 29. Heat Radiation Contours from Fireball (8'' Outlet Pipeline Full Rupture)**

- The previous figure shows that if there is a gas release from 8'' pipeline full rupture and ignited forming fireball this will give a heat radiation with different values and contours and will extend in four dimensions.
- The 4 kW/m<sup>2</sup> heat radiation contours extend about 38.6 meters radius.
- The 12.5 kW/m<sup>2</sup> heat radiation contours extend about 21.8 meters radius.
- The 37.5 kW/m<sup>2</sup> heat radiation contours extend about 11.8 meters radius.

*The modeling shows that the heat radiation values of 4, 12.5 & 37.5 kW/m<sup>2</sup> will be extend outside the PRS boundary from northern fence side.*





### 3.0. Pressure Reduction Station Odorant Tank (Spotleak)

The following table no. (23) Shows 1" hole leak form odorant Modeling:

*Table 23. Dispersion Modeling for Odorant Tank*

Gas Release					
Wind Category	Flammability Limits	Distance (m)	Height (m)	Cloud Width (m)	
3.3 D	UFL	18	0 – 0.2	10	
	LFL	53	0 – 0.7	35	
	50 % LFL	75	0 – 1.1	50	


Jet Fire					
Wind Category	Flame Length (m)	Heat Radiation (kW/m <sup>2</sup> )	Distance Downwind (m)	Distance Crosswind (m)	Lethality Level (%)
3.3 D	16	1.6	26	26	0
		4	16.7	16.7	0
		9.5	11.7	10.9	0
		12.5	10.9	9.3	20% /60 sec.
		25	9	5.6	80.34
		37.5	7.9	3.6	98.74

Unconfined Vapor Cloud Explosion - UVCE (Open Air)				
Wind Category	Pressure Value (bar)	Overpressure Radius (m)	Overpressure Waves Effect / Damage	
3.3 D	0.020	67	0.021 bar	<i>Probability of serious damage beyond this point = 0.05 - 10 % glass broken</i>
	0.137	17.3	0.137 bar	<i>Some severe injuries, death unlikely</i>
	0.206	13.4	0.206 bar	<i>Steel frame buildings distorted / pulled from foundation</i>



**Document Title:** Quantitative Risk Assessment "QRA" Study for El- Kasasin Pressure Reduction & Metering Station

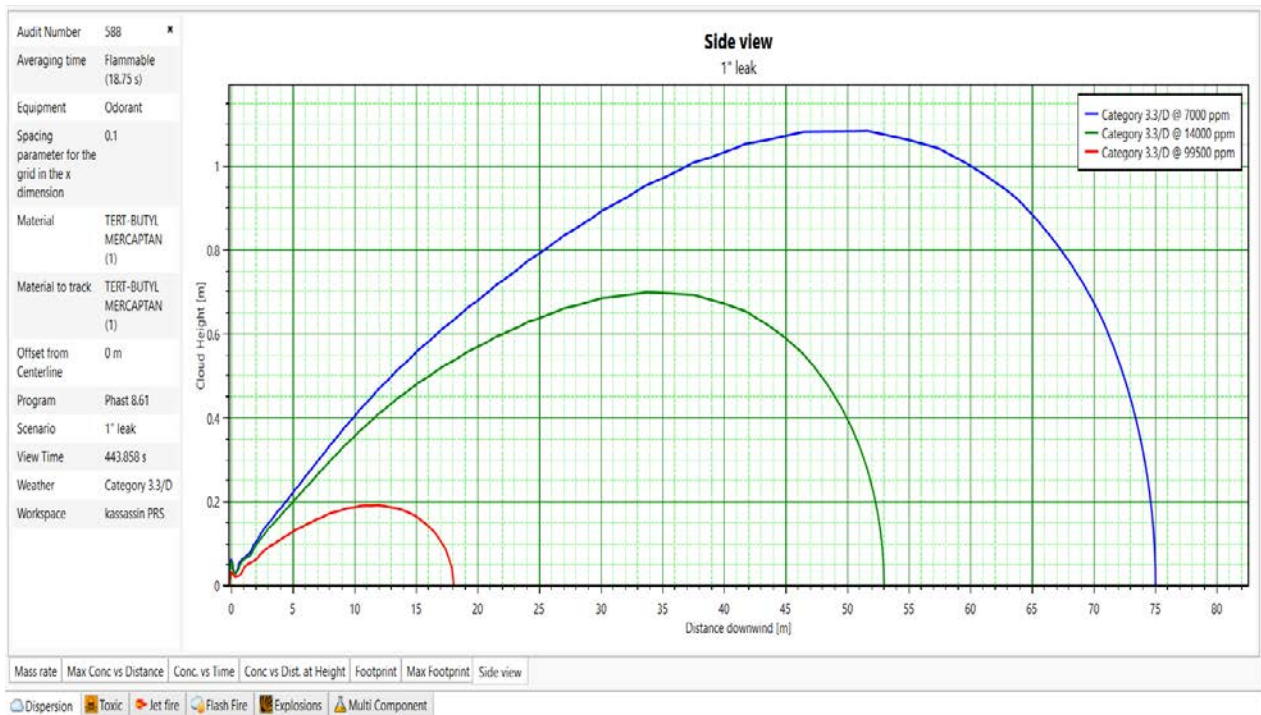

**Figure 30. Vapor Cloud (UFL/LFL) Side View Graph (Odorant leak)**



**Figure 31. Cloud Footprint (UFL/LFL) on site (Odorant leak)**



- The previous figures show that if there is a leak from odorant tank without ignition the flammable vapors will reach a distance about 75 m downwind and from 0 to 1.1 m height (the vapors heavier than air).
- The UFL ( $2.4E+04$  ppm) will reach a distance of about 18 m downwind with a height from 0 to 0.2 m. The cloud large width will be 10 m crosswind.
- The LFL ( $1.4E+04$  ppm) will reach a distance of about 53 m downwind with a height from 0 to 0.7 m. The cloud large width will be 35 m crosswind.
- The 50 % LFL (7000 ppm) will reach a distance of about 75 m downwind with a height from 0 to 1.1 m. The cloud large width will be 50 m crosswind.

*The modeling shows that the vapor cloud will extend outside the PRS fence from the south side.*

*Consideration should be taken when deal with liquid, vapors and smokes according to the MSDS for the material.*



Document Title: Quantitative Risk Assessment "QRA" Study for El- Kasasin Pressure Reduction & Metering Station

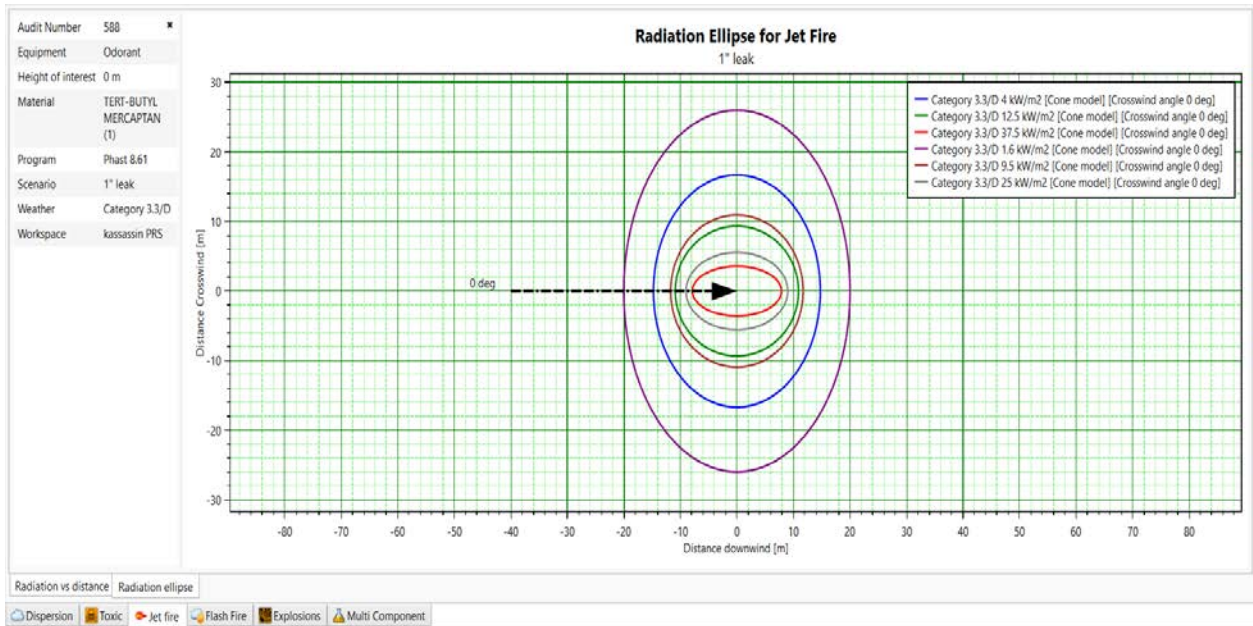


Figure 32. Heat Radiation Contours - Jet Fire Graph (Odorant Leak)

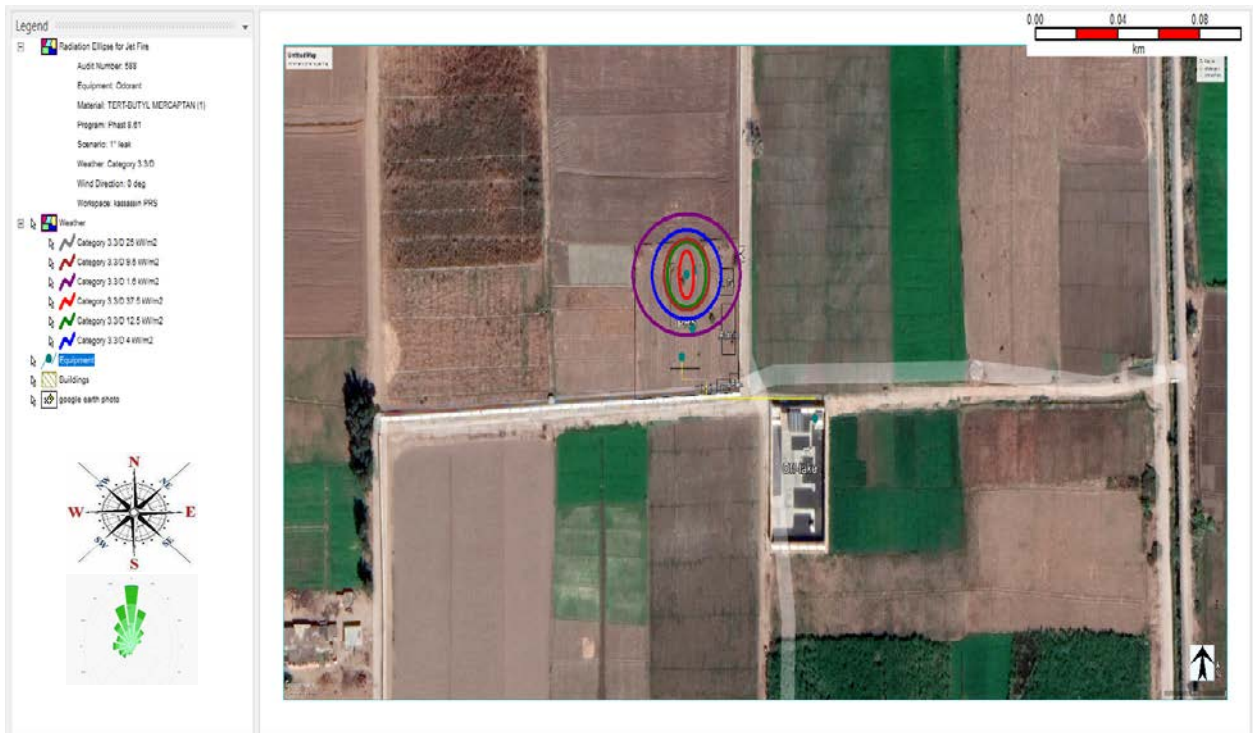


Figure 33. Heat Radiation Contours - Jet Fire on Site (Odorant Leak)




- The previous figures show that if there is a leak from the odorant tank and ignited the expected flame length is about 16 meters downwind.
- The 9.5 kW/m<sup>2</sup> heat radiation contours extend about 11.7 meters downwind and 10.9 meters crosswind.
- The 12.5 kW/m<sup>2</sup> heat radiation contours extend about 10.9 meters downwind and 9.3 meters crosswind.
- The 25 kW/m<sup>2</sup> heat radiation contours extend about 9 meters downwind and 5.6 meters crosswind.
- The 37.5 kW/m<sup>2</sup> heat radiation contours extend about 7.9 meters downwind and 3.6 meters crosswind.

*The modeling shows that all values of heat radiation 9.5, 12.5, 25 & 37.5 kW/m<sup>2</sup> will be limited inside the PRS boundary down and crosswind.*



**Document Title:** Quantitative Risk Assessment "QRA" Study for El- Kasasin Pressure Reduction & Metering Station

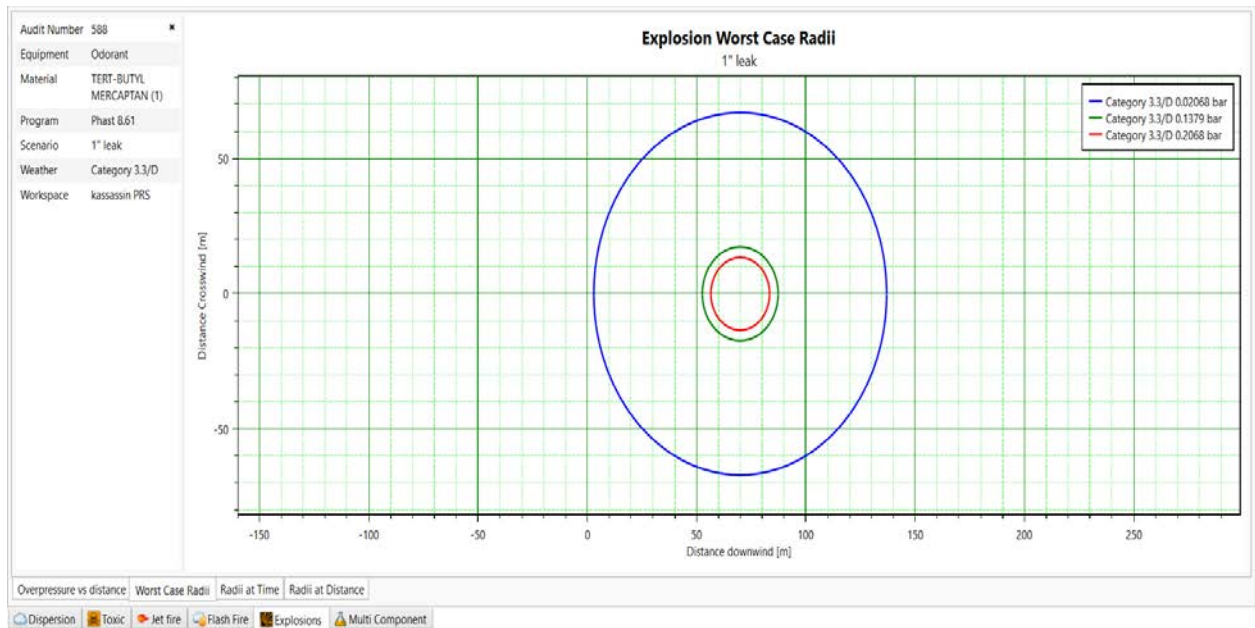

*Figure 34. Worst-Case Explosion Overpressure Waves Graph (Odorant Leak)*



*Figure 35. Explosion Overpressure Waves on Site (Odorant Leak)*



- The previous figures show that if there is a leak from the odorant tank and late ignited this will give an explosion with different values of overpressure waves.
- The 0.020 bar overpressure waves will extend about 67 meters radius.
- The 0.137 bar overpressure waves will extend about 17.3 meters radius.
- The 0.206 bar overpressure waves will extend about 13.4 meters radius.

*The modeling shows that the value of 0.020 bar will cover most parts of the PRS and extend outside the PRS boundary.*

*The values of 0.137 & 0.206 bar will extend outside the PRS boundary.*




#### 4.0. Gas Heater (Water Bath Heating System)

The following table no. (24) Shows 1" hole leak from the heater Modeling:

*Table 24. Dispersion Modeling for Heater Tank*

Gas Release					
Wind Category	Flammability Limits	Distance (m)	Height (m)	Cloud Width (m)	
3.3 D	UFL	2.6	1.1	0.2 @ 2 m	
	LFL	8.2	1.4	0.8 @ 5 m	
	50 % LFL	17.8	1.8	1.6 @ 10 m	
Jet Fire					
Wind Category	Flame Length (m)	Heat Radiation (kW/m <sup>2</sup> )	Distance Downwind (m)	Distance Crosswind (m)	Lethality Level (%)
3.3 D	14.7	1.6	25	18	0
		4	20.9	11.4	0
		9.5	18	7	0
		12.5	17.3	5.9	20% /60 sec.
		25	15	3.2	80.34
		37.5	14.3	1.9	98.74
Unconfined Vapor Cloud Explosion - UVCE (Open Air)					
Wind Category	Pressure Value (bar)	Overpressure Radius (m)	Overpressure Waves Effect / Damage		
3.3 D	0.020	16.2	<b>0.021 bar</b>	<i>Probability of serious damage beyond this point = 0.05 - 10 % glass broken</i>	
	0.137	4.2	<b>0.137 bar</b>	<i>Some severe injuries, death unlikely</i>	
	0.206	3.2	<b>0.206 bar</b>	<i>Steel frame buildings distorted / pulled from foundation</i>	



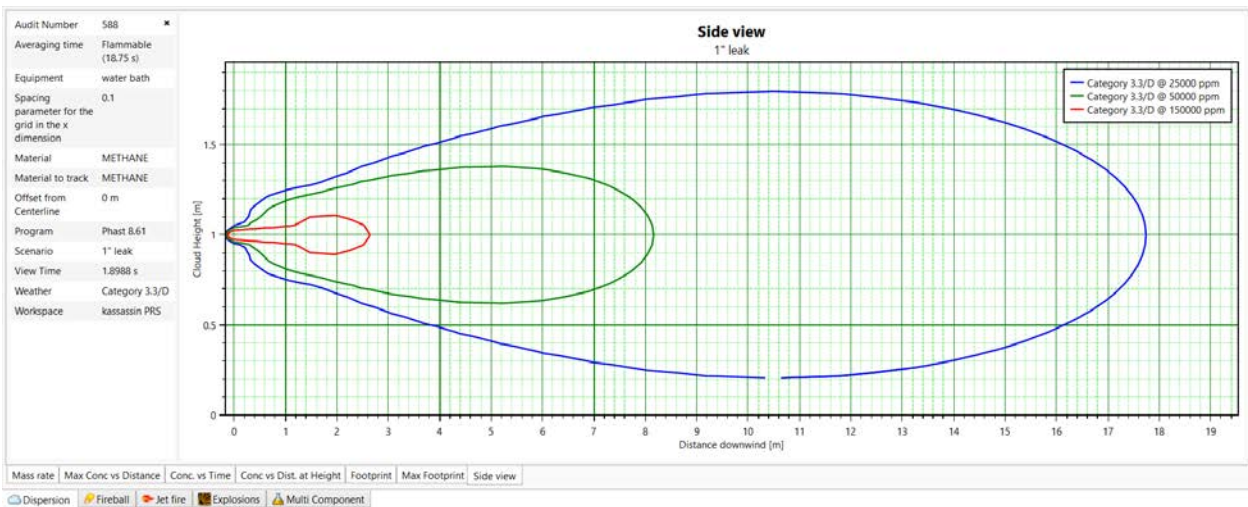


**Figure 36. Vapor Cloud (UFL/LFL) Side View Graph (Gas Heater)**

- The previous figure shows that if there is a gas release from heater pipe without ignition the flammable vapors will reach a distance about 17.8 m downwind and about 1.8 m height.
- The UFL will reach a distance of about 2.6 m downwind with a height of 1.1 m. The cloud large width will be 0.2 m.
- The LFL will reach a distance of about 8.2 m downwind with a height of 1.4 m. The cloud large width will be 0.8 m.
- The 50 % LFL will reach a distance of about 17.8 m downwind with a height of 1.8 m. The cloud large width will be 1.6 m.

*The modeling shows that the vapor cloud will be limited inside the PRS boundary downwind.*



**Document Title:** Quantitative Risk Assessment "QRA" Study for El- Kasasin Pressure Reduction & Metering Station

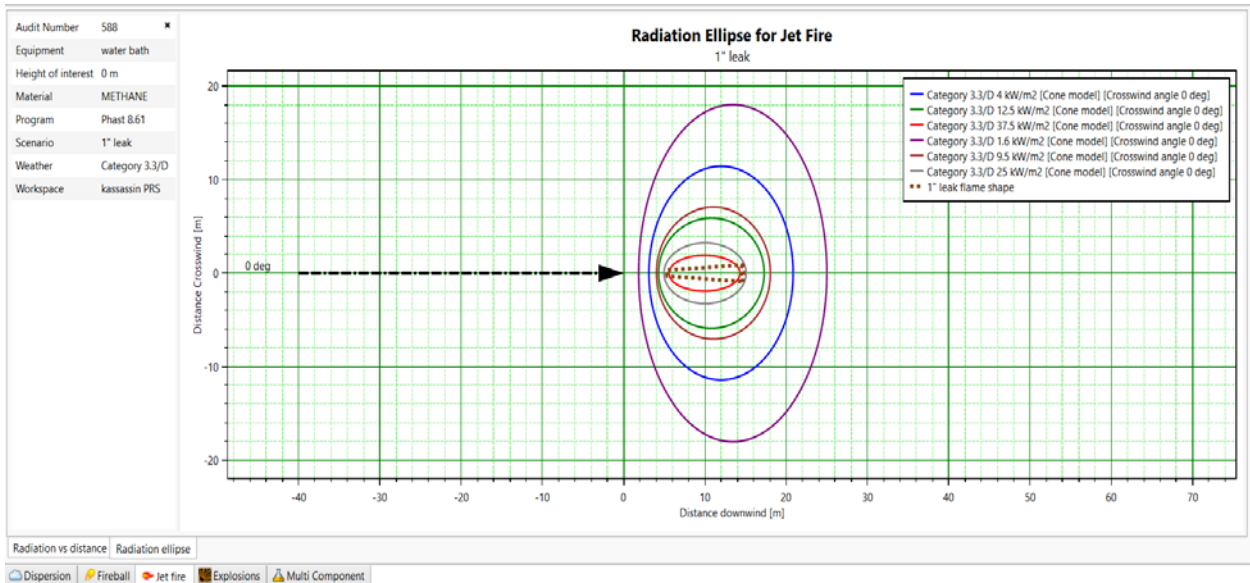

**Figure 37. Heat Radiation Contours - Fire Graph (Gas Heater)**



**Figure 38. Heat Radiation Contours - Fire on Site (Gas Heater)**




- The previous figures show that if there is a leak from the heater and ignited the expected flame length is about 14.7 meters downwind.
- The 9.5 kW/m<sup>2</sup> heat radiation contours extend about 18 meters downwind and 7 meters crosswind.
- The 12.5 kW/m<sup>2</sup> heat radiation contours extend about 17.3 meters downwind and 5.9 meters crosswind.
- The 25 kW/m<sup>2</sup> heat radiation contours extend about 15 meters downwind and 3.2 meters crosswind.
- The 37.5 kW/m<sup>2</sup> heat radiation contours extend about 14.3 meters downwind and 1.9 meters crosswind.

*The modeling shows that the heat radiation value 9.5, 12.5, 25 & 37.5 kW/m<sup>2</sup> effects will be limited inside the PRS boundary affecting some of the PRMS components.*



**Document Title:** Quantitative Risk Assessment "QRA" Study for El- Kasasin Pressure Reduction & Metering Station

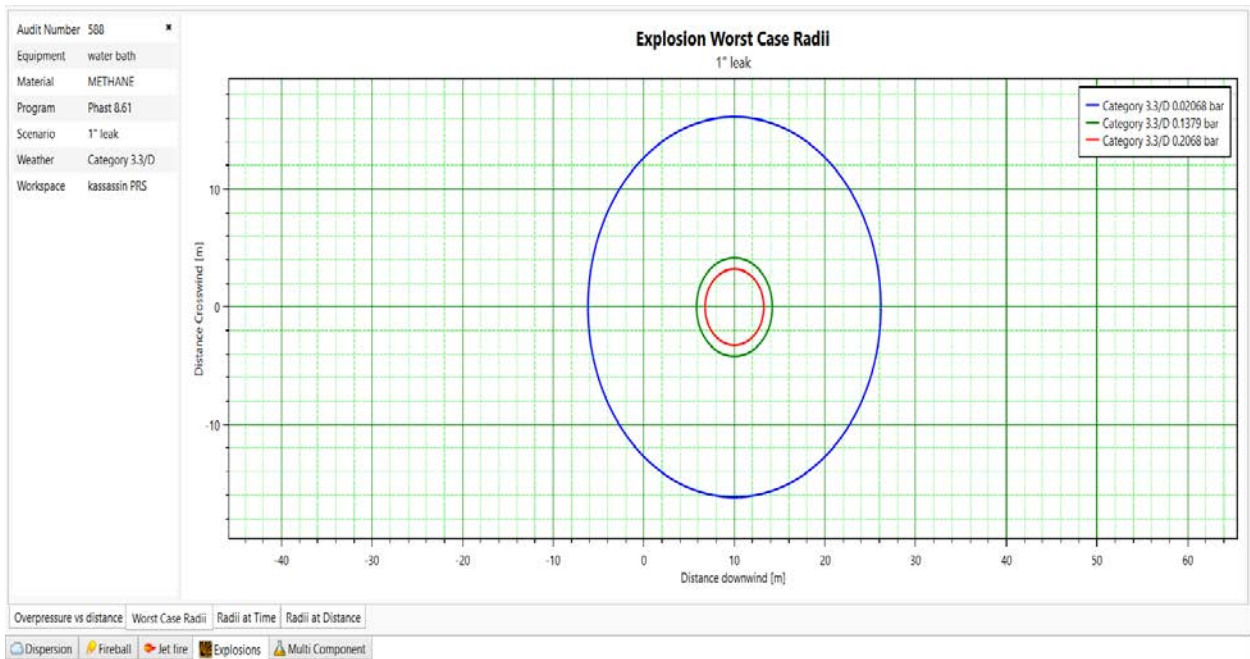

**Figure 39. Explosion Overpressure Waves Graph (Gas Heater)**



**Figure 40. Explosion Overpressure Waves on Site (Gas Heater)**



- The previous figures show that if there is a leak from the heater and late ignited this will give an explosion with different values of overpressure waves.
- The 0.020 bar overpressure waves will extend about 16.2 meters radius.
- The 0.137 bar overpressure waves will extend about 4.2 meters radius.
- The 0.206 bar overpressure waves will extend about 3.2 meters radius.

*The modeling shows that the overpressure values will be limited inside the PRMS boundary.*



## 5.0. Pressure Reduction Station Off-Take Pipeline (6 inch)

### 5/1- Consequence Modeling for 1 inch (Pin Hole) Gas Release

The following table no. (25) Shows that:

*Table 25. Dispersion Modeling for Off-take - 1" / 6" Gas Release*

Gas Release				
Wind Category	Flammability Limits	Distance (m)	Height (m)	Cloud Width (m)
3.3 D	UFL	0.16	1.6	0.27
	LFL	0.38	3.8	0.32
	50 % LFL	0.94	6	1.24

Jet Fire					
Wind Category	Flame Length (m)	Heat Radiation (kW/m <sup>2</sup> )	Distance Downwind (m)	Distance Crosswind (m)	Lethality Level (%)
3.3 D	7.7	1.6	15	14.1	0
		4	8.9	7.4	0
		9.5	2.7	1.7	0
		12.5	Not Reached	Not Reached	20% /60 sec.
		25	Not Reached	Not Reached	80.34
		37.5	Not Reached	Not Reached	98.74

Unconfined Vapor Cloud Explosion - UVCE (Open Air)				
Wind Category	Pressure Value (bar)	Overpressure Radius (m)	Overpressure Waves Effect / Damage	
3.3 D	0.020	N/D	0.021 bar	<i>Probability of serious damage beyond this point = 0.05 - 10 % glass broken</i>
	0.137	N/D	0.137 bar	<i>Some severe injuries, death unlikely</i>
	0.206	N/D	0.206 bar	<i>Steel frame buildings distorted / pulled from foundation</i>



**Figure 41. Gas Cloud Side View (UFL/LFL) (1" hole in 6" off-take Pipeline)**

- The previous figure shows that if there is a gas release from 1" hole size without ignition the flammable vapors will reach a distance about 0.94 m downwind and 6 m height above ground (the tie-in point is under ground with about 5 meters).
- The UFL will reach a distance of about 0.16 m downwind with a height of 1.6 m. The cloud large width will be 0.27 m.
- The LFL will reach a distance of about 0.38 m downwind with a height of 3.8 m. The cloud large width will be 0.32 m.
- The 50 % LFL will reach a distance of about 0.94 m downwind with a height 6 m. The cloud large width will be 1.24 m.

*The modeling shows that the gas cloud effects will be limited inside the Off-take boundary (GASCO's room).*



**Figure 42. Heat Radiation Contours from Jet Fire (1" hole in 6" off-take Pipeline)**

- The previous figure shows that if there is a gas release from 1" hole size and ignited the expected flame length is about 7.7 meters height.
- The  $1.6 \text{ kW/m}^2$  heat radiation contours extend about 15 meters downwind and 14.1 meters crosswind.
- The  $4 \text{ kW/m}^2$  heat radiation contours extend about 8.9 meters downwind and 7.4 meters crosswind.
- The  $9.5 \text{ kW/m}^2$  heat radiation contours extend about 2.7 meters downwind and 1.7 meters crosswind.
- The values  $12.5$ ,  $25$  &  $37.5 \text{ kW/m}^2$  heat radiations not determined.

*The modeling shows that the heat radiation values are limited inside GASCO's room boundary while the  $1.6 \text{ kW/m}^2$  extend outside the Northern fence with no effects outside.*

*The values of  $12.5$ ,  $25$  &  $37.5 \text{ kW/m}^2$  are not determined by the software as they are very small values.*





### 5/2- Consequence Modeling for 3 inch (Half Rup.) Gas Release

The following table no. (26) Shows that:

**Table 26. Dispersion Modeling for Off-take - 3" / 6" Gas Release**


Gas Release					
Wind Category	Flammability Limits	Distance (m)	Height (m)	Cloud Width (m)	
3.3 D	UFL	0.4	6	0.7	
	LFL	1.6	15	2.3	
	50 % LFL	4	23	5.2	

Jet Fire					
Wind Category	Flame Length (m)	Heat Radiation (kW/m <sup>2</sup> )	Distance Downwind (m)	Distance Crosswind (m)	Lethality Level (%)
3.3 D	26.7	1.6	57.4	54.7	0
		4	34.2	30.7	0
		9.5	14.4	12.2	0.72
		12.5	8.6	6	20% /60 sec.
		25	Not Reached	Not Reached	80.34
		37.5	Not Reached	Not Reached	98.74

Unconfined Vapor Cloud Explosion - UVCE (Open Air)				
Wind Category	Pressure Value (bar)	Overpressure Radius (m)	Overpressure Waves Effect / Damage	
3.3 D	0.020	N/D	<b>0.021 bar</b>	<i>Probability of serious damage beyond this point = 0.05 - 10 % glass broken</i>
	0.137	N/D	<b>0.137 bar</b>	<i>Some severe injuries, death unlikely</i>
	0.206	N/D	<b>0.206 bar</b>	<i>Steel frame buildings distorted / pulled from foundation</i>



**Figure 43. Gas Cloud Side View (UFL/LFL) (3" hole in 6" off-take Pipeline)**

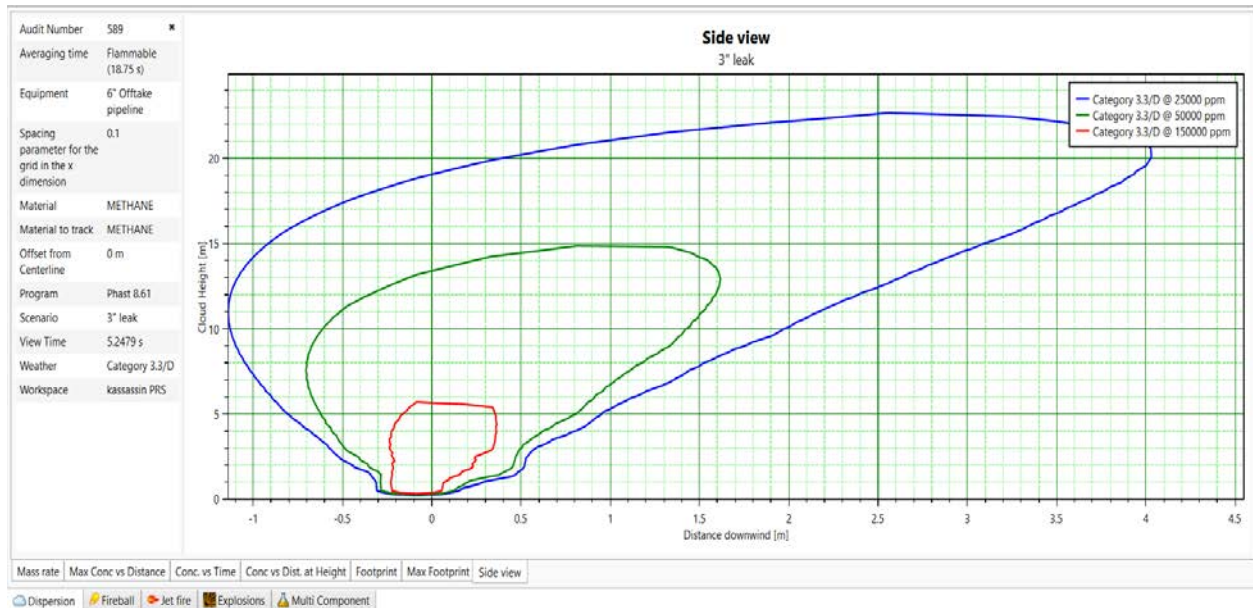- The previous figure shows that if there is a gas release from 3" hole size without ignition the flammable vapors will reach a distance about 4 m downwind and 23 m height above ground (the tie-in point is under ground with about 5 meters).
- The UFL will reach a distance of about 0.4 m downwind with a height of 6 m. The cloud large width will be 0.7 m.
- The LFL will reach a distance of about 1.6 m downwind with a height of 15 m. The cloud large width will be 2.3 m.
- The 50 % LFL will reach a distance of about 4 m downwind with a height 23 m. The cloud large width will be 5.2 m.

*The modeling shows that the gas cloud effects will be limited inside the Off-take boundary (GASCO's room).*



**Figure 44. Heat Radiation Contours from Jet Fire (3" hole in 6" off-take Pipeline)**

- The previous figure shows that if there is a gas release from 3" hole size and ignited the expected flame length is about 26.7 meters height.
- The 1.6 kW/m<sup>2</sup> heat radiation contours extend about 57.4 meters downwind and 54.7 meters crosswind.
- The 4 kW/m<sup>2</sup> heat radiation contours extend about 34.2 meters downwind and 30.7 meters crosswind.
- The 9.5 kW/m<sup>2</sup> heat radiation contours extend about 14.4 meters downwind and 12.2 meters crosswind.
- The 12.5 kW/m<sup>2</sup> heat radiation contours extend about 8.6 meters downwind and 6 meters crosswind.
- The 25 kW/m<sup>2</sup> heat radiation not determined.
- The 37.5 kW/m<sup>2</sup> heat radiation not determined.

*The modeling shows that the heat radiation values of 1.6 & 4 kW/m<sup>2</sup> will extend outside GASCO's room.*

*While the 9.5 & 12.5 kW/m<sup>2</sup> will be limited inside GASCO's room.*

*The values of 25 & 37.5 kW/m<sup>2</sup> are not determined by the software as they are very small values.*



### 5/3- Consequence Modeling for 6 inch (Full Rup.) Gas Release

The following table no. (27) Shows that:

**Table 27. Dispersion Modeling for Off-take - 6" Gas Release**

Gas Release				
Wind Category	Flammability Limits	Distance (m)	Height (m)	Cloud Width (m)
3.3 D	UFL	0.8	12	1.4
	LFL	4	34	5.6
	50 % LFL	9.6	46	12.2

Jet Fire					
Wind Category	Flame Length (m)	Heat Radiation (kW/m <sup>2</sup> )	Distance Downwind (m)	Distance Crosswind (m)	Lethality Level (%)
3.3 D	57	1.6	130	125	0
		4	78	72	0
		9.5	37	33	0
		12.5	25	21.4	20% /60 sec.
		25	Not reached	Not reached	80.34
		37.5	Not reached	Not reached	98.74

Unconfined Vapor Cloud Explosion - UVCE (Open Air)				
Wind Category	Pressure Value (bar)	Overpressure Radius (m)	Overpressure Waves Effect / Damage	
3.3 D	0.020	N/D	<b>0.021 bar</b>	<i>Probability of serious damage beyond this point = 0.05 - 10 % glass broken</i>
	0.137	N/D	<b>0.137 bar</b>	<i>Some severe injuries, death unlikely</i>
	0.206	N/D	<b>0.206 bar</b>	<i>Steel frame buildings distorted / pulled from foundation</i>



**Figure 45. Gas Cloud Side View (UFL/LFL) (6'' off-take Pipeline Full Rupture)**

- The previous figure shows that if there is a gas release from 6'' pipeline full rupture without ignition the flammable vapors will reach a distance more than 9 m downwind and about 46 m height above ground (the tie-in point is under ground with about 5 meters).
- The UFL will reach a distance of about 0.8 m downwind with a height of 12 m. The cloud large width will be 1.4 m.
- The LFL will reach a distance of about 4 m downwind with a height of 34 m. The cloud large width will be 5.6 m.
- The 50 % LFL will reach a distance of about 9.6 m downwind with a height of 46 m. The cloud large width will be 12.2 m.

*The modeling shows that the gas cloud will be limited inside GASCO's room.*



**Figure 46. Heat Radiation Contours from Jet Fire (6" off-take Pipeline Full Rupture)**

- The previous figure shows that if there is a gas release from 6" pipeline full rupture and ignited the expected flame length is about 57 meters height.
- The 1.6 kW/m<sup>2</sup> heat radiation contours extend about 130 meters downwind and 125 meters crosswind.
- The 4 kW/m<sup>2</sup> heat radiation contours extend about 78 meters downwind and 72 meters crosswind.
- The 9.5 kW/m<sup>2</sup> heat radiation contours extend about 37 meters downwind and 33 meters crosswind.
- The 12.5 kW/m<sup>2</sup> heat radiation contours extend about 25 meters downwind and 21.4 meters crosswind.
- The 25 & 37.5 kW/m<sup>2</sup> heat radiations not determined.

*The modeling shows that the heat radiation values of 1.6, 4 & 9.5 kW/m<sup>2</sup> will cover the PRS boundary and extend outside from all directions.*

*While the 12.5 kW/m<sup>2</sup> will cover most parts of the PRS affecting the heater.*

*The values of 25 & 37.5 kW/m<sup>2</sup> are not determined by the software as they are very small values.*



## Individual Risk Evaluation

### *-Risk Calculation*

All identified hazards should be subject to an evaluation for risk potential. This means analyzing the hazard for its probability to actually progress to loss event, as well as likely consequences of this event.

There are four steps to calculate risk, which determined as follows:

- 1- *Identify failure frequency (International Data Base)*
- 2- *Calculating the frequency against control measures at site by using Event Tree Analysis "ETA".*
- 3- *Identify scenarios probability.*
- 4- *Calculated risk to people regarding to the vulnerability of life loses.*

Basically, risk will be calculated as presented in the following equation:

**Risk to people (Individual Risk – IR) =**

**Total Risk ( $\Sigma$  Frequency of fire/explosion) x Occupancy x Vulnerability**

Where:

- Total risk *Is the sum of contributions from all hazards exposed to (fire / explosion).*
- Occupancy *Is the proportion of time exposed to work hazards. (Expected that x man the most exposed person to fire/explosion hazards on site. He works 8 hours shift/day)*
- Vulnerability *Is the probability that exposure to the hazard will result in fatality.*

As shown in tables (5 & 6) – (Page: 30 & 31) the vulnerability of people to heat radiation starting from 12.5 kW/m<sup>2</sup> will lead to fatality accident for 60 sec. Exposure and for explosion over pressure starting from 0.137 bar.



The modeling of the different scenarios shows that the heat radiation and explosion overpressure waves would be a result from release scenarios for all sizes of crack and according to the space size for the PRMS, all of the sequence will be determined for three values release (small, medium and large).

Calculating frequencies needs a very comprehensive calculation which needs a lot of data collecting related to failure of equipment's and accident reporting with detailed investigation to know the failure frequency rates in order to calculate risks from scenarios.

In this study, it is decided to use an International Data Bank for major hazardous incident data.

The following table (28) shows the frequency for each failure that can be raised in pressure reduction station operations:





Table 28. Failure Frequency for Each Scenario

Scenario	Release Size	Failure Cause	Failure Rate
Gas Release from 1"/6" & 1"/8" Pipeline & 1"/4" Gas Heater	<i>Small</i>		
		Internal Corrosion	$1.19E-05$
		External Corrosion	$3.55E-06$
		Maintenance Error	$2.28E-05$
		Corrosive Liquid or Gas	$4.84E-04$
		<b>Total</b>	<b><math>5.22E-04</math></b>
Gas Release from 3"/6" & 4"/8" Pipeline	<i>Medium</i>		
		Internal Corrosion	$2.71E-05$
		External Corrosion	$8.24E-06$
		Erosion	$4.85E-04$
		<b>Total</b>	<b><math>5.20E-04</math></b>
Gas Release from 6" & 8" Pipeline Full Rupture	<i>Large</i>		
		Internal Corrosion	$5.53E-06$
		External Corrosion	$1.61E-06$
		Weld Crack	$4.34E-06$
		Earthquake	$1.33E-07$
		<b>Total</b>	<b><math>1.16E-05</math></b>
Spotleak (Odorant Tank)	<i>Medium</i>	<i>As a package</i>	<b>Failure Rate</b>
			<b><math>1.25E-05</math></b>

Reference: Taylor Associates ApS - 2006

(Hazardous Materials Release and Accident Frequencies for Process Plant - Volume II / Process Unit Release Frequencies - Version 1 Issue 7)



### ***-Event Tree Analysis***

An event tree is a graphical way of showing the possible outcomes of a hazardous event, such as a failure of equipment or human error.

An ETA involves determining the responses of systems and operators to the hazardous event in order to determine all possible alternative outcomes.

The result of the ETA is a series of scenarios arising from different sets of failures or errors.

These scenarios describe the possible accident outcomes in terms of the sequence of events (successes or failures of safety functions) that follow the initial hazardous event.

Event trees shall be used to identify the various escalation paths that can occur in the process. After these escalation paths are identified, the specific combinations of failures that can lead to defined outcomes can then be determined.

This allows identification of additional barriers to reduce the likelihood of such escalation.

The results of an ETA are the event tree models and the safety system successes or failures that lead to each defined outcome.

Accident sequences represents in an event tree represent logical and combinations of events; thus, these sequences can be put into the form of a fault tree model for further qualitative analysis.

These results may be used to identify design and procedural weaknesses, and normally to provide recommendations for reducing the likelihood and/or consequences of the analyzed potential accidents.

Using ETA requires knowledge of potential initiating events (that is, equipment failures or system upsets that can potentially cause an accident), and knowledge of safety system functions or emergency procedures that potentially mitigate the effects of each initiating event.

The equipment failures, system upsets and safety system functions shall be extracted from the likelihood data presented before.



In the case of hydrocarbon release, the event tree first branch is typically representing "Early Ignition". These events are represented in the risk analysis as jet fire events.

This is because sufficient time is unlikely to elapse before ignition for a gas/air mixture to accumulate and cause either a flash fire or a gas hazard.

Subsequent branches for these events represent gas detection, fire detection, inventory isolation (or ESD) or deluge activation.

Delayed ignitions are typically represented by the fifth branch event. This is because, in the time taken for an ignition to occur, sufficient time is more likely to elapse for gas detection and inventory isolation.

The scenario development shall be performed for the following cases:

- Without any control measures
- With control measures

The event tree analysis outcomes can be classified into three main categories as follows:

<b>“Limited Consequence”</b>	<i>Indicates that the release has been detected and the inventory source has been isolated automatically.</i>
<b>“Controlled Consequence”</b>	<i>Indicates that the release has been detected but the source has not been isolated automatically. [Needs human intervention].</i>
<b>“Escalated Consequence”</b>	<i>Indicates that the release has not been detected and consequently the source has not been isolated.</i>

The event trees analysis for each scenario are presented in the below pages:



**Document Title:** Quantitative Risk Assessment "QRA" Study for EI- Kasasin Pressure Reduction & Metering Station

**Table (29) Inlet 6" / Outlet 8" / Off-Take 6" / Waterbath 4" Pipeline Scenarios (Pin Hole Crack – 1" Release) – Event Tree Analysis**

Release of Flammable Materials <sup>(1)</sup>	Immediate Ignition <sup>(2)</sup>	Fire Detection <sup>(3)</sup>	ESD System <sup>(3)</sup>	Fire Protec. <sup>(3)</sup>	Delayed Ignition <sup>(2)</sup>	Outcomes	Frequency
5.22E-04	0.02	0.6	0.978	0.97	0.02		
5.22E-04	Yes 0.02	Yes 0.6	Yes 0.978	Yes 0.97	No 0.02	Controlled Jet fire	1.01E-05
				No 0.03		Not controlled jet fire	3.13E-07
		No 0.4	No 0.022	Yes 0.02	No 0.98	Escalated jet fire	4.18E-06
						Limited release	-----
		No 0.98	No 0.022	Yes 0.02	No 0.98	Large release	1.13E-05
						Escalated jet fire	1.02E-05
<b>TOTAL</b>							<b>1.47E-05</b>

(1) Refer to QRA Study Page 94. (Taylor Associates ApS - 2006)

(2) Ref. Handbook Failure Frequencies 2009.

(3) Ref. OGP – Report No. 434 – A1 / 2010.



**Document Title:** Quantitative Risk Assessment "QRA" Study for EI- Kasasin Pressure Reduction & Metering Station

**Table (30) Inlet 6" / Off-Take 6" Pipeline Scenarios (Half Rupture Release) – Event Tree Analysis**

Release of Flammable Materials <sup>(1)</sup>	Immediate Ignition <sup>(2)</sup>	Fire Detection <sup>(3)</sup>	ESD System <sup>(3)</sup>	Fire Protec. <sup>(3)</sup>	Delayed Ignition <sup>(2)</sup>	Outcomes	Frequency
5.20E-04	0.04	0.6	0.978	0.97	0.04		
	Yes 0.04	Yes 0.6		Yes 0.97		Controlled Jet fire	2.02E-05
		No 0.4		No 0.03		Not controlled jet fire	6.24E-07
						Escalated jet fire	8.32E-06
5.20E-04	No 0.96		Yes 0.978			Limited release	-----
			No 0.022			Large release	1.10E-05
					Yes 0.04	Escalated jet fire	2.00E-05
					No 0.96	Escalated release	4.79E-04
(1) Refer to QRA Study Page 94. (Taylor Associates ApS - 2006)							
(2) Ref. Handbook Failure Frequencies 2009.							
(3) Ref. OGP – Report No. 434 – A1 / 2010.							
<b>TOTAL</b>							<b>2.89E-05</b>



**Document Title:** Quantitative Risk Assessment "QRA" Study for EI- Kasasin Pressure Reduction & Metering Station

**Table (31) Outlet 8" Pipeline Scenario (Half Rupture Release) – Event Tree Analysis**

Release of Flammable Materials <sup>(1)</sup>	Immediate Ignition <sup>(2)</sup>	Fire Detection <sup>(3)</sup>	ESD System <sup>(3)</sup>	Fire Protec. <sup>(3)</sup>	Delayed Ignition <sup>(2)</sup>	Outcomes	Frequency
5.20E-04	0.02	0.6	0.978	0.97	0.02		
	Yes 0.02	Yes 0.6		Yes 0.97		Controlled Jet fire	1.01E-05
		No 0.4		No 0.03		Not controlled jet fire	3.12E-07
						Escalated jet fire	4.16E-06
5.20E-04	No 0.98		Yes 0.978			Limited release	-----
			No 0.022			Large release	1.12E-05
					Yes 0.02	Escalated jet fire	1.02E-05
					No 0.98	Escalated release	4.99E-04
(1) Refer to QRA Study Page 94. (Taylor Associates ApS - 2006)							
(2) Ref. Handbook Failure Frequencies 2009.							
(3) Ref. OGP – Report No. 434 – A1 / 2010.							
<b>TOTAL</b>							<b>1.47E-05</b>



**Document Title:** Quantitative Risk Assessment "QRA" Study for EI- Kasasin Pressure Reduction & Metering Station

*Table (32) Inlet 6" / Off-Take 6" / Outlet 8" Pipeline Scenarios (Full rupture Release) – Event Tree Analysis*

Release of Flammable Materials <sup>(1)</sup>	Immediate Ignition <sup>(2)</sup>	Fire Detection <sup>(3)</sup>	ESD System <sup>(3)</sup>	Fire Protec. <sup>(3)</sup>	Delayed Ignition <sup>(2)</sup>	Outcomes	Frequency
1.16E-05	0.04	0.6	0.978	0.97	0.04		
	Yes 0.04	Yes 0.6	Yes 0.97	Yes 0.97		Controlled Jet fire	4.50E-07
		No 0.4	No 0.03	No 0.03		Not controlled jet fire	1.39E-08
	No 0.96					Escalated jet fire	1.86E-07
1.16E-05		Yes 0.978	Yes 0.978			Limited release	-----
		No 0.022	No 0.022			Large release	2.45E-07
				Yes 0.04		Escalated jet fire	4.45E-07
				No 0.96		Escalated release	1.07E-05
<b>TOTAL</b>							<b>6.45E-07</b>
(1) Refer to QRA Study Page 94. (Taylor Associates ApS - 2006)							
(2) Ref. Handbook Failure Frequencies 2009.							
(3) Ref. OGP – Report No. 434 – A1 / 2010.							



**Document Title:** Quantitative Risk Assessment "QRA" Study for EI- Kasasin Pressure Reduction & Metering Station

*Table (33) Odorant Tank Release – Event Tree Analysis*

Release of Flammable Materials <sup>(1)</sup>	Immediate Ignition <sup>(2)</sup>	Fire Detection <sup>(3)</sup>	ESD System <sup>(3)</sup>	Fire Protec. <sup>(3)</sup>	Delayed Ignition <sup>(2)</sup>	Outcomes	Frequency
1.25E-05	0.065	0.6	0.978	0.97	0.07		
		Yes 0.6		Yes 0.97		Controlled Jet fire	7.88E-07
				No 0.03		Large fire	2.44E-08
	Yes 0.065	No 0.4				Escalated jet fire	3.25E-07
1.25E-05			Yes 0.978			Limited leak	-----
			No 0.022			Large leak	2.57E-07
	No 0.935				Yes 0.07	Escalated jet fire	8.18E-07
					No 0.93	Escalated leak	1.09E-05
(1) Refer to QRA Study Page 94. (Taylor Associates ApS - 2006)							
(2) Ref. Handbook Failure Frequencies 2009.							
(3) Ref. OGP – Report No. 434 – A1 / 2010.							
<b>TOTAL</b>							<b>1.23E-05</b>





**Document Title:** Quantitative Risk Assessment "QRA" Study for El- Kasasin Pressure Reduction & Metering Station

The following table (34) shows the total frequency for each scenario from ETA - Tables (29 to 34):

**Table 34. Total Frequencies for Each Scenario**

Source of Release	Total Frequency (ETA)
Inlet Pipeline Pin Hole	<b>1.47E-05</b>
Off-Take Pipeline Pin Hole	
Outlet Pipeline Pin Hole	
Gas Heater Pin Hole	
Inlet Pipeline Half Rupture	<b>2.89E-05</b>
Off-Take Pipeline Half Rupture	
Outlet Pipeline Half Rupture	<b>1.47E-05</b>
Inlet Pipeline Full Rupture	<b>6.45E-07</b>
Off-Take Pipeline Full Rupture	
Outlet Pipeline Full Rupture	
Odorant Tank 1" hole Leak	<b>1.23E-05</b>

The following table (35) summarize the risk events on workers / public, and according to the site visit of Petrosafe team to the PRMS premises; it will be assumed that:

- One person "as public" works as a farmer (in the agricultural land around the PRS) for one hour / day light.
- Five Persons "as Workers" are available in the PRS for 24 hrs/ day (two operators in control room & one in admin building + Two persons in the security room),

**Table 35. Summarization of Risk on Workers / Public (Occupancy)**

<b>Inlet 6" Pipeline Release Scenarios</b>					
	Event Exposure	Jet / Fireball (12.5 kW/m <sup>2</sup> )		Explosion Overpressure (0.137 bar)	
		Workers	Public	Workers	Public
Pin Hole	1"	None	None	None	None
Half Rupture	3"	None	1 for 1 h (0.04)	None	1 for 1 h (0.04)
Full Rupture	6"	None	1 for 1 h (0.04)	None	1 for 1 h (0.04)
<b>Outlet 8" Pipeline Release Scenarios</b>					
Pin Hole	1"	None	None	None	None
Half Rupture	4"	3 for 24 h (3)	None	None	None
Full Rupture	8"	5 for 24 h (5)	1 for 1 h (0.04)	None	None
<b>Odorant Tank Release Scenario</b>					
Small Leak	1"	None	None	None	1 for 1 h (0.04)
<b>Gas heater (water bath heating system)</b>					
Pin Hole	1"	None	None	None	None



### ***Off-Take 6" Pipeline Release Scenarios***

Pin Hole	1"	None	None	None	None
Half Rupture	3"	None	None	None	None
Full Rupture	6"	None	<i>1 for 1 h (0.04)</i>	None	None

Therefore, the risk calculation will depend on total risk from these scenarios, and as per the equation page (94):

### ***Risk to People (Individual Risk – IR) =***

### ***Total Risk ( $\Sigma$ Frequency of fire/explosion) x Occupancy x Vulnerability***

#### *Where:*

- Total risk - is the sum of contributions from all hazards exposed to (fire / explosion).

*(Frequencies of Scenarios from Table-34)*

- Occupancy - is the proportion of time exposed to work hazards. (Expected that X man the most exposed person to fire/explosion hazards on site. He works 8 hours "shift/day").

*(Ref. to Table-35)*

- Vulnerability - is the probability that exposure to the hazard will result in fatality.

*(Reference: Report No./DNV Reg. No.: 2013-4091/1/17 TLT 29-6 – Rev. 1)*

As per modeling, the IR will be calculated for the workers and the public around the PRMS and Off-Take Point as per the following tables (36 & 37):




Table 36. Individual Risk (IR) Calculation for the Public Near to the PRMS

Source of Event	Frequency 1	Heat Radiation (kW/m <sup>2</sup> ) & Overpressure (Bar)	Vulnerability 2	Time Exposed 3	IR = 1 x 2 x 3
Gas Release from 3"/6" Inlet pipeline	2.89E-05	Jet Fire 12.5	0.7 (Outdoor)	0.04 <sup>1 Pers</sup>	8.10E-07
		Explosion 0.137	0.3 (Outdoor)		3.47E-07
Gas Release from 6" Off-take pipeline	6.45E-07	Jet Fire 12.5	0.7 (Outdoor)	0.04 <sup>1 Pers</sup>	1.81E-08
Gas Release from 6" Inlet pipeline		Jet Fire 12.5	0.7 (Outdoor)	0.04 <sup>1 Pers</sup>	1.81E-08
		Explosion 0.137	0.3 (Outdoor)		7.74E-09
Gas Release from 8" Outlet pipeline		Jet Fire 12.5	0.7 (Outdoor)	0.04 <sup>1 Pers</sup>	1.81E-08
	Fireball 12.5	0.7 (Outdoor)	0.04 <sup>1 Pers</sup>	1.81E-08	
Odorant tank 1" leak	1.23E-05	Explosion 0.137	0.3 (Outdoor)	0.04 <sup>1 Pers</sup>	7.74E-09
<b>TOTAL Risk for the Public (PRMS)</b>					<b>1.24E-06</b>



Table 37. Individual Risk (IR) Calculation for the Workers Near to the PRMS

Source of Event	Frequency <b>1</b>	Heat Radiation (kW/m <sup>2</sup> ) & Overpressure (Bar)	Vulnerability <b>2</b>	Time Exposed <b>3</b>	IR = <b>1 x 2 x 3</b>
Gas Release from 4"/8" Outlet pipeline	<b>1.47E-05</b>	Jet Fire 12.5	<b>0.1</b> (Indoor)	<b>1</b> <sup>3</sup> Pers	<b>4.40E-06</b>
Gas Release from 8" Outlet pipeline	<b>6.45E-07</b>	Jet Fire 12.5	<b>0.1</b> (Indoor)	<b>1</b> <sup>5</sup> Pers	<b>3.22E-07</b>
<b>TOTAL Risk for the Workers</b>					<b>4.72E-06</b>

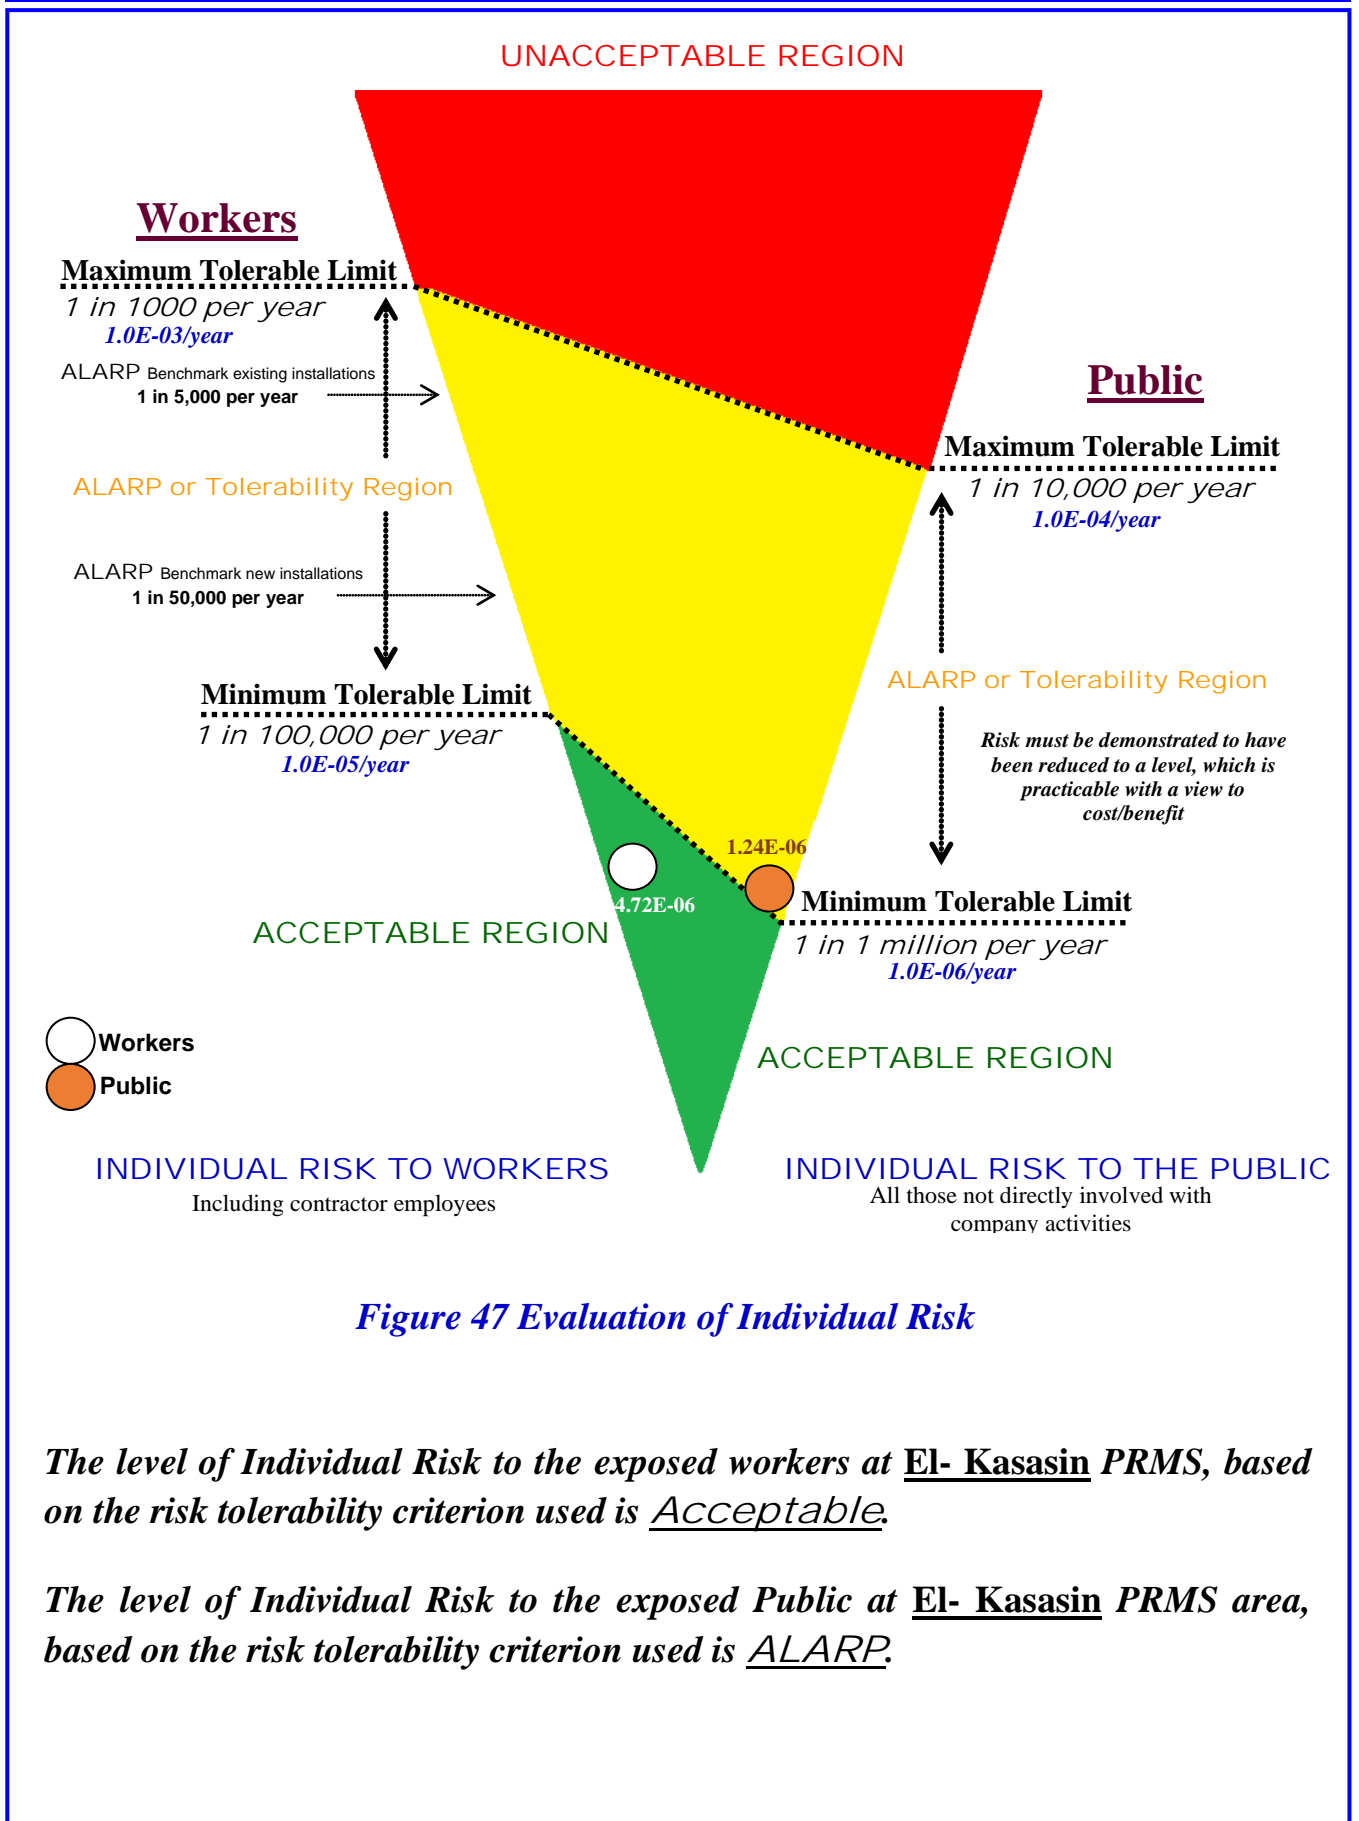



## Summary of Modelling Results and Conclusion

As per results from modeling the consequences of each scenario, the following table summarize the study, and as follows:

Event	Scenario	Effects
<b>Pin hole (1") gas release 6" inlet pipeline</b>		
	Gas cloud UFL LFL 50 % LFL	<i>The modeling shows that the gas cloud effects will be limited inside the PRMS fence.</i>
	Heat radiation / Jet fire 9.5 kW/m <sup>2</sup> 12.5 kW/m <sup>2</sup>	<i>The modeling shows that the heat radiation values will extend outside the PRMS southern fence with no effects outside.</i>
	Explosion 0.020 bar 0.137 bar 0.206 bar	<i>The modeling shows that the value of 0.137 &amp; 0.206 bar will be limited inside the PRMS boundary while 0.020 bar extend outside the PRMS south fence with no effects outside.</i>
<b>Half Rupture (3") gas release 6" inlet pipeline</b>		
	Gas cloud UFL LFL 50 % LFL	<i>The modeling shows that the gas clouds 50 % LFL &amp; LFL will extend to reach the southern fence and extend outside. The UFL will be limited inside the PRS boundary.</i>
	Heat radiation / Jet fire 9.5 kW/m <sup>2</sup> 12.5 kW/m <sup>2</sup>	<i>The modeling shows that the values of 9.5, 12.5, 25 &amp; 37.5 kW/m<sup>2</sup> will extend outside the PRMS southern fence with no effects outside.</i>
	Explosion 0.020 bar 0.137 bar 0.206 bar	<i>The modeling shows that the value of 0.020, 0.137 &amp; 0.206 bar will extend outside the PRMS southern fence.</i>
<b>Full Rupture gas release 6" inlet pipeline</b>		
	Gas cloud UFL LFL 50 % LFL	<i>The modeling shows that the gas cloud effects (LFL &amp; 50 % LFL) will extend outside the PRMS southern fence with no effects outside.</i>
	Heat radiation / Jet	<i>The modeling shows that the heat radiation</i>



Event	Scenario	Effects
	fire 9.5 kW/m <sup>2</sup> 12.5 kW/m <sup>2</sup>	values 9.5, 12.5, 25 & 37.5 kW/m <sup>2</sup> will extend outside the PRMS southern fence, where the 9.5 & 12.5 kW/m <sup>2</sup> reach parts of the neighboring GASCO room.
	Explosion 0.020 bar 0.137 bar 0.206 bar	The modeling shows that the value of 0.137 & 0.206 bar will extend outside the PRMS southern fence.
<b>Pin hole (1") gas release 8" outlet pipeline</b>		
	Gas cloud UFL LFL 50 % LFL	The modeling shows that the gas cloud will be limited inside the PRS boundary.
	Heat radiation / Jet fire 9.5 kW/m <sup>2</sup> 12.5 kW/m <sup>2</sup>	The modeling shows that the heat radiation value 1.6 & 4 kW/m <sup>2</sup> effects will be limited inside the PRS boundary with no effects. The values of 9.5, 12.5, 25 & 37.5 kW/m <sup>2</sup> are not determined by the software due to small leakage.
	Explosion 0.020 bar 0.137 bar 0.206 bar	N/D
<b>Half Rupture (4") gas release 8" outlet pipeline</b>		
	Gas cloud UFL LFL 50 % LFL	The modeling shows that the gas cloud will be limited inside the PRS boundary.
	Heat radiation / Jet fire 9.5 kW/m <sup>2</sup> 12.5 kW/m <sup>2</sup>	The modeling shows that the heat radiation values of 9.5, 12.5, 25 & 37.5 kW/m <sup>2</sup> are limited to the PRMS boundary, where 9.5 & 12.5 kW/m <sup>2</sup> cover parts of the control rooms and neighboring rooms in the building.
	Explosion 0.020 bar 0.137 bar 0.206 bar	The modeling shows that the overpressure values 0.137 & 0.206 bar will be limited inside the PRMS boundary.
<b>Full Rupture gas release 8" outlet pipeline</b>		
	Gas cloud	The modeling shows that the gas cloud



Event	Scenario	Effects
	UFL LFL 50 % LFL	<i>effects will be limited inside the PRS boundary</i>
	Heat radiation / Jet fire 9.5 kW/m <sup>2</sup> 12.5 kW/m <sup>2</sup>	<i>The modeling shows that the heat radiation values of 9.5, 12.5, 25 &amp; 37.5 kW/m<sup>2</sup> will extend outside the PRMS southern fence affecting the security and the control room and neighboring rooms.</i>
	Explosion 0.020 bar 0.137 bar 0.206 bar	<i>The modeling shows that the overpressure values 0.137 and 0.206 bar will be limited inside the PRMS boundary.</i>
	Heat radiation / Fireball 9.5 kW/m <sup>2</sup> 12.5 kW/m <sup>2</sup>	<i>The modeling shows that the heat radiation values of 4, 12.5 &amp; 37.5 kW/m<sup>2</sup> will be extend outside the PRS boundary from northern fence side.</i>
<b>Odorant tank 1" leak</b>		
	Gas cloud UFL LFL 50 % LFL	<i>The modeling shows that the vapor cloud will extend outside the PRS fence from the south side. Consideration should be taken when deal with liquid, vapors and smokes according to the MSDS for the material.</i>
	Heat radiation / Jet fire 9.5 kW/m <sup>2</sup> 12.5 kW/m <sup>2</sup>	<i>The modeling shows that all values of heat radiation 9.5, 12.5, 25 &amp; 37.5 kW/m<sup>2</sup> will be limited inside the PRS boundary down and crosswind.</i>
	Explosion 0.020 bar 0.137 bar 0.206 bar	<i>The modeling shows that the value of 0.020 bar will cover most parts of the PRS and extend outside the PRS boundary . The values of 0.137 &amp; 0.206 bar will extend outside the PRS boundary.</i>
<b>Gas heater (water bath heating system)</b>		
	Gas cloud UFL LFL 50 % LFL	<i>The modeling shows that the vapor cloud will be limited inside the PRS boundary downwind.</i>
	Heat radiation / Jet fire 9.5 kW/m <sup>2</sup> 12.5 kW/m <sup>2</sup>	<i>The modeling shows that the heat radiation value 9.5, 12.5, 25 &amp; 37.5 kW/m<sup>2</sup> effects will be limited inside the PRS boundary affecting some of the PRMS components.</i>
	Explosion 0.020 bar	<i>The modeling shows that the overpressure values will be limited inside the PRMS</i>





Event	Scenario	Effects
	0.137 bar 0.206 bar	boundary.
<b>Pin hole (1") gas release 6" off-take pipeline</b>		
	Gas cloud UFL LFL 50 % LFL	<i>The modeling shows that the gas cloud effects will be limited inside the Off-take boundary (GASCO's room).</i>
	Heat radiation / Jet fire 9.5 kW/m <sup>2</sup> 12.5 kW/m <sup>2</sup>	<i>The modeling shows that the heat radiation values are limited inside GASCO's room boundary while the 1.6 kW/m<sup>2</sup> extend outside the Northern fence with no effects outside. The values of 12.5, 25 &amp; 37.5 kW/m<sup>2</sup> are not determined by the software as they are very small values.</i>
	Explosion 0.020 bar 0.137 bar 0.206 bar	N/D
<b>Half Rupture (3") gas release 6" off-take pipeline</b>		
	Gas cloud UFL LFL 50 % LFL	<i>The modeling shows that the gas cloud effects will be limited inside the Off-take boundary (GASCO's room).</i>
	Heat radiation / Jet fire 9.5 kW/m <sup>2</sup> 12.5 kW/m <sup>2</sup>	<i>The modeling shows that the heat radiation values of 1.6 &amp; 4 kW/m<sup>2</sup> will extend outside GASCO's room. While the 9.5 &amp; 12.5 kW/m<sup>2</sup> will be limited inside GASCO's room. The values of 25 &amp; 37.5 kW/m<sup>2</sup> are not determined by the software as they are very small values.</i>
	Explosion 0.020 bar 0.137 bar 0.206 bar	N/D
<b>Full Rupture gas release 6" off-take pipeline</b>		
	Gas cloud UFL LFL 50 % LFL	<i>The modeling shows that the gas cloud will be limited inside the PRS boundary.</i>
	Heat radiation / Jet fire	<i>The modeling shows that the heat radiation values of 1.6, 4 &amp; 9.5 kW/m<sup>2</sup> will cover the</i>



Event	Scenario	Effects
	9.5 kW/m <sup>2</sup> 12.5 kW/m <sup>2</sup>	<i>PRS boundary and extend outside from all directions. While the 12.5 kW/m<sup>2</sup> will cover most parts of the PRS affecting the heater. The values of 25 &amp; 37.5 kW/m<sup>2</sup> are not determined by the software as they are very small values.</i>
	Explosion 0.020 bar 0.137 bar 0.206 bar	<i>N/D</i>

The previous table shows that there are some of potential hazards with heat radiation (12.5 kW/m<sup>2</sup>) resulting from jet fire and explosion overpressure waves (0.137 bar) from late explosion events.

These risks (Jet fire, Fireball & overpressure waves) will affect the workers at the PRMS, and reach the surrounding near to the station .

The major hazards that extend over site boundary and/or effect on workers / public were used for Risk Calculations.



## Recommendations

Regarding to the modeling scenarios and risk calculations to workers / public which find that the risk to Workers is in the **Acceptable region**. While the risk to Public was found to be in the **ALARP region**, therefore there are some points need to be considered to maintain the risk tolerability in its region and this will be described in the following recommendations:

Recommendation	Timeline Phases	Town Gas Remarks
<ul style="list-style-type: none"> <li>• Ensure that</li> </ul>		
<ul style="list-style-type: none"> <li>- All PRMS facilities specifications referred to the national and international codes and standards.</li> </ul>	Design	
<ul style="list-style-type: none"> <li>- Inspection and maintenance plans and programs are according to the manufacturers guidelines to keep all facility parts in a good condition.</li> </ul>	Operation	
<ul style="list-style-type: none"> <li>- All operations are according to standard operating procedures for the PRMS operations and training programs in-place for operators.</li> </ul>	Operation	
<ul style="list-style-type: none"> <li>- Emergency shutdown detailed procedure including emergency gas isolation points at the PRMS and Off-Take Point in place.</li> </ul>	Operation	
<ul style="list-style-type: none"> <li>- Surface drainage system is suitable for containment any odorant spillage.</li> </ul>	Design	
<ul style="list-style-type: none"> <li>• Considering that all electrical equipment, facilities and connections are according to the hazardous area classification for natural gas facilities.</li> </ul>	Design	
<ul style="list-style-type: none"> <li>• Updating the emergency response plan for the PRS to include all scenarios in this study and other needs like:</li> </ul>	Operation	
<ul style="list-style-type: none"> <li>- Firefighting brigades, mutual aids, emergency communications and fire detection / protection systems.</li> </ul>	Operation	
<ul style="list-style-type: none"> <li>- Dealing with the external road in case of major fires.</li> </ul>	Operation	

Prepared By:

PETROSAFE



Egyptian Natural Gas Holding Company "EGAS"

Page 115 of 115

Date: May 2022

**Document Title:** Quantitative Risk Assessment "ORA" Study for El- Kasasin Pressure Reduction & Metering Station

<b>Recommendation</b>	<b>Timeline Phases</b>	<b>Town Gas Remarks</b>
- Safe exits in building according to the modeling in this study, and to the PRS from other side beside the designed exit in layout.	Design	
• Provide the site with SCBA "Self-Contained Breathing Apparatus (at least two sets) and arrange training programs for operators.	Operation	
• Cooperation should be done with the concerned parties before planning for housing projects around the PRMS area.	Operation / Design / Construction	

Prepared By:

**PETROSAFE**



Egyptian Natural Gas Holding Company "EGAS"

**Annex "1"**

Date: May 2022

**Document Title:** Quantitative Risk Assessment "QRA" Study for El- Kasasin Pressure Reduction & Metering Station

## Annex "1"

# Results of Consequence Modelling Low Wind Scenario



## Results of Consequence Modelling Low Wind Scenario

### 1.0. Pressure Reduction Station Inlet Pipeline (6 inch)

#### 1/1- Consequence Modeling for 1 inch (Pin Hole) Gas Release

The following table no. (A.1) Shows that:

*Table (A.1) Dispersion Modeling for Inlet - 1" / 6" Gas Release*

Gas Release (Inlet / PRV "High Pressure")				
Wind Category	Flammability Limits	Distance (m)	Height (m)	Cloud Width (m)
2 F	UFL	1.9	1.05	0.1 @ 1.1 m
	LFL	5.6	1.25	0.5 @ 3.5 m
	50 % LFL	10.9	1.5	1 @ 6.5 m

Jet Fire					
Wind Category	Flame Length (m)	Heat Radiation (kW/m <sup>2</sup> )	Distance Downwind (m)	Distance Crosswind (m)	Lethality Level (%)
2 F	10	1.6	15.6	10.2	0
		4	13.2	6.3	0
		9.5	11.4	3.7	0
		12.5	10.7	2.8	20% /60 sec.
		25	9.2	0.9	80.34
		37.5	Not reached	Not reached	98.74

Unconfined Vapor Cloud Explosion - UVCE (Open Air)				
Wind Category	Pressure Value (bar)	Explosion Overpressure Radius (m)	Overpressure Waves Effect / Damage	
2 F	0.020	11.5	0.021 bar	Probability of serious damage beyond this point = 0.05 - 10 % glass broken
	0.137	3	0.137 bar	Some severe injuries, death unlikely
	0.206	2.3	0.206 bar	Steel frame buildings distorted / pulled from foundation

### *1/2- Consequence Modeling for 3 inch (Half Rup.) Gas Release*

The following table no. (A.2) Shows that:

*Table (A.2) Dispersion Modeling for Inlet - 3" / 6" Gas Release*

Gas Release (Inlet / PRV "High Pressure")				
Wind Category	Flammability Limits	Distance (m)	Height (m)	Cloud Width (m)
2 F	UFL	7	1.3	0.6 @ 4 m
	LFL	27	0 - 2.3	2.3 @ 15 m
	50 % LFL	49	0 – 3.7	3.7 @ 30 m

Jet Fire					
Wind Category	Flame Length (m)	Heat Radiation (kW/m <sup>2</sup> )	Distance Downwind (m)	Distance Crosswind (m)	Lethality Level (%)
2 F	34.3	1.6	74.7	60.1	0
		4	58.5	38.3	0
		9.5	49	25.4	0
		12.5	46	21.5	20% /60 sec.
		25	40.3	14.2	80.34
		37.5	36.7	10.5	98.74

Unconfined Vapor Cloud Explosion - UVCE (Open Air)				
Wind Category	Pressure Value (bar)	Explosion Overpressure Radius (m)	Overpressure Waves Effect / Damage	
2 F	0.020	52.8	<b>0.021 bar</b>	<i>Probability of serious damage beyond this point = 0.05 - 10 % glass broken</i>
	0.137	10.1	<b>0.137 bar</b>	<i>Some severe injuries, death unlikely</i>
	0.206	7.8	<b>0.206 bar</b>	<i>Steel frame buildings distorted / pulled from foundation</i>

### *1/3- Consequence Modeling for 6 inch (Full Rupture) Gas Release*

The following table no. (A.3) Shows that:

*Table (A.3) Dispersion Modeling for Inlet - 6" Gas Release*

Gas Release				
Wind Category	Flammability Limits	Distance (m)	Height (m)	Cloud Width (m)
2 F	UFL	18	1.9	1.8 @ 10 m
	LFL	45	0 – 3.8	3.8 @ 25 m
	50 % LFL	58	0 – 5.4	5.4 @ 35 m

Jet Fire					
Wind Category	Flame Length (m)	Heat Radiation (kW/m <sup>2</sup> )	Distance Downwind (m)	Distance Crosswind (m)	Lethality Level (%)
2 F	71.9	1.6	178.1	143	0
		4	136.4	92.3	0
		9.5	111.1	62	0
		12.5	103	52.4	20 %/60 sec.
		25	88.2	35.8	80.34
		37.5	79.5	27.5	98.74

Unconfined Vapor Cloud Explosion - UVCE (Open Air)				
Wind Category	Pressure Value (bar)	Explosion Overpressure Radius (m)	Overpressure Waves Effect / Damage	
2 F	0.020	125.4	<b>0.021 bar</b>	<i>Probability of serious damage beyond this point = 0.05 - 10 % glass broken</i>
	0.137	32.5	<b>0.137 bar</b>	<i>Some severe injuries, death unlikely</i>
	0.206	25.1	<b>0.206 bar</b>	<i>Steel frame buildings distorted / pulled from foundation</i>