

**PETROSAFE**

Petroleum Safety & Environmental Services Co.  
An Egyptian Oil Sector Company



**بترو سيف**

شركة الخدمات البترولية للسلامة والبيئة  
إحدى شركات قطاع البترول



The Egyptian Natural Gas Holding Company "EGAS"

# **Quantitative Risk Assessment**

## **"QRA" Study**

### **For**

# **El-Baragil**

## **Pressure Reduction Station**



Prepared By  
Petroleum Safety and Environmental Services Company  
PETROSAFE

June 2022

**Document Title: Quantitative Risk Assessment "QRA" Study for El-Baragil Pressure Reduction & Metering Station**

|  |  |
|--|--|
| <b>Title</b>   | Quantitative Risk Assessment Study for El-Baragil Pressure Reduction Station – Giza Governorate  |
| <b>Customer</b>  | Egyptian Natural Gas Holding Company "EGAS"  |
| <b>Customer Reference</b>  | EGAS/QRA/23/2019-MG/MS   |
| <b>Confidentiality, Copyright and Reproduction</b>   | This document has been prepared by PETROSAFE in connection with a contract to supply services and is submitted only on the basis of strict confidentiality. The contents must not be disclosed to third parties other than in accordance with the terms of the contract. |
| <b>Report Number</b>   | EGAS.HSE.QRA.Study.02/El-Baragil-Town.Gas/PRMS.No.06/2022/QRA/MG/MS/MY-DNV-PHAST.8.61 -PETROSAFE-Draft.Report-Rev.00   |
| <b>Report Status</b>   | Revision 00  |
| <p>PETROSAFE<br/>         6w/4 Hassan Nassar St. - Takseem El-Laselky - New Maadi, Cairo, Egypt<br/>         Telephone: +(202) 2517 6935 / 2517 6936 / 2517 6937<br/>         Facsimile: +(202) 2517 6938 / 2517 6958<br/>         e-mail: <a href="mailto:mohamed.ghazaly@petrosafe.com.eg">mohamed.ghazaly@petrosafe.com.eg</a><br/> <a href="mailto:mohamed.samy@petrosafe.com.eg">mohamed.samy@petrosafe.com.eg</a> / <a href="mailto:mohamed.yousry@petrosafe.com.eg">mohamed.yousry@petrosafe.com.eg</a></p> |  |

|                     | Name   | Signature | Date      |
|---------------------|--|-----------|-----------|
| <b>Team Work</b>    | Eng. Mohamad Yousry<br>Loss Prevention Specialist  | PETROSAFE | June 2022 |
|                     | Chem. Mohamad Samy<br>Safety Consultations Assist. GM  | PETROSAFE | June 2022 |
|                     | Geo. Mohamad Al-Ghazaly<br>Saf. & Env. Consultations GM  | PETROSAFE | June 2022 |
| <b>Reviewed by</b>  | Dr. Emad Kilany<br>Safety Gen. Mgr.  | EGAS      | June 2022 |
|                     | Eng. Tarek Mansour<br>World Bank Project Gen. Mgr.   | EGAS      | June 2022 |
| <b>Approved by</b>  | Dr. Ashraf Ramadan<br>Assistant Chairman for Environment and Supervising on Health & Safety Department | EGAS      | June 2022 |
|                     | Eng. Ahmed Mahmoud<br>Vice Chairman for Planning & Gas Projects & Business Development                 | EGAS      | June 2022 |
| <b>Distribution</b> |  |           |           |

- Client: EGAS
- File: EGAS / PETROSAFE
- Library: EGAS / PETROSAFE



## CONTENTS

|  |           |
|--|-----------|
| <b>Executive Summary</b>   | <b>6</b>  |
| <b>Introduction</b>  | <b>15</b> |
| <b>Technical Definitions</b>                                     | <b>16</b> |
| <b>Objectives</b>  | <b>21</b> |
| <b>Quantitative Risk Assessment Study Scope</b>                  | <b>22</b> |
| <b>Quantitative Risk Assessment "QRA" Studies</b>                | <b>23</b> |
| Method of Assessment   | 23        |
| 1.General Method Used  | 23        |
| 2.Risk Assessment  | 23        |
| Modelling the Consequences                                       | 25        |
| Criterion for Risk Tolerability                                  | 26        |
| Personnel Vulnerability and Structural Damage                    | 29        |
| Quantification of the Frequency of Occurrence                    | 32        |
| Identification of Scenarios Leading to Selected Failures         | 32        |
| Relevant Weather Data for the Study                              | 33        |
| -Weather Data  | 33        |
| -Stability Categories  | 37        |
| <b>El-Baragil PRMS Description</b>                               | <b>38</b> |
| Background   | 38        |
| The PRMS Location Coordinates (Town Gas Data)                    | 38        |
| PRMS Brief Description and Component list (Town Gas Data)        | 38        |
| El-Baragil PRMS Units (Town Gas Data)                            | 39        |
| Process Condition Data (Town Gas Company Data)                   | 44        |
| Gas Odorant Specifications                                       | 45        |
| Fire Fighting and Protection Systems and Facilities              | 46        |
| Emergency Response Plan "ERP"                                    | 46        |
| <b>Analytical Results of Consequence Modeling</b>                | <b>47</b> |
| 1.0.Pressure Reduction Station Inlet Pipeline (10 inch)          | 47        |
| 1/1- Consequence Modeling for 1 inch (Pin Hole) Gas Release      | 47        |
| 1/2- Consequence Modeling for 4 inch (Half Rup.) Gas Release     | 51        |
| 1/3- Consequence Modeling for 10 inch (Full Rupture) Gas Release | 55        |
| 2.0.Pressure Reduction Station Outlet Pipeline (10 inch)         | 59        |
| 2/1- Consequence Modeling for 1 inch (Pin Hole) Gas Release      | 59        |
| 2/2- Consequence Modeling for 4 inch (Half Rup.) Gas Release     | 62        |
| 2/3- Consequence Modeling for 10 inch (Full Rup.) Gas Release    | 66        |

|   |            |
|---|------------|
| 3.0.Pressure Reduction Station Odorant Tank (Spotleak)        | 71         |
| 4.0. Gas Heater (Water Bath Heating System)                   | 75         |
| 5.0.Pressure Reduction Station Off-Take Pipeline (10 inch)    | 79         |
| 5/1- Consequence Modeling for 1 inch (Pin Hole) Gas Release   | 79         |
| 5/2- Consequence Modeling for 4 inch (Half Rup.) Gas Release  | 82         |
| 5/3- Consequence Modeling for 10 inch (Full Rup.) Gas Release | 85         |
| <b>Individual Risk Evaluation</b>                             | <b>89</b>  |
| -Risk Calculation   | 89         |
| -Event Tree Analysis  | 92         |
| <b>Summary of Modelling Results and Conclusion</b>            | <b>105</b> |
| <b>Recommendations</b>  | <b>110</b> |

## FIGURES

|   |    |
|---|----|
| <i>Figure 1 Risk Assessment Framework</i>   | 24 |
| <i>Figure 2. Criteria for Individual Risk Tolerability</i>  | 26 |
| <i>Figure 3. Proposed Individual Risk Criteria</i>  | 27 |
| <i>Figure 4. Monthly Variations of the Maximum Temperature for El-Baragil Area</i>                  | 34 |
| <i>Figure 5. Monthly Variation of the Wind Speed for El-Baragil Area</i>                            | 35 |
| <i>Figure 6. Wind Rose for El-Baragil Area</i>  | 35 |
| <i>Figure 7. Monthly Variations of the Sunny, Cloudy and Precipitation days for El-Baragil Area</i> | 36 |
| <i>Figure 8. El-Baragil PRMS Layout</i>   | 41 |
| <i>Figure 9. El-Baragil PRMS Piping and Instrumentation Diagram "P&amp;ID"</i>                      | 42 |
| <i>Figure 10. El-Baragil PRMS and Surroundings Plotted on Google Earth Photo</i>                    | 43 |
| <i>Figure 11. Gas Cloud Side View (UFL/LFL) (1" hole in 10" Inlet Pipeline)</i>                     | 48 |
| <i>Figure 12. Heat Radiation Contours from Jet Fire (1" hole in 10" Inlet Pipeline)</i>             | 49 |
| <i>Figure 13. Gas Cloud Side View (UFL/LFL) (4" hole in 10" Inlet Pipeline)</i>                     | 52 |
| <i>Figure 14. Heat Radiation Contours from Jet Fire (4" hole in 10" Inlet Pipeline)</i>             | 53 |
| <i>Figure 15. Worst-Case Explosion Overpressure Waves (4" hole in 10" Inlet Pipeline)</i>           | 54 |
| <i>Figure 16. Gas Cloud Side View (UFL/LFL) (10" Inlet Pipeline Full Rupture)</i>                   | 56 |
| <i>Figure 17. Heat Radiation Contours from Jet Fire (10" Inlet Pipeline Full Rupture)</i>           | 57 |
| <i>Figure 18. Worst-Case Explosion Overpressure Waves (10" Inlet Pipeline Full Rupture)</i>         | 58 |
| <i>Figure 19. Gas Cloud Side View (UFL/LFL) (1" hole in 10" Outlet Pipeline)</i>                    | 60 |
| <i>Figure 20. Heat Radiation Contours from Jet Fire (1" hole in 10" Outlet Pipeline)</i>            | 61 |
| <i>Figure 21. Gas Cloud Side View (UFL/LFL) (4" hole in 10" Outlet Pipeline)</i>                    | 63 |
| <i>Figure 22. Heat Radiation Contours from Jet Fire (4" hole in 10" Outlet Pipeline)</i>            | 64 |



|  |     |
|--|-----|
| <i>Figure 23. Worst-Case Explosion Overpressure Waves (4" hole in 10" Outlet Pipeline)</i>     | 65  |
| <i>Figure 24. Gas Cloud Side View (UFL/LFL) (10" Outlet Pipeline Full Rupture)</i>             | 67  |
| <i>Figure 25. Heat Radiation Contours from Jet Fire (10" Outlet Pipeline Full Rupture)</i>     | 68  |
| <i>Figure 26. Worst-Case Explosion Overpressure Waves (10" Outlet Pipeline Full Rupture)</i>   | 69  |
| <i>Figure 27. Heat Radiation Contours from Fireball (10" Outlet Pipeline Full Rupture)</i>     | 70  |
| <i>Figure 28. Vapor Cloud (UFL/LFL) Side View Graph (Odorant leak)</i>                         | 72  |
| <i>Figure 29. Cloud Footprint (UFL/LFL) on site (Odorant leak)</i>                             | 72  |
| <i>Figure 30. Heat Radiation Contours - Jet Fire Graph (Odorant Leak)</i>                      | 73  |
| <i>Figure 31. Heat Radiation Contours - Jet Fire on Site (Odorant Leak)</i>                    | 73  |
| <i>Figure 32. Worst-Case Explosion Overpressure Waves Graph (Odorant Leak)</i>                 | 74  |
| <i>Figure 33. Worst-Case Explosion Overpressure Waves on Site (Odorant Leak)</i>               | 74  |
| <i>Figure 34. Vapor Cloud (UFL/LFL) Side View Graph (Gas Heater)</i>                           | 76  |
| <i>Figure 35. Cloud Footprint (UFL/LFL) on site (Gas Heater)</i>                               | 76  |
| <i>Figure 36. Heat Radiation Contours - Fire Graph (Gas Heater)</i>                            | 77  |
| <i>Figure 37. Heat Radiation Contours - Fire on Site (Gas Heater)</i>                          | 77  |
| <i>Figure 38. Worst-Case Explosion Overpressure Waves Graph (Gas Heater)</i>                   | 78  |
| <i>Figure 39. Worst-Case Explosion Overpressure Waves on Site (Gas Heater)</i>                 | 78  |
| <i>Figure 40. Gas Cloud Side View (UFL/LFL) (1" hole in 10" off-take Pipeline)</i>             | 80  |
| <i>Figure 41. Heat Radiation Contours from Jet Fire (1" hole in 10" off-take Pipeline)</i>     | 81  |
| <i>Figure 42. Gas Cloud Side View (UFL/LFL) (4" hole in 10" off-take Pipeline)</i>             | 83  |
| <i>Figure 43. Heat Radiation Contours from Jet Fire (4" hole in 10" off-take Pipeline)</i>     | 84  |
| <i>Figure 44. Gas Cloud Side View (UFL/LFL) (10" off-take Pipeline Full Rupture)</i>           | 86  |
| <i>Figure 45. Heat Radiation Contours from Jet Fire (10" off-take Pipeline Full Rupture)</i>   | 87  |
| <i>Figure 46. Worst-Case Explosion Overpressure Waves (10" off-take Pipeline Full Rupture)</i> | 88  |
| <i>Figure (47) Evaluation of Individual Risk</i>   | 104 |

## TABLES

|  |    |
|--|----|
| <i>Table 1. Description of Modeling of the Different Scenario</i>                        | 25 |
| <i>Table 2. Proposed Individual Risk (IR) Criteria (per person/year)</i>                 | 27 |
| <i>Table 3. Criteria for Personnel Vulnerability and Structural Damage</i>               | 29 |
| <i>Table 4. Heat Radiation Effects on Structures (International Data Bank)*</i>          | 30 |
| <i>Table 5. Heat Radiation Effects on People</i>   | 30 |
| <i>Table 6. Effects of Overpressure</i>  | 31 |
| <i>Table 7. Annual Average Temperature, Relative Humidity and Wind Speed / Direction</i> | 33 |
| <i>Table 8. Mean of Monthly Air Temperature (°C) - El-Baragil Area</i>                   | 34 |
| <i>Table 9. Mean of Monthly Wind Speed (m/sec) - El-Baragil Area</i>                     | 34 |



|  |     |
|--|-----|
| <i>Table 10. Mean of Monthly Average Relative Humidity - El-Baragil Area</i>   | 34  |
| <i>Table 11. Pasqual Stability Categories</i>  | 37  |
| <i>Table 12. Relationship between Wind Speed and Stability</i>   | 37  |
| <i>Table 13. Sets of Weather Conditions Selected for Current Study</i>   | 37  |
| <i>Table 14. Location Coordinates of PRMS</i>  | 38  |
| <i>Table 15. El-Baragil PRMS Units</i>   | 39  |
| <i>Table 16. Process Conditions / Gas Components and Specifications</i>  | 44  |
| <i>Table 17. Dispersion Modeling for Inlet - 1" / 10" Gas Release</i>  | 47  |
| <i>Table 18. Dispersion Modeling for Inlet - 4" / 10" Gas Release</i>  | 51  |
| <i>Table 19. Dispersion Modeling for Inlet - 10" Gas Release</i>   | 55  |
| <i>Table 20. Dispersion Modeling for Outlet - 1" / 10" Gas Release</i>   | 59  |
| <i>Table 21. Dispersion Modeling for Outlet - 4" / 10" Gas Release</i>   | 62  |
| <i>Table 22. Dispersion Modeling for Outlet - 10" Gas Release</i>  | 66  |
| <i>Table 23. Dispersion Modeling for Odorant Tank</i>  | 71  |
| <i>Table 24. Dispersion Modeling for Heater Tank</i>   | 75  |
| <i>Table 25. Dispersion Modeling for Off-take - 1" / 10" Gas Release</i>   | 79  |
| <i>Table 26. Dispersion Modeling for Off-take - 4" / 10" Gas Release</i>   | 82  |
| <i>Table 27. Dispersion Modeling for Off-take - 10" Gas Release</i>  | 85  |
| <i>Table 28. Failure Frequency for Each Scenario</i>   | 91  |
| <i>Table 29. Inlet 10" / Outlet 10" / Off-Take 10" / Waterbath 3" Pipeline Scenarios (Pin Hole Crack – 1" Release) – ETA</i> | 94  |
| <i>Table 30. Inlet 10" / Off-Take 10" Pipeline Scenarios (Half Rupture 4" Release) – ETA</i>                                 | 95  |
| <i>Table 31. Outlet 10" Pipeline Scenario (Half Rupture 4" Release) – ETA</i>  | 96  |
| <i>Table 32. Inlet 10" / Off-Take 10" Pipeline Scenarios (Full rupture Release) – ETA</i>                                    | 97  |
| <i>Table 33. Outlet 10" Pipeline Scenarios (Full rupture Release) – ETA</i>  | 98  |
| <i>Table 34. Odorant Tank Release – ETA</i>  | 99  |
| <i>Table 35. Total Frequencies for Each Scenario</i>   | 100 |
| <i>Table 36. Summarization of Risk on Workers / Public (Occupancy)</i>   | 100 |
| <i>Table 37. Individual Risk (IR) Calculation for the Workers Near to the PRMS</i>   | 102 |
| <i>Table 38. Individual Risk (IR) Calculation for the Public Near to the PRMS</i>  | 103 |



## Executive Summary

This report summarizes the Quantitative Risk Assessment (QRA) analysis study undertaken for the New Natural Gas Pressure Reduction & Metering Station "PRMS" with an Odorant at El-Baragil City – Giza Governorate – Egypt. The PRMS owned by The Egyptian Natural Gas Holding Company "EGAS" and operated by Town Gas Company.

The scope of work includes performing frequency assessment, consequence modeling analysis and Quantitative Risk Assessment of El-Baragil PRMS in order to assess its impacts on the surroundings.

The main objective of the Quantitative Risk Assessment (QRA) study is to demonstrate that Individual Risk "IR" for workers and for public fall within the ALARP region of Risk Acceptance Criteria, and El-Baragil PRMS does not lead to any unacceptable risks to workers or the public.

QRA Study has been undertaken in accordance with the methodology outlined in the UKHSE as well as international regulations and standards.

QRA starts by Hazard Identification (HAZID) study, which determines the Major Accident Hazards (MAH) that requires consequence modelling, frequency analysis, and risk calculation.

In order to perform consequence-modelling analysis of the potential hazardous scenarios resulting from loss of containment, some assumptions and design basis have been proposed. Four scenarios of the release have been proposed:

1. Gas Release from the inlet / outlet pipeline.
2. Gas Release from the off-take point.
3. Leak from odorant tank.
4. Leak from water bath heater (WBH).

The QRA has been performed using DNV PHAST software (Ver. 8.61) for consequence modelling of different types of hazardous consequences.

Weather conditions have been selected based on wind speed and stability class for the area detailed weather statistics.

The average weather conditions have been selected; represented by wind speed of 3.6 m/s and stability class "D" representing "Neutral" weather conditions, in order to obtain conservative results. The prevailing wind direction is North (N).

Additional scenario was discussed to highlight the effect of different weather conditions "low wind speed", where the differences between the two weather conditions were negligible. Please refer to Annex "1" for additional scenario.



As per results from modeling the consequences of each scenario, the following table summarizes the study, and as follows:

| Event   | Scenario   | Effects   |
|---|--|---|
| <b>Pin hole (1") gas release 10" inlet pipeline</b>     |  |   |
|   | Gas cloud<br>UFL<br>LFL<br>50 % LFL  | <i>The modeling shows that the gas cloud effects will be limited inside the PRMS fence.</i>   |
|   | Heat radiation / Jet fire<br>9.5 kW/m <sup>2</sup><br>12.5 kW/m <sup>2</sup> | <i>The modeling shows that the heat radiation values will be limited inside the PRMS fence with no effects outside; while may affect operator if exist.</i>   |
|   | Worst-Case explosion<br>0.020 bar<br>0.137 bar<br>0.206 bar                  | <i>The modeling shows that the value of 0.020, 0.137 &amp; 0.206 bar will not extend outside the PRMS fence; i.e. no effects outside; while may affect operator if exist.</i>   |
| <b>Half Rupture (4") gas release 10" inlet pipeline</b> |  |   |
|   | Gas cloud<br>UFL<br>LFL<br>50 % LFL  | <i>The modeling shows that the gas clouds 50 % LFL &amp; LFL will extend to reach the southern fence and extend outside. The UFL will be limited inside the PRS boundary.</i>   |
|   | Heat radiation / Jet fire<br>9.5 kW/m <sup>2</sup><br>12.5 kW/m <sup>2</sup> | <i>The modeling shows that the values of 9.5, 12.5, 25 &amp; 37.5 kW/m<sup>2</sup> will extend outside the PRMS southern fence with no effects outside; while may affect operator if exist; in addition to security building.</i>                         |
|   | Worst-Case explosion<br>0.020 bar<br>0.137 bar<br>0.206 bar                  | <i>The modeling shows that the value of 0.020, 0.137 &amp; 0.206 bar will extend outside the PRMS southern fence with no effects outside.</i>   |
| <b>Full Rupture gas release 10" inlet pipeline</b>      |  |   |
|   | Gas cloud<br>UFL<br>LFL<br>50 % LFL  | <i>The modeling shows that the gas cloud effects (LFL &amp; 50 % LFL) will not reach southern fence; i.e. no effects outside.</i>   |
|   | Heat radiation / Jet fire<br>9.5 kW/m <sup>2</sup><br>12.5 kW/m <sup>2</sup> | <i>The modeling shows that the heat radiation values 9.5, 12.5, 25 &amp; 37.5 kW/m<sup>2</sup> will extend outside the PRMS southern fence, with no effects on the neighboring; while may affect operator if exist; in addition to security building.</i> |





| Event  | Scenario   | Effects   |
|--|--|---|
|  | Worst-Case explosion<br>0.020 bar<br>0.137 bar<br>0.206 bar                  | <i>The modeling shows that the value of 0.020, 0.137 &amp; 0.206 bar will extend outside the PRMS southern fence with no effects outside.</i>   |
| <b>Pin hole (1") gas release 10" outlet pipeline</b>     |  |   |
|  | Gas cloud<br>UFL<br>LFL<br>50 % LFL  | <i>The modeling shows that the gas cloud will be limited inside the PRS boundary.</i>   |
|  | Heat radiation / Jet fire<br>9.5 kW/m <sup>2</sup><br>12.5 kW/m <sup>2</sup> | <i>The modeling shows that the heat radiation value 1.6, 4, 9.5, 12.5, 25 &amp; 37.5 kW/m<sup>2</sup> effects will be limited inside the PRS boundary with no effect on the surroundings, while may affect operator if exist.</i>     |
|  | Worst-Case explosion<br>0.020 bar<br>0.137 bar<br>0.206 bar                  | <i>N/D.</i>   |
| <b>Half Rupture (4") gas release 10" outlet pipeline</b> |  |   |
|  | Gas cloud<br>UFL<br>LFL<br>50 % LFL  | <i>The modeling shows that the gas cloud will be limited inside the PRS boundary.</i>   |
|  | Heat radiation / Jet fire<br>9.5 kW/m <sup>2</sup><br>12.5 kW/m <sup>2</sup> | <i>The modeling shows that the heat radiation values of 9.5, 12.5, 25 &amp; 37.5 kW/m<sup>2</sup> will extend outside the PRMS eastern and western fences with no effect on the surroundings; while may affect operator if exist.</i> |
|  | Worst-Case explosion<br>0.020 bar<br>0.137 bar<br>0.206 bar                  | <i>The modeling shows that the overpressure values will extend outside the PRMS western fence; with no effect on the surroundings; while may affect operator if exist.</i>  |
| <b>Full Rupture gas release 10" outlet pipeline</b>      |  |   |
|  | Gas cloud<br>UFL<br>LFL<br>50 % LFL  | <i>The modeling shows that the gas cloud effects will be limited inside the PRS boundary.</i>   |
|  | Heat radiation / Jet fire<br>9.5 kW/m <sup>2</sup><br>12.5 kW/m <sup>2</sup> | <i>The modeling shows that the heat radiation values of 9.5, 12.5, 25 &amp; 37.5 kW/m<sup>2</sup> will extend outside the PRMS eastern and western</i>  |



| Event   | Scenario   | Effects   |
|---|--|---|
|   |  | <i>fences with no effect on the surroundings; while may affect operator if exist; in addition to security building.</i>   |
|   | Worst-Case explosion<br>0.020 bar<br>0.137 bar<br>0.206 bar                  | <i>The modeling shows that the overpressure values will extend outside the PRMS western fence; with no effect on the surroundings; while may affect operator if exist.</i>  |
|   | Heat radiation / Fireball<br>9.5 kW/m <sup>2</sup><br>12.5 kW/m <sup>2</sup> | <i>The modeling shows that the heat radiation values of 9.5, 12.5, 25 &amp; 37.5 kW/m<sup>2</sup> will extend outside the PRMS eastern and western fences with no effect on the surroundings; while may affect operator if exist; in addition to Control Room building.</i> |
| <b>Odorant tank 1" leak</b>                   |  |   |
|   | Gas cloud<br>UFL<br>LFL<br>50 % LFL  | <i>The modeling shows that the vapor cloud will be limited inside the PRS fence.</i>  |
|   | Heat radiation / Jet fire<br>9.5 kW/m <sup>2</sup><br>12.5 kW/m <sup>2</sup> | <i>The modeling shows that all values of heat radiation 9.5, 12.5, 25 &amp; 37.5 kW/m<sup>2</sup> will be limited inside the PRS boundary down and crosswind; i.e. no effect on the surroundings; while may affect operator if exist.</i>                                   |
|   | Worst-Case explosion<br>0.020 bar<br>0.137 bar<br>0.206 bar                  | <i>The modeling shows that the values of 0.137 &amp; 0.206 bar will extend outside the PRS boundary; with no effect on the surroundings; while may affect operator if exist; in addition to security building.</i>  |
| <b>Gas heater (water bath heating system)</b> |  |   |
|   | Gas cloud<br>UFL<br>LFL<br>50 % LFL  | <i>The modeling shows that the vapor cloud will be limited inside the PRS boundary downwind.</i>  |
|   | Heat radiation / Jet fire<br>9.5 kW/m <sup>2</sup><br>12.5 kW/m <sup>2</sup> | <i>The modeling shows that the heat radiation values 4, 9.5, 12.5, 25 &amp; 37.5 kW/m<sup>2</sup> effects will be limited inside the PRS boundary affecting the PRMS components; i.e. may affect operator if exist.</i>   |
|   | Worst-Case explosion<br>0.020 bar<br>0.137 bar<br>0.206 bar                  | <i>The modeling shows that the overpressure values will be limited inside the PRMS boundary; i.e. no effects outside; while may affect operator if exist.</i>   |



| Event  | Scenario   | Effects  |
|--|--|--|
| <b>Pin hole (1") gas release 10" off-take pipeline</b>     |  |  |
|  | Gas cloud<br>UFL<br>LFL<br>50 % LFL  | <i>The modeling shows that the gas cloud effects will be limited inside the PRS boundary.</i>  |
|  | Heat radiation / Jet fire<br>9.5 kW/m <sup>2</sup><br>12.5 kW/m <sup>2</sup> | <i>The modeling shows that the heat radiation values 9.5, 12.5 &amp; 25 kW/m<sup>2</sup> are limited inside the PRS and may affect operator if exist; while heat radiation values 1.6 &amp; 4 kW/m<sup>2</sup> extend outside the fence with no effects.</i>   |
|  | Worst-Case explosion<br>0.020 bar<br>0.137 bar<br>0.206 bar                  | N/D  |
| <b>Half Rupture (4") gas release 10" off-take pipeline</b> |  |  |
|  | Gas cloud<br>UFL<br>LFL<br>50 % LFL  | <i>The modeling shows that the gas cloud effects will be limited inside the PRS boundary.</i>  |
|  | Heat radiation / Jet fire<br>9.5 kW/m <sup>2</sup><br>12.5 kW/m <sup>2</sup> | <i>The modeling shows that the heat radiation values of 9.5 &amp; 12.5 kW/m<sup>2</sup> will cover the PRS boundary and may affect operator if exist; in addition to security building. Also, it will extend outside the PRS fence and may affect the neighboring person in the agricultural area "if any".<br/>The values of 25 &amp; 37.5 kW/m<sup>2</sup> are not determined.</i> |
|  | Worst-Case explosion<br>0.020 bar<br>0.137 bar<br>0.206 bar                  | N/D  |
| <b>Full Rupture gas release 10" off-take pipeline</b>      |  |  |
|  | Gas cloud<br>UFL<br>LFL<br>50 % LFL  | <i>The modeling shows that the gas cloud will be limited inside the PRS boundary.</i>  |
|  | Heat radiation / Jet fire<br>9.5 kW/m <sup>2</sup><br>12.5 kW/m <sup>2</sup> | <i>The modeling shows that the heat radiation values of 9.5 &amp; 12.5 kW/m<sup>2</sup> will cover the PRS boundary and may affect operator if exist; in addition to security building. Also, it will</i>  |

| Event | Scenario  | Effects  |
|-------|---|--|
|       |   | <i>extend outside the PRS fence and may affect the neighboring person in the agricultural area "if any".<br/>The values of 25 &amp; 37.5 kW/m2 are not determined.</i>   |
|       | Worst-Case explosion<br>0.020 bar<br>0.137 bar<br>0.206 bar | <i>The modeling shows that the overpressure values will extend outside the PRMS southern fence; and may affect on the neighboring person in the agricultural area "if any"; in addition, may affect operator if exist.</i> |

The previous table shows that there are some of potential hazards with heat radiation (12.5 kW/m<sup>2</sup>) resulting from jet fire and explosion overpressure waves (0.137 bar) from late explosion events.

These risks (Jet fire, Fireball & overpressure waves) will affect the workers at the PRMS, and reach the surrounding near to the station.

The major hazards that extend over site boundary and/or effect on workers / public were used for Risk Calculations.

Event Tree Analysis (ETA) is an analysis technique for identifying and evaluating the sequence of events in a potential accident scenario following the occurrence of an initiating event. ETA utilizes a visual logic tree structure known as an event tree (ET). ETA provides a Probabilistic Risk Assessment (PRA) of the risk associated with each potential outcome. ETA has been used for scenario development.

The following data and assumptions have been considered in the Event tree analysis (ETA):

- Failure frequency data (mainly E&P Forum/OGP),
- Risk reduction factors (if available),
- Ignition probabilities (both immediate and delayed),
- Vulnerability data.

Risks have been assessed for workers / public using International Risk Management Guidelines as a reference.

The resulting risks have been compared with International Risk Acceptance Criteria.

Risk evaluation for Individual Risk "IR" for the major hazards presented in the following tables:



### Individual Risk (IR) Calculation for PRMS Workers

| Source of Event   | Frequency<br>1 | Heat Radiation<br>(kW/m <sup>2</sup> ) &<br>Overpressure<br>(Bar) | Vulnerability<br>2 | Time<br>Exposed<br>3   | IR =<br>1 x 2 x 3 |
|---|----------------|---|--------------------|------------------------|-------------------|
| Gas release from<br>1"/10" Inlet<br>Pipeline                              | 1.47E-05       | Jet Fire<br>12.5  | 0.7<br>(Outdoor)   | 0.04 <sup>1 Pers</sup> | 4.12E-07          |
|   |                | Explosion<br>0.137  | 0.3<br>(Outdoor)   |                        | 1.76E-07          |
| Gas release from<br>heater  | 1.47E-05       | Jet Fire<br>12.5  | 0.7<br>(Outdoor)   | 0.04 <sup>1 Pers</sup> | 4.12E-07          |
|   |                | Explosion<br>0.137  | 0.3<br>(Outdoor)   |                        | 1.76E-07          |
| Gas Release from<br>4"/10" Inlet<br>pipeline 4"/10" Off-<br>take pipeline | 2.89E-05       | Jet Fire<br>12.5  | 0.7<br>(Outdoor)   | 0.04 <sup>1 Pers</sup> | 8.09E-07          |
|   |                | Jet Fire<br>12.5  | 0.1<br>(Indoor)    | 2.00 <sup>2 Pers</sup> | 5.78E-06          |
| Gas Release from<br>4"/10" Outlet<br>pipeline                             | 1.47E-05       | Jet Fire<br>12.5  | 0.7<br>(Outdoor)   | 0.04 <sup>1 Pers</sup> | 4.12E-07          |
|   |                | Explosion<br>0.137  | 0.3<br>(Outdoor)   |                        | 1.76E-07          |
|   |                | Jet Fire<br>12.5  | 0.1<br>(Indoor)    | 3.00 <sup>3 Pers</sup> | 4.41E-06          |
| Gas Release from<br>10" Inlet pipeline &<br>10" Off-take<br>pipeline      | 1.50E-06       | Jet Fire<br>12.5  | 0.7<br>(Outdoor)   | 0.04 <sup>1 Pers</sup> | 4.20E-08          |
|   |                | Jet Fire<br>12.5  | 0.1<br>(Indoor)    | 2.00 <sup>2 Pers</sup> | 3.00E-07          |
|   |                | Explosion<br>0.137  | 1<br>(Indoor)      | 2.00 <sup>2 Pers</sup> | 3.00E-06          |
| Gas Release from<br>10" Outlet pipeline                                   | 6.45E-07       | Jet Fire<br>12.5  | 0.1<br>(Indoor)    | 5.00 <sup>5 Pers</sup> | 3.23E-07          |
|   |                | Jet Fire<br>12.5  | 0.7<br>(Outdoor)   |                        | 1.81E-08          |
|   |                | Fireball<br>12.5  | 0.7<br>(Outdoor)   | 0.04 <sup>1 Pers</sup> | 1.81E-08          |
|   |                | Explosion<br>0.137  | 0.3<br>(Outdoor)   |                        | 7.74E-09          |
| Odorant tank 1"<br>leak   | 1.23E-05       | Jet Fire<br>12.5  | 0.7<br>(Outdoor)   | 0.04 <sup>1 Pers</sup> | 3.44E-07          |
|   |                | Explosion<br>0.137  | 1<br>(Indoor)      | 2.00 <sup>2 Pers</sup> | 2.46E-05          |
| <b>TOTAL Risk for the Workers</b>   |                |   |                    |                        | <b>4.14E-05</b>   |




### *Individual Risk (IR) Calculation for the Public Near to the PRMS*

| Source of Event                           | Frequency<br><b>1</b> | Heat Radiation (kW/m <sup>2</sup> ) & Overpressure (Bar) | Vulnerability<br><b>2</b> | Time Exposed<br><b>3</b>      | IR =<br><b>1 x 2 x 3</b> |
|---|-----------------------|--|---------------------------|-------------------------------|--------------------------|
| Gas Release from 4"/10" Off-take pipeline | <b>2.89E-05</b>       | Jet Fire<br>12.5   | <b>0.7</b><br>(Outdoor)   | <b>0.08</b> <sup>1 Pers</sup> | <b>1.62E-06</b>          |
| Gas Release from 4"/10" Inlet pipeline    |                       | Jet Fire<br>12.5   | <b>0.7</b><br>(Outdoor)   |                               | <b>1.62E-06</b>          |
|   |                       | Explosion<br>0.137                                       | <b>0.3</b><br>(Outdoor)   |                               | <b>6.94E-07</b>          |
| Gas Release from 4"/10" Outlet pipeline   | <b>1.47E-05</b>       | Jet Fire<br>12.5   | <b>0.7</b><br>(Outdoor)   | <b>0.08</b> <sup>1 Pers</sup> | <b>8.23E-07</b>          |
|   |                       | Explosion<br>0.137                                       | <b>0.3</b><br>(Outdoor)   |                               | <b>3.53E-07</b>          |
| Gas Release from 10" Off-take pipeline    | <b>1.50E-06</b>       | Jet Fire<br>12.5   | <b>0.7</b><br>(Outdoor)   | <b>0.08</b> <sup>1 Pers</sup> | <b>8.40E-08</b>          |
|   |                       | Explosion<br>0.137                                       | <b>0.3</b><br>(Outdoor)   |                               | <b>3.60E-08</b>          |
| Gas Release from 10" Inlet pipeline       |                       | Jet Fire<br>12.5   | <b>0.7</b><br>(Indoor)    | <b>1.67</b> <sup>1 Pers</sup> | <b>2.51E-07</b>          |
|   |                       | Jet Fire<br>12.5   | <b>0.7</b><br>(Outdoor)   | <b>0.08</b> <sup>1 Pers</sup> | <b>8.40E-08</b>          |
|   |                       | Explosion<br>0.137                                       | <b>0.3</b><br>(Outdoor)   |                               | <b>3.60E-08</b>          |
| Gas Release from 10" Outlet pipeline      | <b>6.45E-07</b>       | Jet Fire<br>12.5   | <b>0.7</b><br>(Outdoor)   | <b>0.08</b> <sup>1 Pers</sup> | <b>3.61E-08</b>          |
|   |                       | Explosion<br>0.137                                       | <b>0.3</b><br>(Outdoor)   |                               | <b>1.55E-08</b>          |
| Odorant tank 1" leak                      | <b>1.23E-05</b>       | Explosion<br>0.137                                       | <b>0.3</b><br>(Outdoor)   | <b>0.08</b> <sup>1 Pers</sup> | <b>2.95E-07</b>          |
| <b>TOTAL Risk for the Public (PRMS)</b>   |                       |  |                           |                               | <b>5.94E-06</b>          |

The previous tables show that there are some effects on PRMS workers & surrounding public, it was assumed that: One person "as public" is present in the agricultural area neighboring to the PRS for 2 hours / day light, Five persons "as public" is present in the residential building neighboring to the PRS for 8 hours / day light and Five Persons "as Workers" are available in the PRS for 24 hr./day (Three operators in control room and



admin building + Two persons in the security room), and One of the operators will be available around the PRS components for Maintenance/ Operation for 1 hour / day light. The following figure shows the Individual Risk "IR" for El-Baragil PRMS:

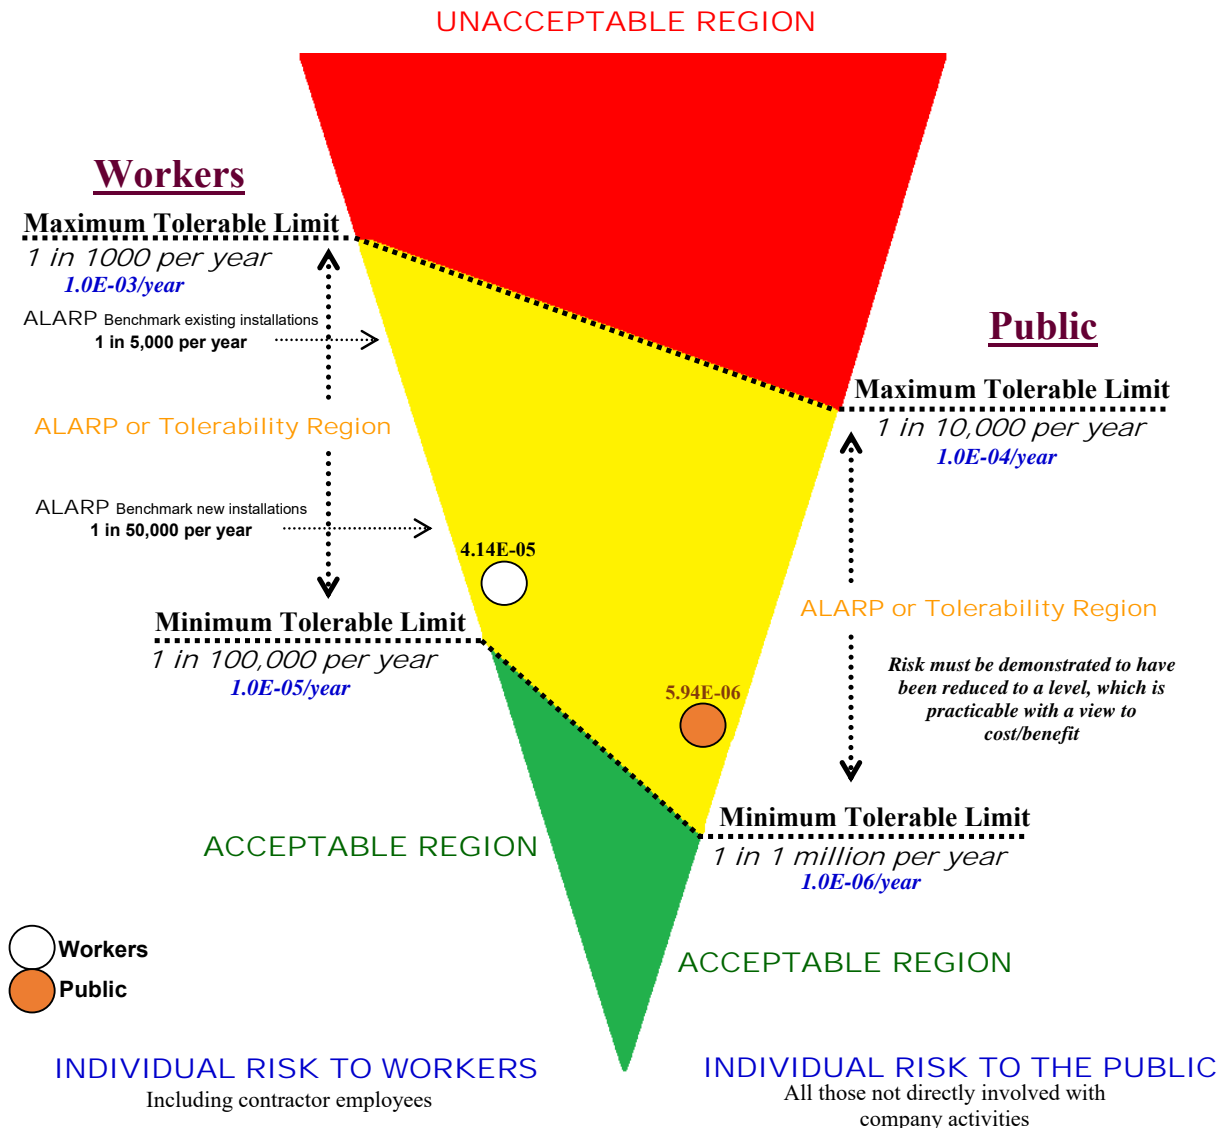

**The level of Individual Risk to the exposed Workers at El-Baragil PRMS, based on the risk tolerability criterion used is ALARP.**

**The level of Individual Risk to the exposed Public at El-Baragil PRMS area, based on the risk tolerability criterion used is ALARP.**

Referring to the ALARP risk; all efforts had been considered and additional control measures have been deemed not "Practicable" to prevent incidents and to mitigate chronic and acute effects and to bring the risk from the "ALARP" Region to the acceptable region.

## Introduction

The Egyptian Natural Gas Holding Company "EGAS" has engaged Petroleum Safety and Environmental Services Company "PETROSAFE" to identify and evaluate hazards generated from the "Natural Gas Pressure Reduction and Odorant Station – PRMS" at El-Baragil City – Giza Governorate – Egypt. The PRMS operated by Town Gas Company in order to advice protective measures for minimizing risk up to acceptable level.

As part of this review, a QRA study conducted for the following objectives:

- Identify hazardous scenarios related to the most critical unexpected event(s).
- Determine the likelihood of the identified scenarios;
- Model the potential consequences of the identified scenarios;
- Determine the Potential risk of fatality resulting from the identified hazardous scenarios.

The proposed study should also identify existing arrangements for the prevention of major accidents and their mitigation. This would involve emergency plan and procedure for dealing with such events.

PETROSAFE selected to carry out this study, as it has the experience in conducting this type of work.

PETROSAFE is also empowered by the Egyptian General Petroleum Corporation "EGPC" to identify and evaluate factors that relate to Occupational Health & Safety and Environmental Protection.





## Technical Definitions

|             |   |
|-------------|---|
| ALARP       | <i>Stands for "As Low As Reasonably Practicable", and is a term often used in the milieu of safety-critical and safety-involved systems. The ALARP principle is that the residual risk shall be as low as reasonably practicable.</i>   |
| API         | <i>American Petroleum Institute.</i>  |
| Confinement | <i>A qualitative or quantitative measure of the enclosure or partial enclosure areas where vapors cloud may be contained.</i>   |
| Congestion  | <i>A qualitative or quantitative measure of the physical layout, spacing, and obstructions within a facility that promote development of a vapor cloud explosion.</i>   |
| DNV PHAST   | <i>Process Hazard Analysis Software Tool "PHAST" established by Det Norske Veritas "DNV". Phast examines the progress of a potential incident from the initial release to far-field dispersion including modelling of pool spreading and evaporation, and flammable and toxic effects.</i>  |
| E&P Forum   | <i>Exploration and Production "E&amp;P" Forum is the international association of oil companies and petroleum industry organizations formed in 1974. It was established to represent its members' interests at the specialized agencies of the United Nations, governmental and other international bodies concerned with regulating the exploration and production of oil and gas.</i> |
| EGAS        | <i>The Egyptian Natural Gas Holding Company.</i>  |
| EGPC        | <i>The Egyptian General Petroleum Corporation.</i>  |
| EX          | <i>Explosion Proof Type Equipment.</i>  |
| EERA        | <i>Escape, Evacuation and Rescue Assessment.</i>  |
| ESD         | <i>Emergency Shut Down.</i>   |
| Explosion   | <i>Explosion is the delayed ignition of gas in a confined or congested area resulting in high overpressure waves.<br/>Once the explosion occurs, it creates a blast wave that has a very steep pressure rise at the wave front and a blast wind that is a transient flow behind the blast wave. The impact of the blast wave</i>  |



on structure near the explosion known as blast loading. The two important aspects of the blast loading concern are the prediction of the magnitude of the blast and of the pressure loading onto the local structures. Pressure loading predication as result of a blast; resemble a pulse of trapezoidal or triangular shape. They normally have duration of between approximately 40 msec and 400 msec. The time to maximum pressure is typically 20 msec.

Primary damage from an explosion may result from several events:

1. Overpressure - the pressure developed between the expanding gas and its surrounding atmosphere.
2. Pulse - the differential pressure across a plant; as a pressure wave passes; might cause collapse or movement, both positive and negative.
3. Missiles and Shrapnel - are whole or partial items that are thrown by the blast of expanding gases that might cause damage or event escalation. In general, these "missiles" from atmospheric vapor cloud explosions cause minor impacts to process equipment since insufficient energy is available to lift heavy objects and cause major impacts. Small projectile objects are still a hazard to personnel and may cause injuries and fatalities. Impacts from rupture incidents may produce catastrophic results.

(ETA)  
Event Tree  
Analysis

Is a forward, bottom up, logical modeling technique for both success and failure that explores responses through a single initiating event and lays a path for assessing probabilities of the outcomes and overall system analysis. This analysis technique used to analyze the effects of functioning or failed systems, given that an event has occurred.

Failure Rate

Is the frequency with which an engineered system or component fails, expressed in failures per unit of time. It is highly used in reliability engineering.

GASCO

The Egyptian Natural Gas Company.

Gas Cloud  
Dispersion

Gas cloud air dilution naturally reduces the concentration to below the LEL or no longer considered ignitable (typically defined as 50 % of the LEL).

|                                      |   |
|--------------------------------------|---|
| HSE Policy                           | <i>Health, Safety and Environmental Policy.</i>   |
| Hazard                               | <i>An inherent physical or chemical characteristic (flammability, toxicity, corrosively, stored chemical or mechanical energy) or set of conditions that has the potential for causing harm to people, property, or the environment.</i>  |
| (HAZOP) Hazard And Operability Study | <i>Is a structured and systematic examination of a planned or existing process or operation in order to identify and evaluate problems that may represent risks to personnel or equipment, or prevent efficient operation. The HAZOP technique is qualitative, and aims to stimulate the imagination of participants to identify potential hazards and operability problems; structure and completeness given by using guideword prompts.</i>   |
| (HAZID) Hazard Identification Study  | <i>Is a tool for hazard identification, used early in a project as soon as process flow diagrams, draft heat and mass balances, and plot layouts are available. Existing site infrastructure, weather, and Geotechnical data also required, these being a source of external hazards.</i>   |
| (HAC) Hazardous Area Classification  | <i>When electrical equipment is used in, around, or near an atmosphere that has flammable gases or vapors, flammable liquids, combustible dusts, ignitable fibers or flying's, there is always a possibility or risk that a fire or explosion might occur. Those areas where the possibility or risk of fire or explosion might occur due to an explosive atmosphere and/or mixture is often called a hazardous (or classified) location/area.</i>  |
| (IR) Individual Risk                 | <i>The risk to a single person inside a particular building. Maximum individual risk is the risk to the most-exposed person and assumes that the person is exposed.</i>   |
| Jet Fire                             | <i>A jet fire is a pressurized stream of combustible gas or atomized liquid (such as a high-pressure release from a gas pipe or wellhead blowout event) that is burning. If such a release is ignited soon after it occurs, (i.e., within 2 - 3 minutes), the result is an intense jet flame. This jet fire stabilizes to a point that is close to the source of release, until the release stopped. A jet fire is usually a very localized, but very destructive to anything close to it. This is partly because as well as producing thermal radiation, the jet fire causes considerable convective heating in the region</i> |



beyond the tip of the flame. The high velocity of the escaping gas entrains air into the gas "jet" causing more efficient combustion to occur than in pool fires.

Consequently, a much higher heat transfer rate occurs to any object immersed in the flame, i.e., over 200 kW/m<sup>2</sup> (62,500 Btdsq. ft) for a jet fire than in a pool fire flame. Typically, the first 10% of a jet fire length is conservatively considered un-ignited gas, as a result of the exit velocity causing the flame to lift off the gas point of release. This effect has been measured on hydrocarbon facility flares at 20% of the jet length, but a value of 10% is used to account for the extra turbulence around the edges of a real release point as compared to the smooth gas release from a flare tip. Jet flames have a relatively cool core near the source. The greatest heat flux usually occurs at impingement distances beyond 40% of the flame length, from its source. The greatest heat flux is not necessarily on the directly impinged side.

kW/m<sup>2</sup>

Kilowatt per square meter – unit for measuring the heat radiation (or heat flux).

LFL / LEL

Lower Flammable Limit / Lower Explosive Limit - The lowest concentration (percentage) of a gas or a vapor in air capable of producing a flash of fire in presence of an ignition source.

MSDS

Material Safety Data Sheet.

mm Hg

A millimeter of mercury is a manometric unit of pressure, formerly defined as the extra pressure generated by a column of mercury one millimeter high.

MEL

Maximum Exposure Limit.

NFPA

National Fire Protection Association.

N

North Direction.

NE

Northern East Direction.

NW

Northern West Direction.

N/D

Not Determined. (It means not getting results from the software's calculations)

|                             |  |
|-----------------------------|--|
| N/R                         | <i>Not Reached. (It means the resulting consequence doesn't reach the surrounding receptors "if any")</i>  |
| OGP                         | <i>Oil and Gas Producers.</i>  |
| ppm                         | <i>Part Per Million.</i>   |
| PRMS                        | <i>Pressure Reduction and Metering Station.</i>  |
| P&ID's                      | <i>Piping and Instrumentation Diagrams.</i>  |
| PETROSAFE                   | <i>Petroleum Safety and Environmental Services Company.</i>  |
| QRA                         | <i>Quantitative Risk Assessment Study is a formal and systematic approach to estimating the likelihood and consequences of hazardous events, and expressing the results quantitatively as risk to people, the environment or your business.</i>                                  |
| Risk                        | <i>Relates to the probability of exposure to a hazard, which could result in harm to personnel, the environment or public. Risk is a measure of potential for human injury or economic loss in terms of both the incident likelihood and the magnitude of the injury / loss.</i> |
| Risk Assessment             | <i>The identification and analysis, either qualitative or quantitative, of the likelihood and outcome of specific events or scenarios with judgments of probability and consequences.</i>  |
| scm/hr                      | <i>Standard Cubic Meter Per Hour.</i>  |
| SCBA                        | <i>Self-Contained Breathing Apparatus.</i>   |
| SE                          | <i>Southern East Direction.</i>  |
| SW                          | <i>Southern West Direction.</i>  |
| TWA                         | <i>Time Weighted Averages.</i>   |
| UFL/UEL                     | <i>Upper flammable limit, the flammability limit describing the richest flammable mixture of a combustible gas.</i>  |
| UVCE                        | <i>When a flammable vapor is released, its mixture with air will form a flammable vapor cloud. If ignited, the flame speed may accelerate to high velocities and produce significant blast overpressure.</i>   |
| V                           | <i>Volume.</i>   |
| Vapor Cloud Explosion (VCE) | <i>An explosion in air of a flammable material cloud.</i>  |



## Objectives

The objectives of this QRA for the unit facilities are:

- Identify hazardous scenarios related to the facilities based on historical data recorded;
- Determine the likelihood (frequencies) of the identified scenarios;
- Model the potential consequences of the identified scenarios;
- Determine the Potential risk of fatality resulting from the identified hazardous scenarios;
- Evaluate the risk against the acceptable risk level to ensure that it is within *As Low As Reasonably Practicable "ALARP"*, otherwise additional control measures and recommendations will be provided at this study to reduce the Risk, (*ALARP*).



## Quantitative Risk Assessment Study Scope

The scope of work of this QRA study is limited to the following:

- Identification of the Most Critical Event<sub>(s)</sub> or scenarios that may lead to fatal accidents as well as to ensure that the expected risk will not exceed the Acceptable Risk Level as per national and international standards;
- To assess and quantify the risks associated with El-Baragil PRMS and the off-take point on the neighboring / surrounding community;
- The study determines Frequencies, Consequences (Including Associated Effect Contours) and Potential Risk of Fatality for the identified hazardous scenarios;
- Normal operations of the facilities (e.g. Construction and specific maintenance activities) are excluded from this analysis.



## Quantitative Risk Assessment "QRA" Studies

### Method of Assessment

#### *1.General Method Used*

Attention mainly focussed on those accidents where a gross failure of containment could result in the generation of a large vapour cloud of flammable or toxic material. The approach adopted has involved the following stages:

- Identification of hazardous materials,
- Establishment of maximum total inventories and location.

During the site visit by the study team, the overall functioning of the site discussed in some detail and the Companies asked to provide a complete list of holdings of hazardous materials. A preliminary survey notes was issued by the team, as a private communication to the company concerned, and this formed the basis for subsequent more discussion and analysis.

From the PRMS design model provided by the client, it was impractical to examine in depth all possible failure modes for all parts within the time allowed for this study. Instead, only those potential failures, which might contribute, either directly or indirectly, to off-site risks were examined.

#### *2.Risk Assessment*

As the PRMS designed and prepared for construction, so it was therefore necessary for the study team to identify and analyse the hazards potential from first principles the routes by which a single or multiple accident could affect the community or neighbouring.

The terms of reference required the team to investigate and determine the overall risk to health and safety both from individual installations and then foreseeable interactions.

The assessment of risk in a complex situation is difficult. No method is perfect as all have advantages and limitations.

It was agreed that the quantitative approach was the most meaningful way of comparing and evaluating different risks. The risk assessment framework shown in Figure (1) used for the study.



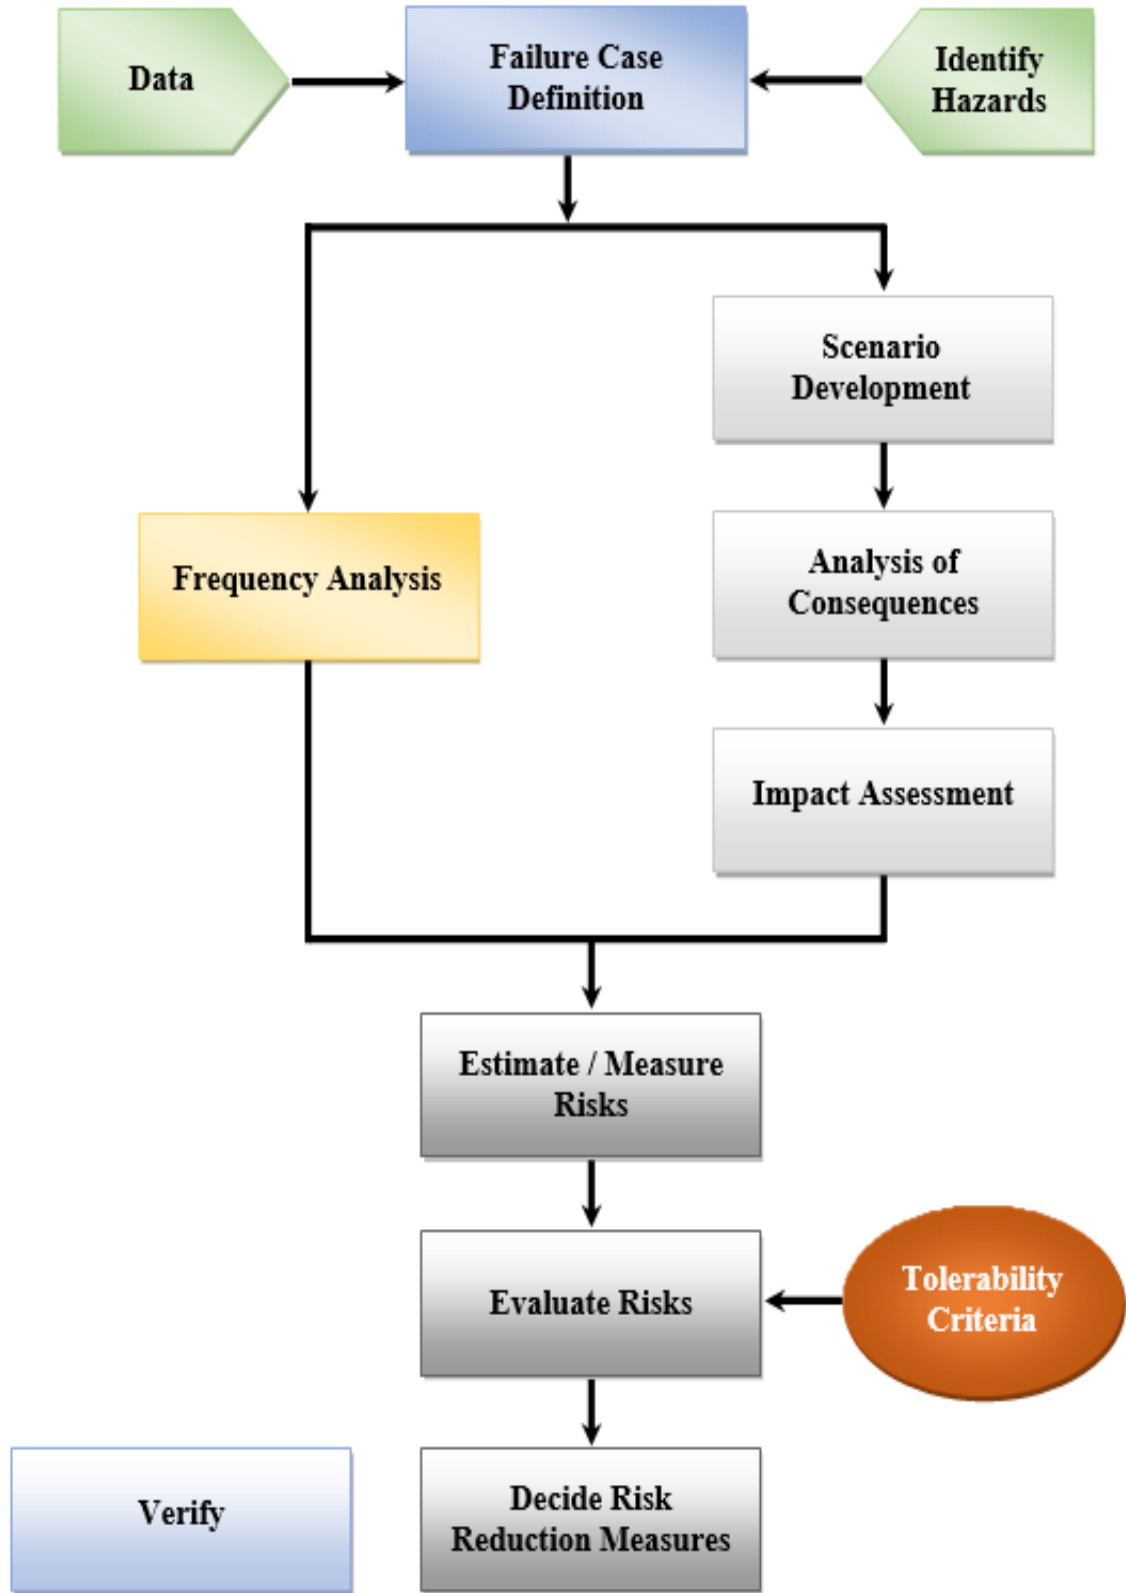


Figure 1 Risk Assessment Framework

## Modelling the Consequences

Modelling of the consequences is one of the key steps in Quantitative Risk Assessment "QRA", as it provides the link between hazard identification (in this study Potential Loss of Containment Incidents) and the determination of possible impact of those incidents on People (Worker / Public), Asset and the Environment.

In this study, Natural Gas (Mainly Methane CH<sub>4</sub>) was considered. There are several types of consequences to be considered for modelling, these include Gas Dispersion (UFL - LFL - 50 % LFL) / Heat Radiation / Explosion Overpressure modelling, also each of these scenarios described in the following table:

*Table 1. Description of Modeling of the Different Scenario*

|                                   |  |
|-----------------------------------|--|
| <b><i>Discharge Modeling</i></b>  | <i>Modeling of the mass release rate and its variation overtime.</i> |
| <b><i>Radiation Modeling</i></b>  | <i>Modeling of the Thermal radiation from fires.</i>                 |
| <b><i>Dispersion Modeling</i></b> | <i>Modeling of the Gas and two-phase releases.</i>                   |
| <b><i>Overpressure</i></b>        | <i>Associated with explosions or pressure burst.</i>                 |

Toxic hazards are considered as result of releases / loss of containment for which discharge modeling and gas dispersion modeling are required. The hazard ranges are dependent upon the condition of the release pressure and rate of release.

There are a number of commercial software for modeling gas dispersion, fire, explosion and toxic releases. PETROSAFE select the DNV PHAST Ver. 8.61 Software package in modeling scenarios.

The software developed by DNV in order to provide a standard and validated set of consequence models that can be used to predict the effects of a release of hydrocarbon or chemical liquid or vapour. (Results of the modeling presented in pages from 47 to 92)



## Criterion for Risk Tolerability

The main function of this phase of the work was to assess the effectiveness of the proposed arrangement for managing risks against performance standards.

In order to do this, we need firstly to define a performance standard and secondly, to be able to analyse the effectiveness of the arrangements in a manner which permits a direct comparison with these standards.


The defining of performance standards undertakes at the following three levels:

- Policy-based
- System
- Technical

Where the present work is mainly concerned with the assessment against the standards associated with the first two levels.

The policy-based performance standard relates to this objective to provide a working environment, where the risk to the individual reduced to a level that is ALARP.

This performance standard is therefore, expressed in the form of individual risk and the arrangements for managing this risk should result in a level of 'Individual Risk', based on a proposed Tolerability Criteria, Figure (2).

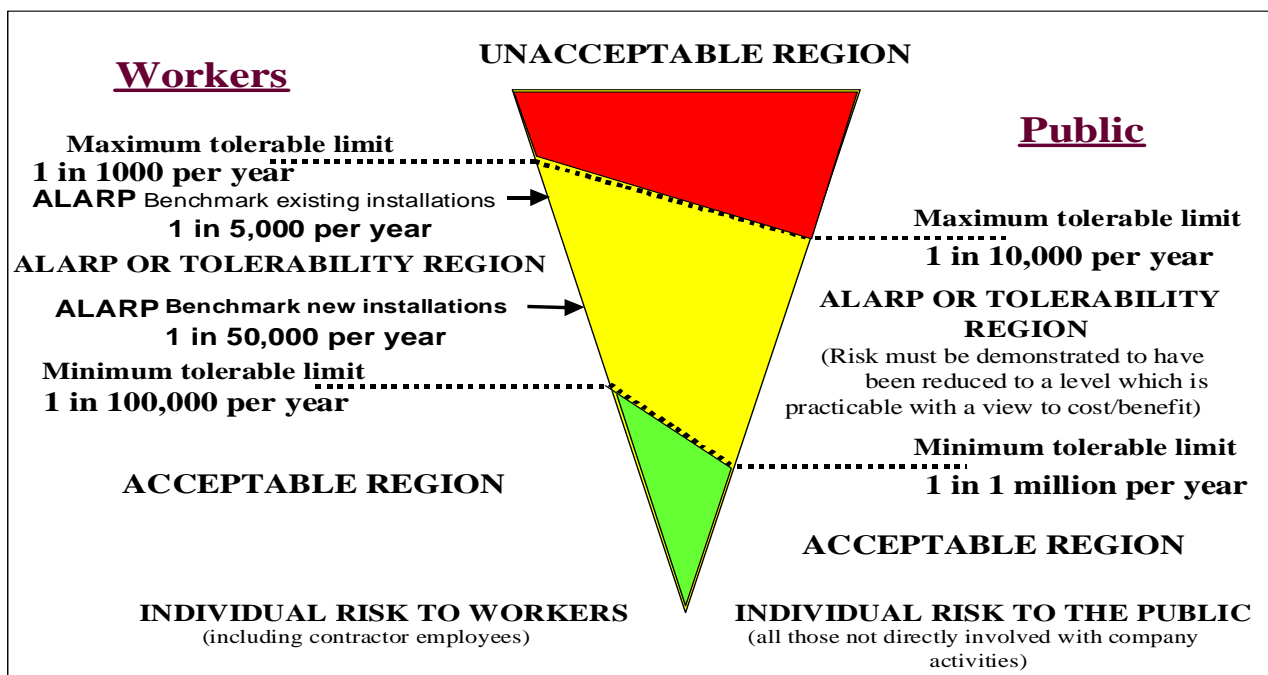

**Figure 2. Criteria for Individual Risk Tolerability**




The criterion for IR tolerability for workers and to the public outlined in Table (2) and Figure (3).

It should be noted that these criteria proposed only as a guideline. Risk assessment is no substitute to professional judgement.

*Table 2. Proposed Individual Risk (IR) Criteria (per person/year)*

| Risk Level         | Workers                    | Public                     |
|--------------------|----------------------------|----------------------------|
| <i>Intolerable</i> | $> 10^{-3}$ per person/yr. | $> 10^{-4}$ per person/yr. |
| <i>Negligible</i>  | $> 10^{-5}$ per person/yr. | $> 10^{-6}$ per person/yr. |

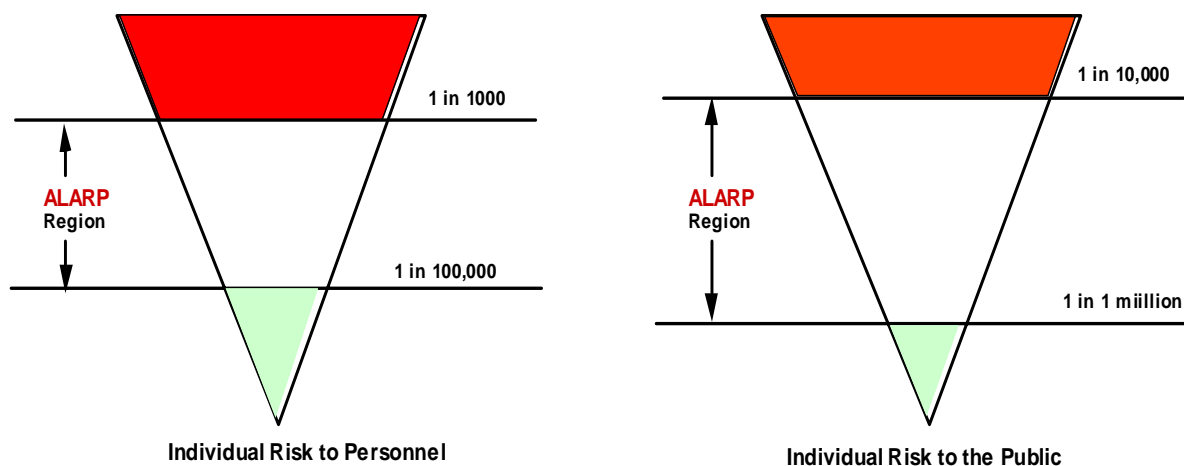

**Figure 3. Proposed Individual Risk Criteria**

Workers would include the Company employees and contractors. The public includes the public, visitors, and any third party who is not directly involved in the Company work activities.

On this basis, we have chosen to set our level of intolerability at Individual Risk for workers of 1 in 1,000 per year, and we define an individual risk of 1 in 100,000 per year as broadly acceptable. Consequently, our ALARP region is between 1 in 1,000 and 1 in 100,000 per person/year.

It is important to ensure that conflict between these subordinate standards and those stemming from international codes and standards are avoided and that any subordinate standards introduced are at least on a par with or augment those standards, which are associated with compliance with these international requirements. These system level performance standards are included as part of the summaries from the QRA. These used as the basis for assessing the



suitability and sufficiency of Town Gas Site arrangements for both protecting personnel on site and members of public from major hazards and securing effective response in an emergency. Failure to meet acceptance criteria at this level results in the identification of remedial measures for assessment both qualitatively and quantitatively.

The analytical work uses a system analysis approach and divided into a number of distinct phases:

- Data collection, including results from site-based qualitative assessments.
- Definition of arrangements.
- Qualitative evaluation of arrangements against a catalogue of fire and explosion hazards from other major accident hazards.
- Preparing of event tree analysis models.
- Consolidation of list of design events.
- Analysis of the effect of design events on fire, explosion and toxic hazard management and emergency response arrangements.
- Quantification of that impact in terms of individual risk.

The main model would base on a systems approach, and it takes the following form:

- Estimates of incremental individual risk (IIR) per person/yr.
- Is caused-consequences based.
- Uses event tree analysis to calculate the frequency of occurrence.
- Estimates incremental individual risk utilizing event tree analysis, based on modeling the emergency response arrangements from detection through to recovery to a place of safety.



## Personnel Vulnerability and Structural Damage

A criterion used in the QRA study for the calculation of personnel vulnerability and structural / asset damage because of fire, explosion and toxic release shown in Table (3).

The criteria shown below provide some assumptions for the impairment effects of hydrocarbon releases on personnel and structures, which based on Health and Safety Executive: Methods of approximation and determination of human vulnerability for offshore major accident hazard assessment.

*Table 3. Criteria for Personnel Vulnerability and Structural Damage*

| Event Type                         | Threshold of Fatality                                    | Asset/Structural Damage   |
|------------------------------------|--|---|
| Jet and Diffusive Fire Impingement | 6.3 kW/ m <sup>2</sup> (1)<br>12.5 kW/m <sup>2</sup> (2) | - Flame impingement 10 minutes.<br>- 300 - 500 kW/m <sup>2</sup><br>Structural Failure within 20 minutes. |
| Pool Fire Impingement              | 6.3 kW/ m <sup>2</sup> (1)<br>12.5 kW/m <sup>2</sup> (2) | - Flame impingement 20 minutes<br>- 100 - 150 kW/m <sup>2</sup><br>Structural Failure within 30 minutes.  |
| Smoke                              | 2.3% v/v (3)<br>15% v/v (4)                              |   |
| Explosion Overpressure             | 300 mbar   | 100 mbar  |

- (1) Fatality within 1 - 2 minutes
- (2) Fatal < 1 minute
- (3) Above 2.3%, escape possible but difficult
- (4) No escape possible, fatal in a few seconds

The effects of exposure to fire expressed in terms of heat radiation (kW/m<sup>2</sup>) and overpressure waves shown in Tables (4), (5) and (6).



*Table 4. Heat Radiation Effects on Structures (International Data Bank)\**

| Radiation Level<br>kW/m <sup>2</sup> | Observed Effect  |
|--------------------------------------|--|
| <b>37.5</b>                          | Sufficient to cause damage to process equipment.                           |
| <b>25</b>                            | Minimum energy to ignite wood at indefinitely long exposure (non-piloted). |
| <b>12.5</b>                          | Minimum energy required to ignite wood, melting of plastic tubing.         |

*Table 5. Heat Radiation Effects on People*

| Radiation Level<br>kW/m <sup>2</sup> | Effects on People   |
|--------------------------------------|---|
| <b>1.2</b>                           | Equivalent to heat from sun at midday summer.   |
| <b>1.6</b>                           | Minimum level at which pain can be sensed.  |
| <b>4 - 6</b>                         | Pain caused in 15 - 20 seconds, Second Degree burns after 30 seconds.                                 |
| <b>12</b>                            | 20 % chance of fatality for 60 seconds exposure.  |
| <b>25</b>                            | 100 % chance of fatality for continuous exposure.<br>50 % chance of fatality for 30 seconds exposure. |
| <b>40</b>                            | 30 % chance of fatality for 15 seconds exposure.  |
| <b>50</b>                            | 100 % chance of fatality for 20 seconds exposure.   |

\*Ref.1- OGP, International Association of Oil & Gas Producers, March 2010.

\*Ref.2- API 521.



Table 6. Effects of Overpressure

| Pressure |      | Effects / Damage  |
|----------|------|---|
| bar      | psig |   |
| 0.002    | 0.03 | Occasional breakage of glass windows.   |
| 0.006    | 0.1  | Breakage of some small windows.   |
| 0.021    | 0.3  | Probability of serious damage beyond this point = 0.05.<br>10 % glass broken. |
| 0.027    | 0.4  | Minor structural damage of buildings.   |
| 0.068    | 1.0  | Partial collapse of walls and roofs, possible injuries.                       |
| 0.137    | 2.0  | Some severe injuries, death unlikely.   |
| 0.206    | 3.0  | Steel frame buildings distorted / pulled from foundation.                     |
| 0.275    | 4.0  | Oil storage tanks ruptured.   |
| 0.344    | 5.0  | Wooden utilities poles snapped / Fatalities.                                  |
| 0.41     | 6.0  | Nearly complete destruction of building.                                      |
| 0.48     | 7.0  | Loaded wagon train overturned.  |
| 0.689    | 10.0 | Total destruction of buildings.   |



## Quantification of the Frequency of Occurrence

The probability of a sequence of events leading to a major hazard is dependent on the probability of each event in a sequence occurring; usually these probabilities may be multiplied together to obtain the end event probability or frequency.

The technique of Quantified Risk Assessment 'QRA' requires data in the form of probability or frequency to be estimated for each input event.

Ideally, data relating to hardware failures and human error that are specific to each plant should be obtained from the company's maintenance and historical records.

Unfortunately, records available were not in the form that allows data relevant to this study to be obtained. Therefore, other sources of data were used as a basis for failure/error scenarios. The sources of information and data are shown in the References section of this report.

## Identification of Scenarios Leading to Selected Failures

For each selected failure scenario, the potential contributory factors were examined, taking into account any protective features available. Typically, the factors examined included:

- Operator error
- Metallurgical fatigue or ageing of materials
- Internal or external Corrosion
- Loss of process control, e.g. pressure, temperature or flow, etc.
- Overfilling of vessels
- Introduction of impurities
- Fire and/or explosion
- Missiles
- Flooding

Account was taken at this stage of those limited releases, which, although in themselves did not constitute a significant off-site hazard could, under some circumstances, initiate a sequence leading to a larger release, as a knock-on effect.

It was noted that the proposed criterion for risk tolerability was used in Egypt by the following organizations: British Gas / British Petroleum / Shell / Total.



## Relevant Weather Data for the Study

### -Weather Data

The Weather Data relevant to this study consists of a list of weather conditions in the form of different combinations of wind-speed/direction, temperature, humidity and atmospheric stability. Table (7)

The weather conditions are an important input into the dispersion calculations and results for a single set of conditions could give a misleading picture of potential hazard.

Met-oceanographic data gathered from Weather base for El-Baragil Area – Giza Governorate over a period of some years.

These data included wind speed, wind direction, air temperature and humidity, as well as current speed, direction and wave height.

*Table 7. Annual Average Temperature, Relative Humidity and Wind Speed / Direction*

|                              |                        |              |
|------------------------------|------------------------|--------------|
| <b>• Air Temperature °C</b>  |                        |              |
|                              | Min. Recorded          | 13.4 °C      |
|                              | Max. Recorded          | 28.0 °C      |
|                              | <i>Annual Average</i>  | 21.5 °C      |
| <b>• Relative Humidity %</b> |                        |              |
|                              | Annual Average Morning | 63.8 %       |
|                              | Annual Average Evening | 46.0 %       |
|                              | <i>Annual Average</i>  | 57.2 %       |
| <b>• Wind Speed m/s</b>      |                        |              |
|                              | <i>Annual Average</i>  | 3.6 m / sec. |
| <b>• Wind Direction</b>      |                        |              |
|                              | <i>Annual Average</i>  | N            |

The general climatic conditions at El-Baragil Area (Giza Governorate) are summarized in Tables No. (8, 9 & 10) Below.



**Table 8. Mean of Monthly Air Temperature (°C) - El-Baragil Area**

| Months     | Jan  | Feb  | Mar  | Apr  | May  | Jun  | Jul | Aug  | Sep  | Oct  | Nov | Dec  |
|------------|------|------|------|------|------|------|-----|------|------|------|-----|------|
| Temp. (c°) | 13.4 | 14.7 | 17.1 | 21.2 | 24.6 | 27.2 | 28  | 27.8 | 26.3 | 23.6 | 19  | 14.9 |


**Table 9. Mean of Monthly Wind Speed (m/sec) - El-Baragil Area**

| Months             | Jan  | Feb  | Mar  | Apr  | May  | Jun  | Jul  | Aug  | Sep | Oct  | Nov  | Dec  |
|--------------------|------|------|------|------|------|------|------|------|-----|------|------|------|
| Wind Speed (m/sec) | 3.19 | 3.69 | 4.11 | 3.81 | 4.11 | 4.11 | 3.81 | 3.39 | 3.5 | 3.61 | 3.11 | 3.11 |

**Table 10. Mean of Monthly Average Relative Humidity - El-Baragil Area**

| Months                | Jan  | Feb  | Mar  | Apr  | May | Jun  | Jul  | Aug | Sep | Oct  | Nov  | Dec  |
|-----------------------|------|------|------|------|-----|------|------|-----|-----|------|------|------|
| Relative Humidity (%) | 63.2 | 58.7 | 55.8 | 48.4 | 46  | 49.1 | 57.2 | 61  | 60  | 59.5 | 63.1 | 63.8 |

Figure (4) shows the maximum temperatures diagram for El-Baragil Area (Giza Governorate)

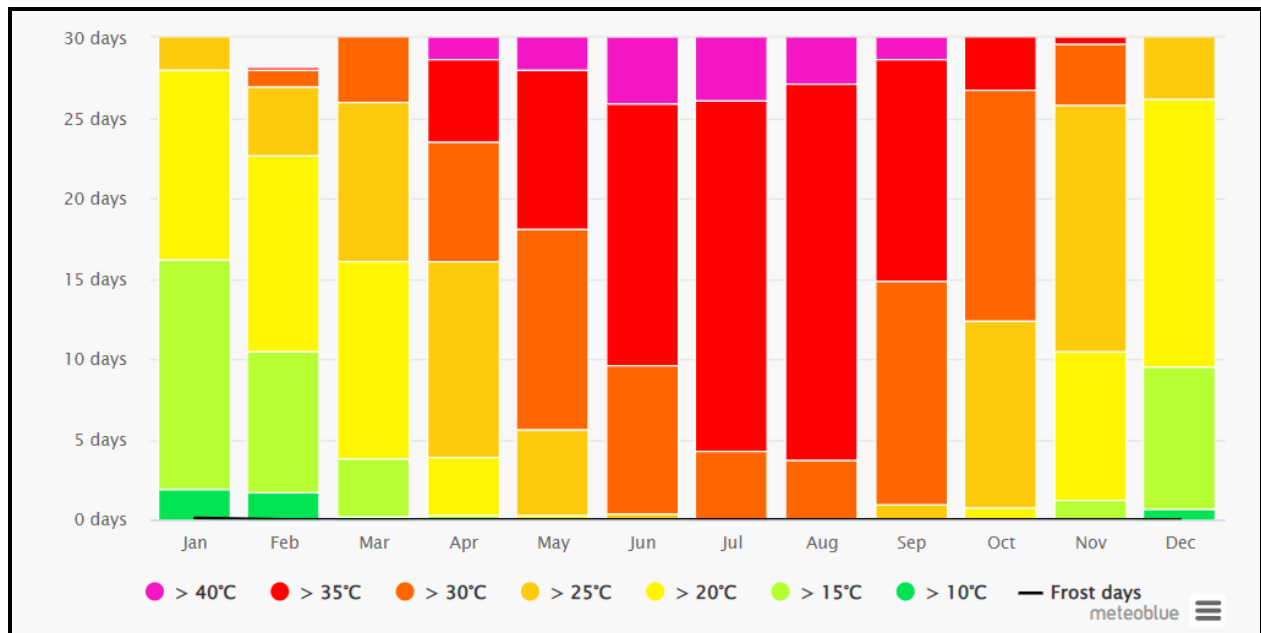

**Figure 4. Monthly Variations of the Maximum Temperature for El-Baragil Area**

Figures (5 & 6) show the monthly variations of the wind speed as well as wind rose for El-Baragil Area (Giza Governorate) respectively.

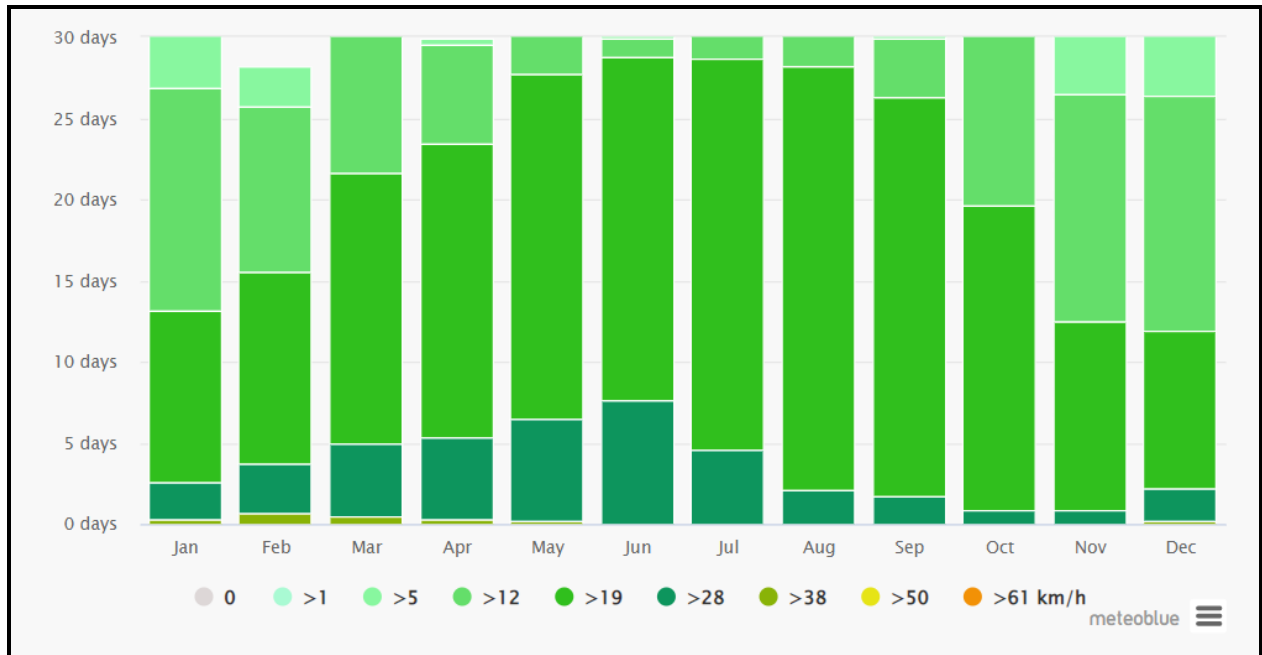


Figure 5. Monthly Variation of the Wind Speed for El-Baragil Area

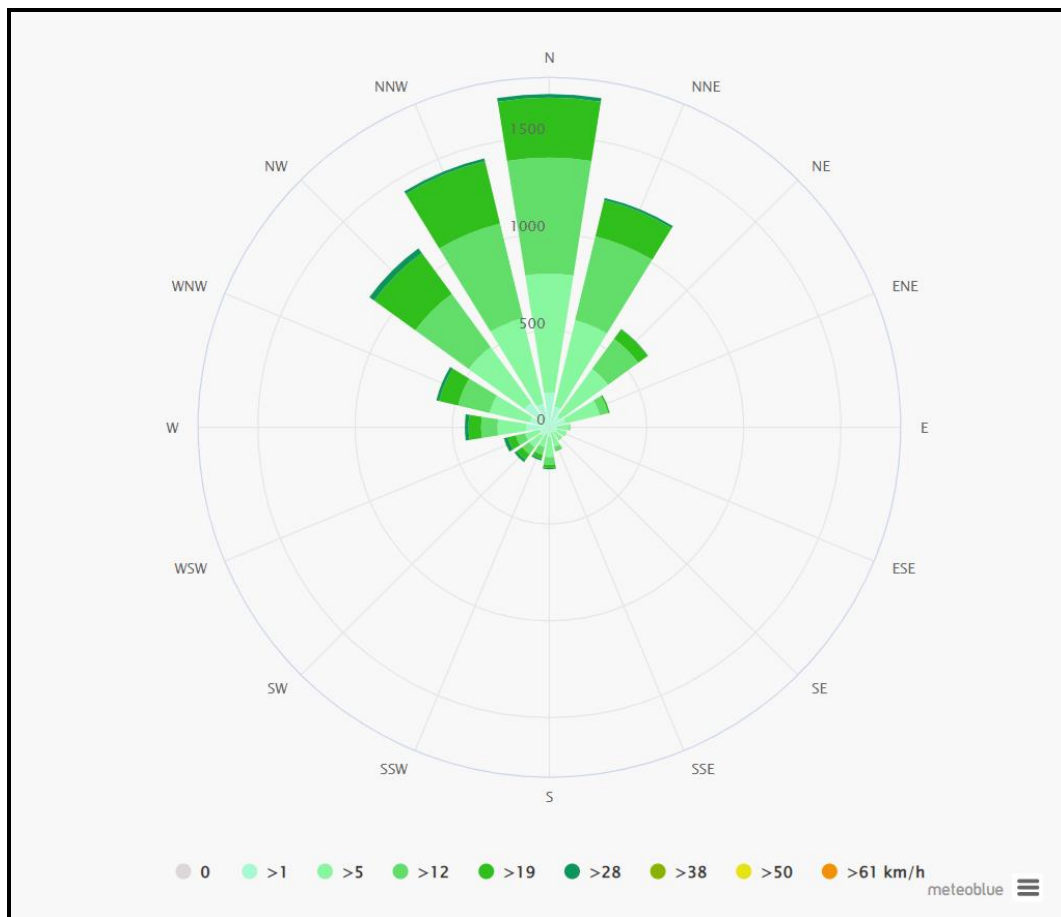


Figure 6. Wind Rose for El-Baragil Area



Figure (7) shows the monthly variations of the sunny, cloudy and precipitation days for El-Baragil Area (Giza Governorate).

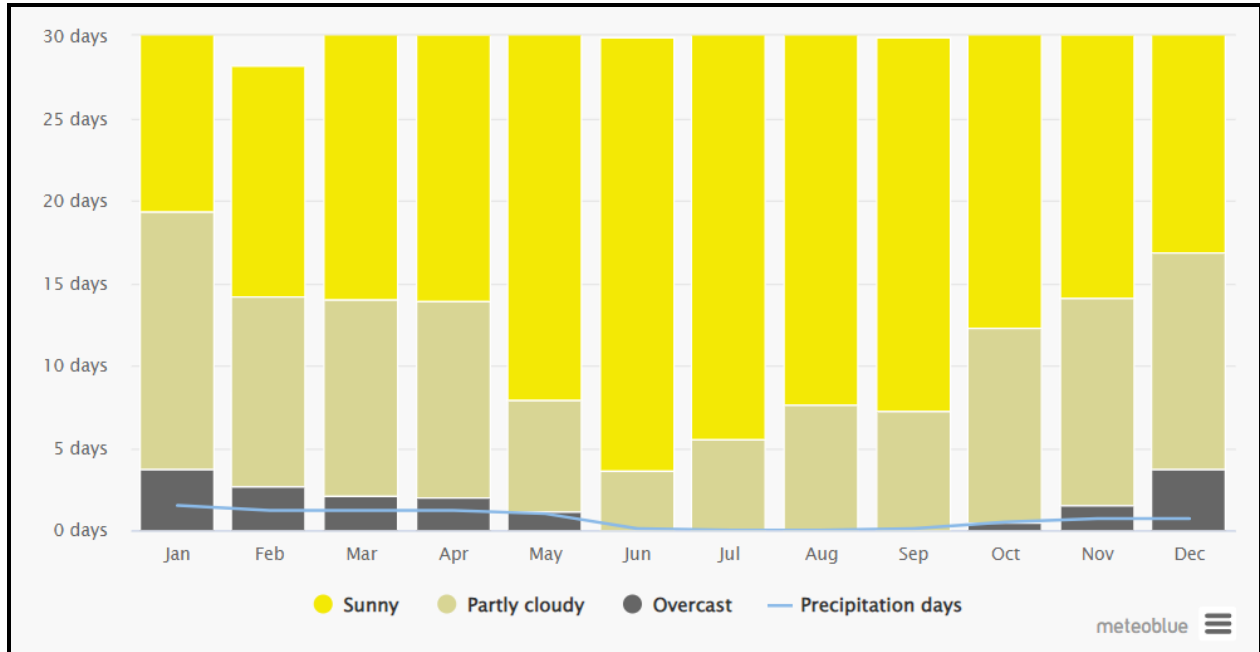


Figure 7. Monthly Variations of the Sunny, Cloudy and Precipitation days for El-Baragil Area



### *-Stability Categories*

The two most significant variables, which would affect the dispersion calculations, are Wind-speed and atmospheric stability. The stability class is a measure of the atmospheric turbulence caused by thermal gradients. Pasqual Stability identifies six main categories, which shown in the Tables (11 & 12) and summarized in Table (13).

*Table 11. Pasqual Stability Categories*

| <b>A</b>      | <b>B</b> | <b>C</b>            | <b>D</b> | <b>E</b>          | <b>F</b> |
|---------------|----------|---------------------|----------|-------------------|----------|
| Very Unstable | Unstable | Moderately Unstable | Neutral  | Moderately Stable | Stable   |

Neutral conditions correspond to a vertical temperature gradient of about 1° C per 100 m.

*Table 12. Relationship between Wind Speed and Stability*

| Wind speed<br>(m/s) | Day-time<br>Solar Radiation |        |        | Night-time<br>Cloud Cover |                |                  |
|---------------------|-----------------------------|--------|--------|---------------------------|----------------|------------------|
|                     | Strong                      | Medium | Slight | Thin<br><3/8              | Medium<br>>3/8 | Overcast<br>>4/5 |
| <2                  | A                           | A-B    | B      | -                         | -              | D                |
| 2-3                 | A-B                         | B      | C      | E                         | F              | D                |
| 3-5                 | B                           | B-C    | C      | D                         | E              | D                |
| 5-6                 | C                           | C-D    | D      | D                         | D              | D                |
| >6                  | C                           | D      | D      | D                         | D              | D                |

*Table 13. Sets of Weather Conditions Selected for Current Study*

| Set for Wind Speed and Stability |           |
|----------------------------------|-----------|
| Wind speed                       | Stability |
| 3.6 m/sec.                       | D         |



## El-Baragil PRMS Description

### Background

El-Baragil Pressure Reduction and Metering Station is Operated by Town Gas Company. It is located at 2.5 km from El-Baragil City Center and 250 m from the South direction of Mehwar Rod El-Farag Road. The PRMS will provide the natural gas to El-Baragil and surrounding area public housing. The PRMS feeding will be from the National Gas Pipeline owned by GASCO and the off-take point is located inside the PRMS premises. The off-take point pressure will be from 20 to 70 bar, later the pressure is reduced to 7 bar at the PRMS facilities following the adding of odorant. As for the last step of the station, the pipeline is connected to the internal distribution network to public housing at El-Baragil and surrounding area.

### The PRMS Location Coordinates (Town Gas Data)

*Table 14. Location Coordinates of PRMS*

| Point | PRMS         |              |
|-------|--------------|--------------|
|       | North (N)    | East (E)     |
| 1     | 30°05'48.35" | 31°09'20.70" |
| 2     | 30°05'44.80" | 31°09'21.06" |
| 3     | 30°05'44.70" | 31°09'20.49" |
| 4     | 30°05'48.24" | 31°09'20.22" |

### PRMS Brief Description and Component list (Town Gas Data)

The PRMS will be surrounded by 3 m height fence and mainly consist of the following:

- Inlet module: which contains 10" pipeline #600 RF isolation inlet manual ball valve.
- Filter module: two identical streams each contain required instrumentation and valves + 1m<sup>3</sup> Condensate tank + one future connections with manual ball valve DN6" #600.
- Heating system module: Inlet and outlet header DN3" #600.
- Metering module: two identical existing each with one inlet manual isolation ball valve DN4" #600 + one future connection DN4" #600.
- Regulating module: two identical regulating lines existing each with one



inlet manual isolation ball valve DN4" #600 + one future connection DN4" #600 to WBH.

- Outlet module: contains DN10" #600 butterfly valve/ manual ball valve.
- Odorant module: 600 lit. capacity bulk tank / 50 lit. daily usage
- Off-take point from up-ground room surrounded by 1 m height brick wall fence containing connection pipes and isolation valves with GASCO underground pipeline 24", connected to 10" PRMS feeding pipeline.
- Security Office (one floor)
- Administration office (C.R.) (one floor)
- Firefighting Facilities (Fire Water Tank / Pumps / Fire water Network / Powder Fire Extinguishers)

### El-Baragil PRMS Units (Town Gas Data)

*Table 15. El-Baragil PRMS Units*

| No | PRMS Units                       | Capacity   | Size         |
|----|----------------------------------|------------|--------------|
| 1  | <b><i>Inlet unit</i></b>         |            |              |
|    | Inlet valve                      | 20000 scmh | 10"          |
|    | Inlet valve bypass (ball + plug) |            | 3"           |
| 2  | <b><i>Filter units</i></b>       |            |              |
|    | Line F1                          | 10000 scmh | 6" * 4"      |
|    | Line F2                          | 10000 scmh | 6" * 4"      |
|    | Line F3(only two valves)         | 10000 scmh | 6" * 4"      |
|    | Line F3(only blind flange)       | -----      | ---          |
|    | Line F4 (only blind flange)      | -----      | ---          |
| 3  | <b><i>Meter unit</i></b>         |            |              |
|    | Line M1                          | 10000 scmh | 4" * 6" * 4" |
|    | Line M2                          | 10000 scmh | 4" * 6" * 4" |
|    | Line M3(only two valves)         | 10000 scmh | 4" * 4"      |
|    | Line M3 (only blind flange)      | -----      | ---          |
|    | Line M4 (only blind flange)      | -----      | ---          |





|    |   |            |         |
|----|---|------------|---------|
|    | One extension ball valve on outlet header (future heater) | -----      | ---     |
|    | One ball valve full bore for heater bypass                | -----      | ---     |
| 4  | <b>Heater unit</b>  |            |         |
|    | Line H1 (150 kw)  | 10000 scmh | 3"      |
|    | Heater bypass Line  | 20000 scmh | 6"      |
|    | Line H2 (only two valves)                                 | 10000 scmh | 3"      |
| 5  | <b>Regulator unit</b>                                     |            |         |
|    | Line R1   | 10000 scmh | 4" * 6" |
|    | Line R2   | 10000 scmh | 4" * 6" |
|    | Line R3(only two valves)                                  | 10000 scmh | 4" * 6" |
|    | Line R3(only blind flange)                                | -----      | ---     |
|    | Line R4(only blind flange)                                | -----      | ---     |
|    | One extension ball valve on inlet header (future heater)  | -----      | ---     |
| 6  | <b>Odorant unit</b>                                       |            |         |
|    | Electrical pumps  | -----      |         |
|    | Lapping system  | -----      |         |
| 7  | <b>Outlet unit</b>  |            |         |
|    | Outlet valve  | 20000 scmh | 10"     |
|    | Extension valve (future)                                  | -----      | -----   |
| 8  | <b>Monitoring and Control unit</b>                        |            |         |
| 9  | <b>Generator (15 KVA)</b>                                 |            |         |
| 10 | <b>UPS</b>  |            |         |

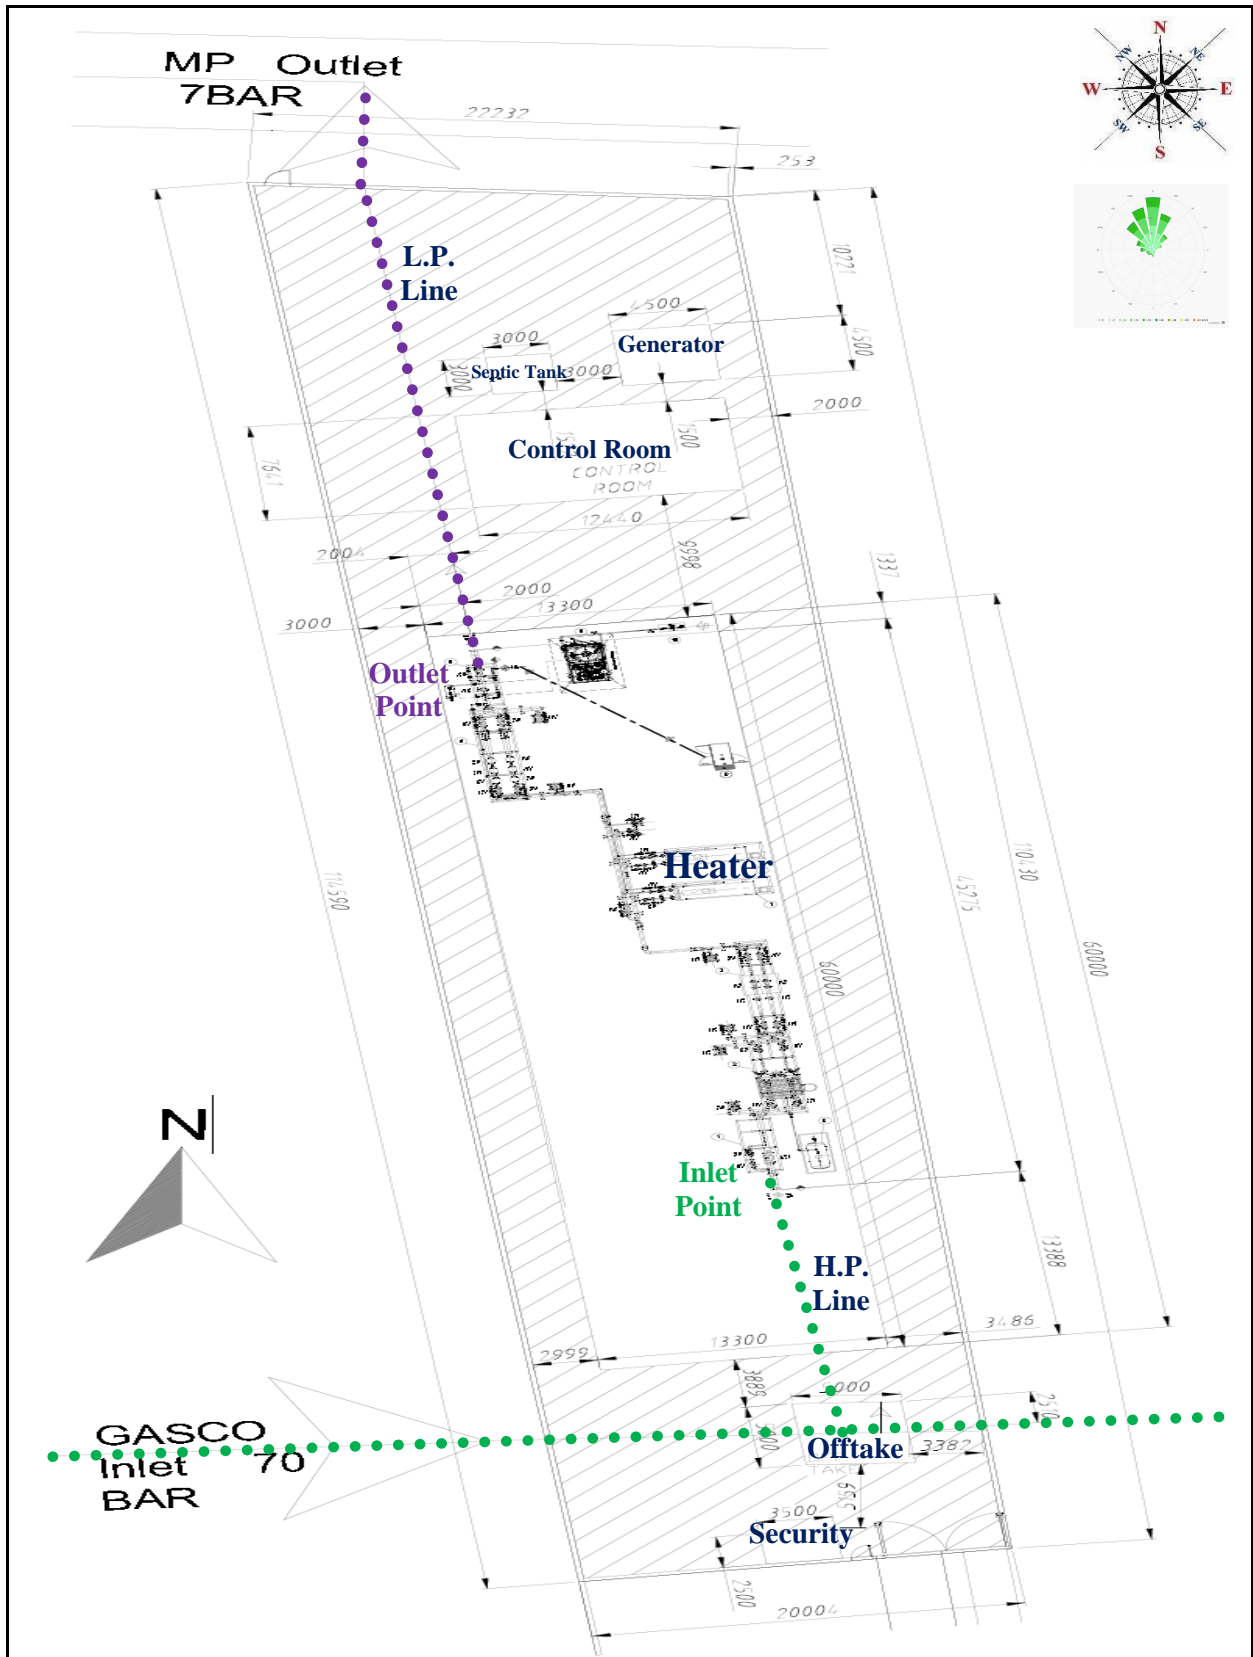


Figure 8. El-Baragil PRMS Layout



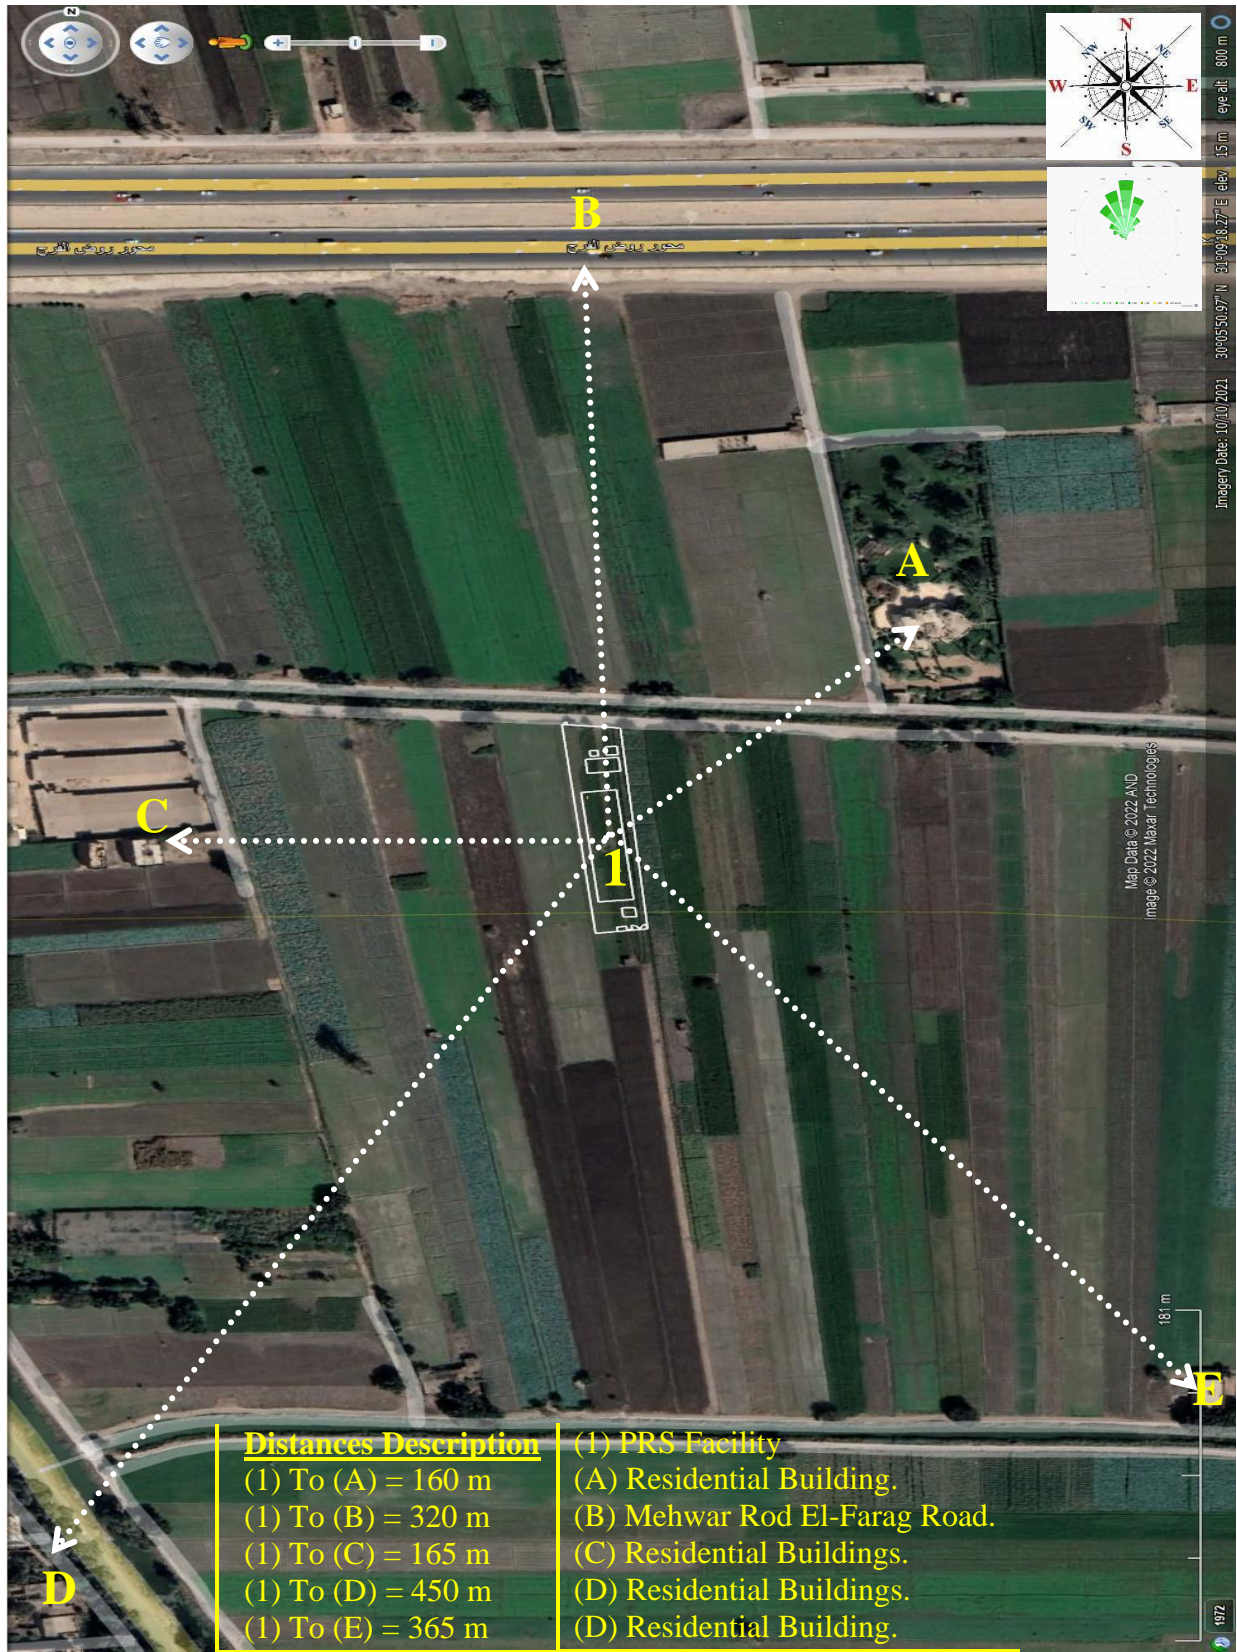


Figure 10. El-Baragil PRMS and Surroundings Plotted on Google Earth Photo



## Process Condition Data (Town Gas Company Data)

The following *Table 15*. describes the process conditions for El-Baragil PRMS:

*Table 16. Process Conditions / Gas Components and Specifications*

| Process Conditions              |                 |
|---------------------------------|-----------------|
| Maximum flow rate scm / hr      | 20,000          |
| future flow rate scm / hr       | 40,000          |
| Design pressure bar g           | 70              |
| Min / Max inlet pressure bar g  | 70/20           |
| Min / Max outlet pressure bar g | 7               |
| Min / Max inlet temperature °C  | 15 – 25         |
| Outlet temperature °C           | Not less than 1 |

| Gas Components        |               |
|-----------------------|---------------|
| Gas composition % Mol |               |
| Water                 | 0             |
| H <sub>2</sub> S      | 4 ppm         |
| Nitrogen              | 0.2 - 0.83    |
| Carbon Dioxide        | 0.07 - 3      |
| Methane               | 77.73 - 99.82 |
| Ethane                | 0.03 - 15.68  |
| Propane               | 0.01 - 4.39   |
| I-Butane              | 0.0 - 1.14    |
| N-Butane              | 0.0 - 1.01    |
| I-Pentane             | 0.0 - 0.19    |
| N-Butane              | 0.0 - 0.26    |
| C6+                   | 0.0 - 0.25    |

| Gas Specifications |            |
|--------------------|------------|
| Specific gravity   | 0.5 - 0.69 |



## Gas Odorant Specifications

The odorant supplied with a Hazard Data Sheet and identified as Spotleak 1009. Spotleak is an aliphatic mixture in clear liquid form that is extremely flammable, with the following characteristics:

- |                                  |                 |
|----------------------------------|-----------------|
| - Boiling Range                  | 60-70° C        |
| - Flash Point                    | -17.8° C        |
| - Freezing Point                 | -45.5° C        |
| - Density (H <sub>2</sub> O = 1) | 0.812 @ 15.5° C |
| - Vapor Density                  | 3.0 (air = 1)   |
| - Vapor Pressure (mm Hg)         | 6.6 @ 37.8° C   |

### Health Hazards

Spotleak is not carcinogenic, but the major health hazards as a result of exposure to Spotleak include the following:

#### Inhalation

- Short-term exposure: Irritation and central nervous system effects
- Long-term exposure: Irritation

#### Skin Contact

- Short-term: Irritation
- Long-term: Dermatitis

#### Eye Contact

- Short-term: Irritation and tearing
- Long-term: Irritation

#### Ingestion

- Short-term: nausea, vomiting, central nervous system effects
- Long-term: no effects are known

### Hygiene Standards and Limits

PEL: 10 PPM according to OSHA, TWA (NIOSH): 0.5 ppm not to be exceeded during any 15 minute work period. "Refer to Annex 5 of PRS ESIA"

### Fire and Explosion Hazards

Spotleak is a severe fire hazard. Vapor/air mixtures are explosive. Vapor is 3 times heavier than air. Vapor may ignite at distant ignition sources and flash back.

Thermal decomposition products include oxides of sulphur and hydrogen sulphide.



## **Fire Fighting and Protection Systems and Facilities**

The PRMS will be provided by the following fire protection facilities:

- Firewater tank with a capacity of 40 cubic meters.
- Firewater pumps (1 Electrical & 1 Diesel with capacity of 250 gpm each) + one Jockey pump.
- Firewater main with a diameter of 4 inch.
- Four Firewater hydrants (each with a diameter of 3 inch)
- Firewater monitors.
- Smoke detectors in control rooms according to the area.
- Different sizes of fire extinguishers will be distributed at PRMS site.

## **Emergency Response Plan "ERP"**

There is a general Emergency Response Plan "ERP" for Town Gas PRMS, including the following items:

- Calling Plan
- Emergency Cases and Scenarios at Main PRSs
- Emergency Procedures in case of Significant Risks
- Emergency Procedures in case of Normal Risks
- Possible causes of these scenarios and their precaution procedures



## Analytical Results of Consequence Modeling

### 1.0. Pressure Reduction Station Inlet Pipeline (10 inch)

#### 1/1- Consequence Modeling for 1 inch (Pin Hole) Gas Release

The following table no. (16) Shows that:


*Table 17. Dispersion Modeling for Inlet - 1" / 10" Gas Release*

| Gas Release (Inlet / PRV "High Pressure") |                     |              |            |                 |
|---|---------------------|--------------|------------|-----------------|
| Wind Category                             | Flammability Limits | Distance (m) | Height (m) | Cloud Width (m) |
| 3.6 D                                     | UFL                 | 2.2          | 1.1        | 0.2 @ 1.5 m     |
|   | LFL                 | 6.8          | 1.32       | 0.64 @ 4.4 m    |
|   | 50 % LFL            | 13.5         | 1.65       | 1.3 @ 8 m       |


| Jet Fire      |                  |                                     |                       |                        |                     |
|---------------|------------------|-------------------------------------|-----------------------|------------------------|---------------------|
| Wind Category | Flame Length (m) | Heat Radiation (kW/m <sup>2</sup> ) | Distance Downwind (m) | Distance Crosswind (m) | Lethality Level (%) |
| 3.6 D         | 12.5             | 1.6                                 | 20.2                  | 17.8                   | 0                   |
|               |                  | 4                                   | 17.1                  | 9.3                    | 0                   |
|               |                  | 9.5                                 | 15.1                  | 5.8                    | 0                   |
|               |                  | 12.5                                | 14.6                  | 4.8                    | 20% /60 sec.        |
|               |                  | 25                                  | 13.5                  | 2.9                    | 80.34               |
|               |                  | 37.5                                | 12.8                  | 1.9                    | 98.74               |

| Unconfined Vapor Cloud Explosion - UVCE (Open Air) |                      |                                    |                                    |  |
|--|----------------------|------------------------------------|------------------------------------|--|
| Wind Category                                      | Pressure Value (bar) | Overpressure Worst-Case Radius (m) | Overpressure Waves Effect / Damage |  |
| 3.6 D  | 0.020                | 23.7                               | 0.021 bar                          | Probability of serious damage beyond this point = 0.05 - 10 % glass broken |
|  | 0.137                | 13.5                               | 0.137 bar                          | Some severe injuries, death unlikely                                       |
|  | 0.206                | 12.7                               | 0.206 bar                          | Steel frame buildings distorted / pulled from foundation                   |




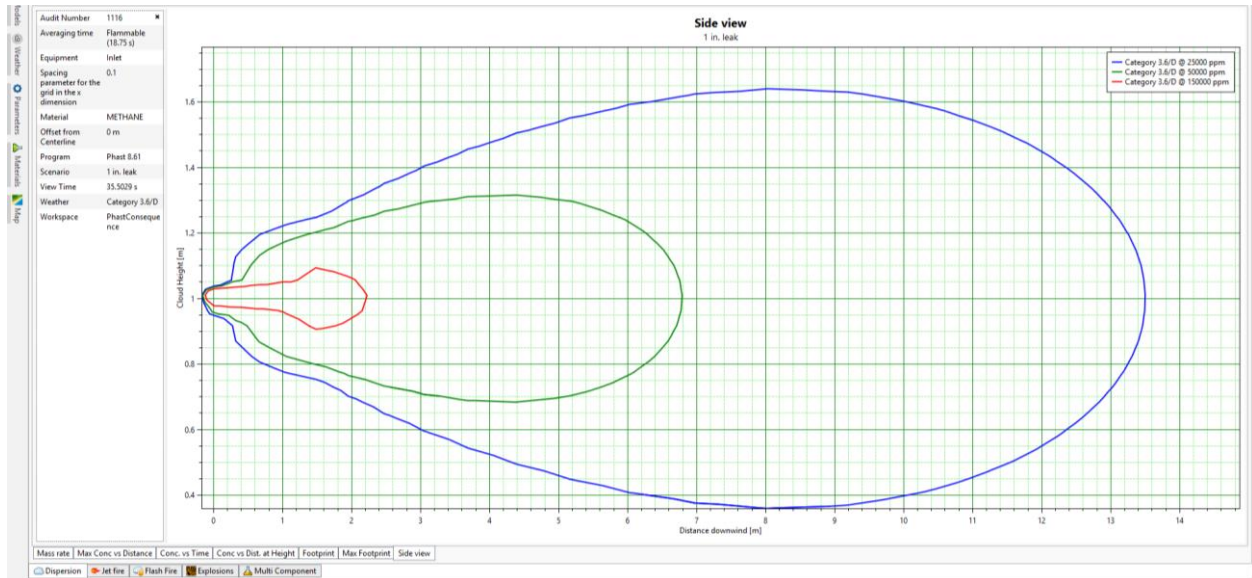

**Figure 11. Gas Cloud Side View (UFL/LFL) (1" hole in 10" Inlet Pipeline)**

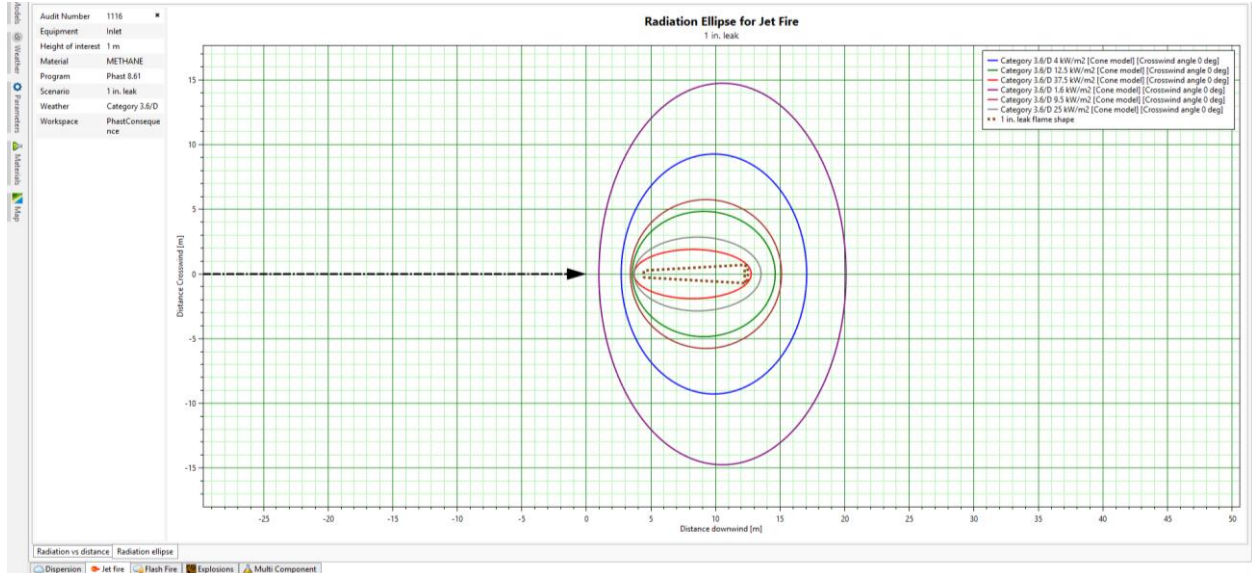

**Figure 12. Heat Radiation Contours from Jet Fire (1" hole in 10" Inlet Pipeline)**

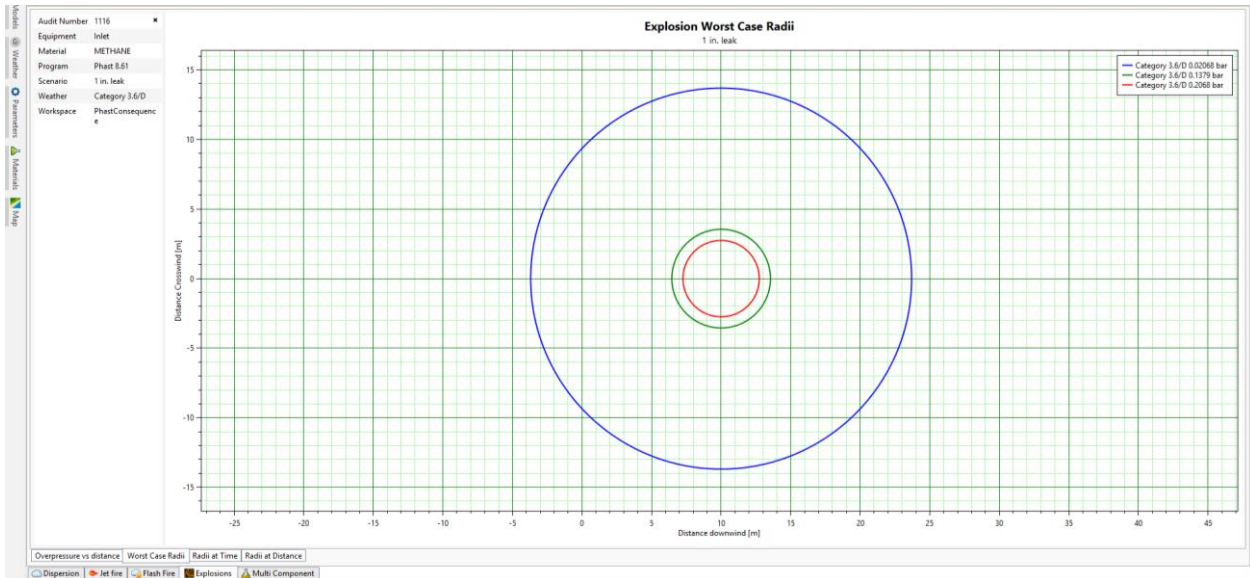

*Figure 13. Worst-Case Explosion Overpressure Waves (1" hole in 10" Inlet Pipeline)*



### 1/2- Consequence Modeling for 4 inch (Half Rup.) Gas Release


The following table no. (17) Shows that:

*Table 18. Dispersion Modeling for Inlet - 4" / 10" Gas Release*


| Gas Release (Inlet / PRV "High Pressure") |                     |              |            |                 |
|---|---------------------|--------------|------------|-----------------|
| Wind Category                             | Flammability Limits | Distance (m) | Height (m) | Cloud Width (m) |
| 3.6 D                                     | UFL                 | 12.7         | 1.6        | 1.7 @ 7 m       |
|   | LFL                 | 49.3         | 0 – 3.3    | 3.3 @ 30 m      |
|   | 50 % LFL            | 75.7         | 0 – 4.9    | 4.9 @ 37 m      |

| Jet Fire      |                  |                                     |                       |                        |                     |
|---------------|------------------|-------------------------------------|-----------------------|------------------------|---------------------|
| Wind Category | Flame Length (m) | Heat Radiation (kW/m <sup>2</sup> ) | Distance Downwind (m) | Distance Crosswind (m) | Lethality Level (%) |
| 3.6 D         | 57               | 1.6                                 | 136                   | 113.1                  | 0                   |
|               |                  | 4                                   | 104.8                 | 72.6                   | 0                   |
|               |                  | 9.5                                 | 85.6                  | 47.4                   | 0                   |
|               |                  | 12.5                                | 80.9                  | 41.2                   | 20% /60 sec.        |
|               |                  | 25                                  | 70.9                  | 28.3                   | 80.34               |
|               |                  | 37.5                                | 65.7                  | 22.1                   | 98.74               |


| Unconfined Vapor Cloud Explosion - UVCE (Open Air) |                      |                                    |                                    |   |
|--|----------------------|------------------------------------|------------------------------------|---|
| Wind Category                                      | Pressure Value (bar) | Overpressure Worst-Case Radius (m) | Overpressure Waves Effect / Damage |   |
| 3.6 D  | 0.020                | 137.7                              | 0.021 bar                          | <i>Probability of serious damage beyond this point = 0.05 - 10 % glass broken</i> |
|  | 0.137                | 75.8                               | 0.137 bar                          | <i>Some severe injuries, death unlikely</i>                                       |
|  | 0.206                | 73.7                               | 0.206 bar                          | <i>Steel frame buildings distorted / pulled from foundation</i>                   |

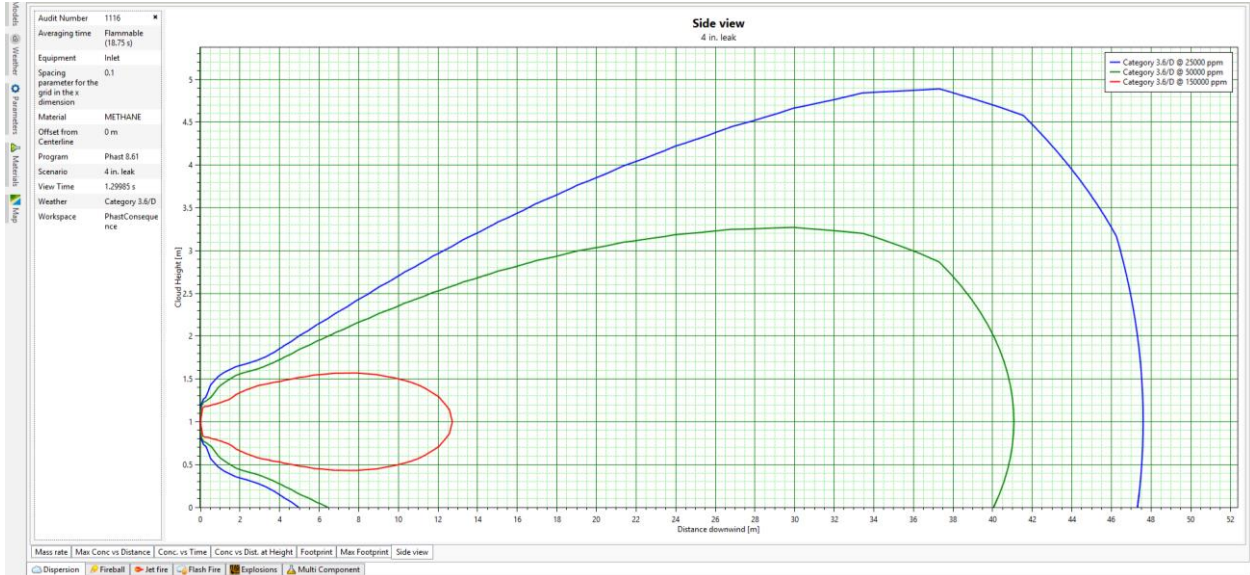

*Figure 13. Gas Cloud Side View (UFL/LFL) (4" hole in 10" Inlet Pipeline)*

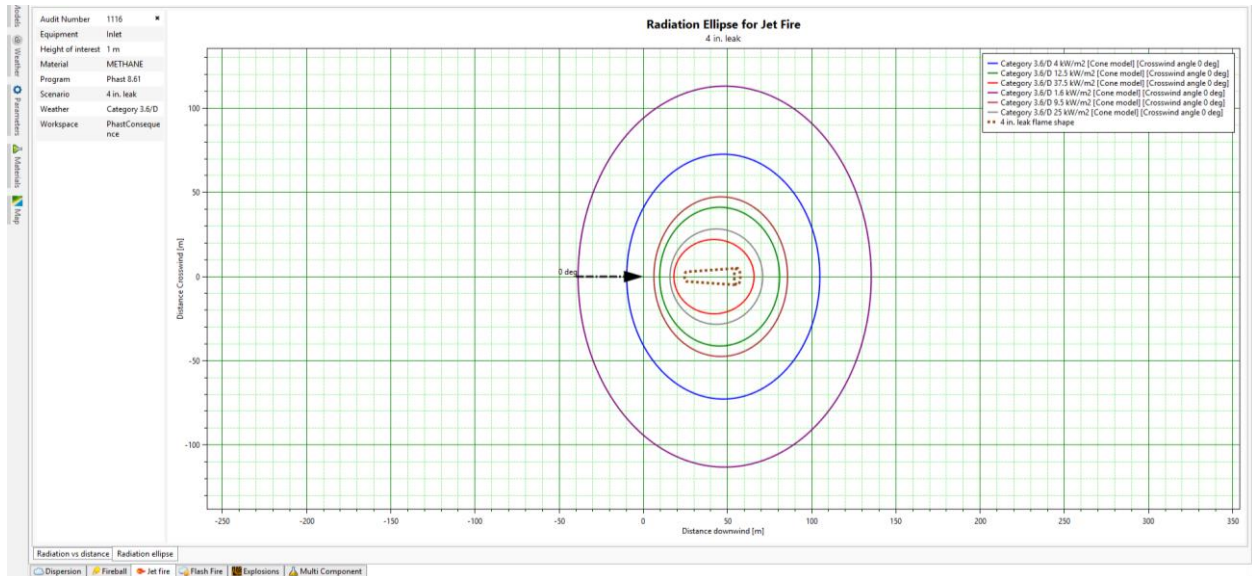

**Figure 14. Heat Radiation Contours from Jet Fire (4" hole in 10" Inlet Pipeline)**

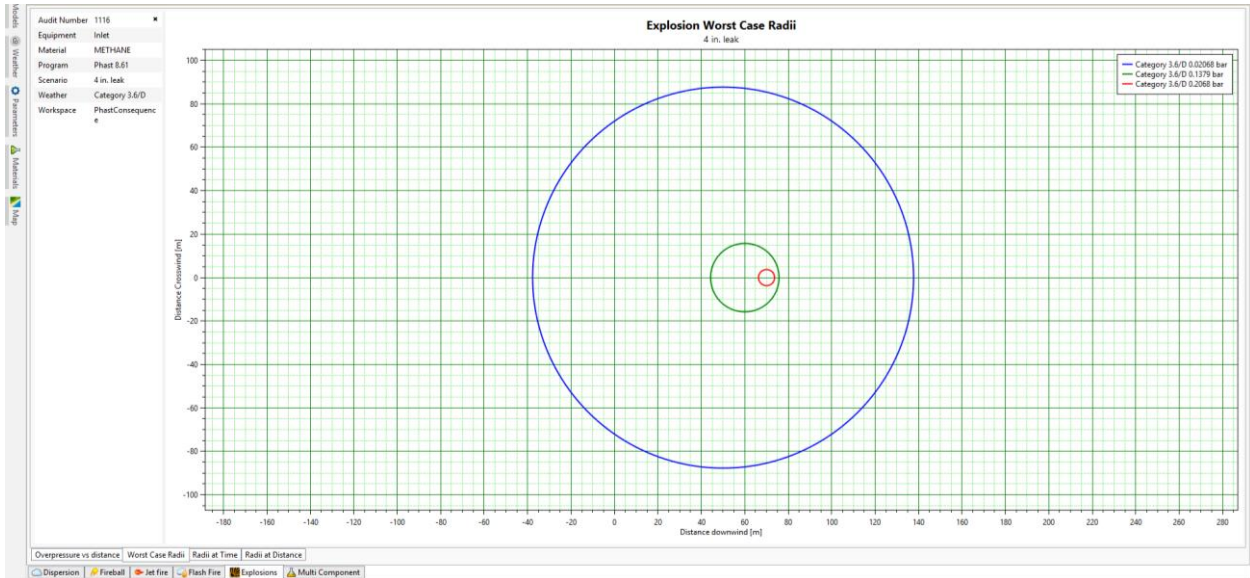

*Figure 15. Worst-Case Explosion Overpressure Waves (4" hole in 10" Inlet Pipeline)*




### 1/3- Consequence Modeling for 10 inch (Full Rupture) Gas Release

The following table no. (18) Shows that:



*Table 19. Dispersion Modeling for Inlet - 10" Gas Release*

| Gas Release  |                      |                                     |                                    |   |                     |
|--|----------------------|-------------------------------------|------------------------------------|---|---------------------|
| Wind Category                                      | Flammability Limits  | Distance (m)                        | Height (m)                         | Cloud Width (m)   |                     |
| 3.6 D  | UFL                  | 20.3                                | 1.9                                | 1.8 @ 12 m  |                     |
|  | LFL                  | 64.9                                | 0 – 3.3                            | 3.3 @ 18.5 m  |                     |
|  | 50 % LFL             | 92.2                                | 0 – 4.1                            | 4.1 @ 20.75 m   |                     |
| Jet Fire   |                      |                                     |                                    |   |                     |
| Wind Category                                      | Flame Length (m)     | Heat Radiation (kW/m <sup>2</sup> ) | Distance Downwind (m)              | Distance Crosswind (m)  | Lethality Level (%) |
| 3.6 D  | 133.8                | 1.6                                 | 373.7                              | 287.6   | 0                   |
|  |                      | 4                                   | 279.8                              | 186.8   | 0                   |
|  |                      | 9.5                                 | 220.2                              | 123.1   | 0                   |
|  |                      | 12.5                                | 205.3                              | 107.4   | 20 %/60 sec.        |
|  |                      | 25                                  | 173.3                              | 74.6  | 80.34               |
|  |                      | 37.5                                | 156.3                              | 58.9  | 98.74               |
| Unconfined Vapor Cloud Explosion - UVCE (Open Air) |                      |                                     |                                    |   |                     |
| Wind Category                                      | Pressure Value (bar) | Overpressure Worst-Case Radius (m)  | Overpressure Waves Effect / Damage |   |                     |
| 3.3 D  | 0.020                | 175                                 | 0.021 bar                          | <i>Probability of serious damage beyond this point = 0.05 - 10 % glass broken</i> |                     |
|  | 0.137                | 102.3                               | 0.137 bar                          | <i>Some severe injuries, death unlikely</i>                                       |                     |
|  | 0.206                | 97.2                                | 0.206 bar                          | <i>Steel frame buildings distorted / pulled from foundation</i>                   |                     |





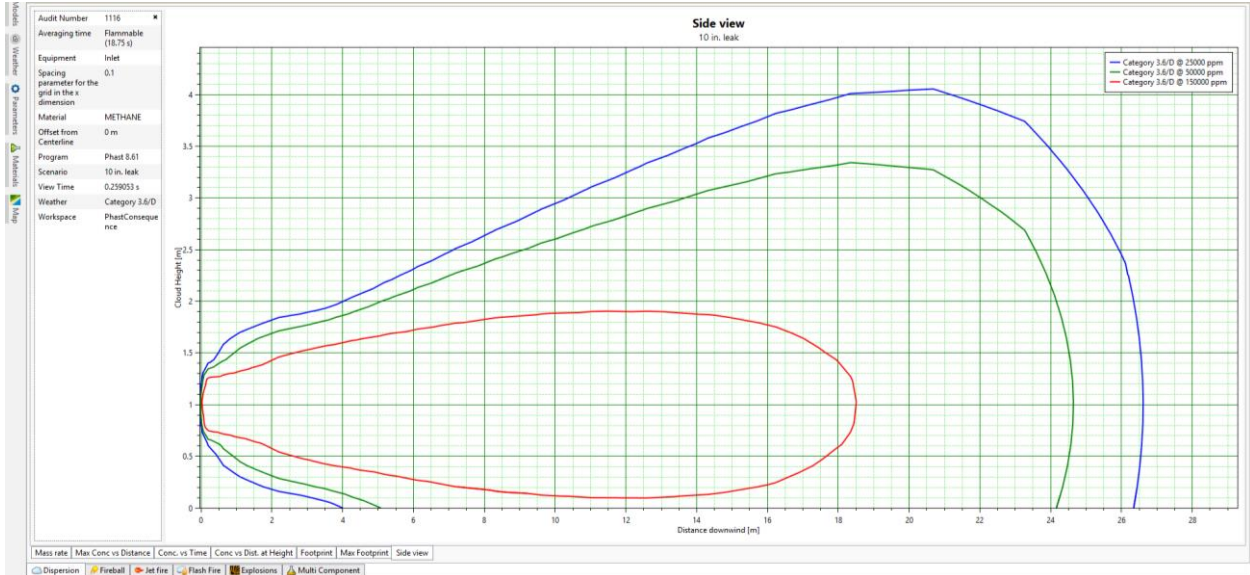

**Figure 16. Gas Cloud Side View (UFL/LFL) (10" Inlet Pipeline Full Rupture)**

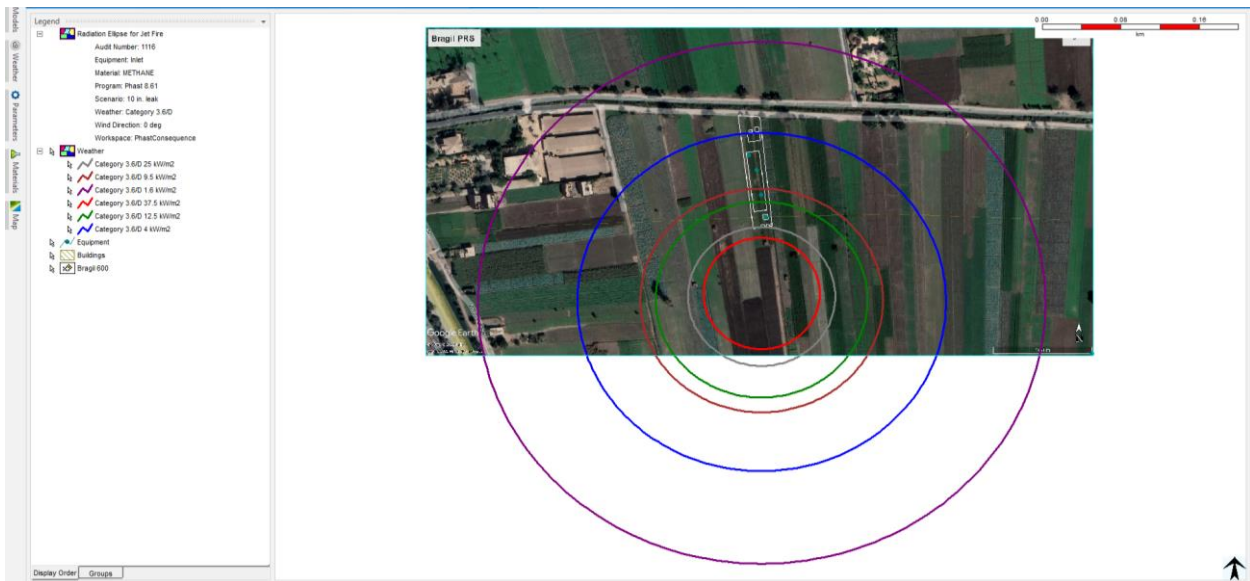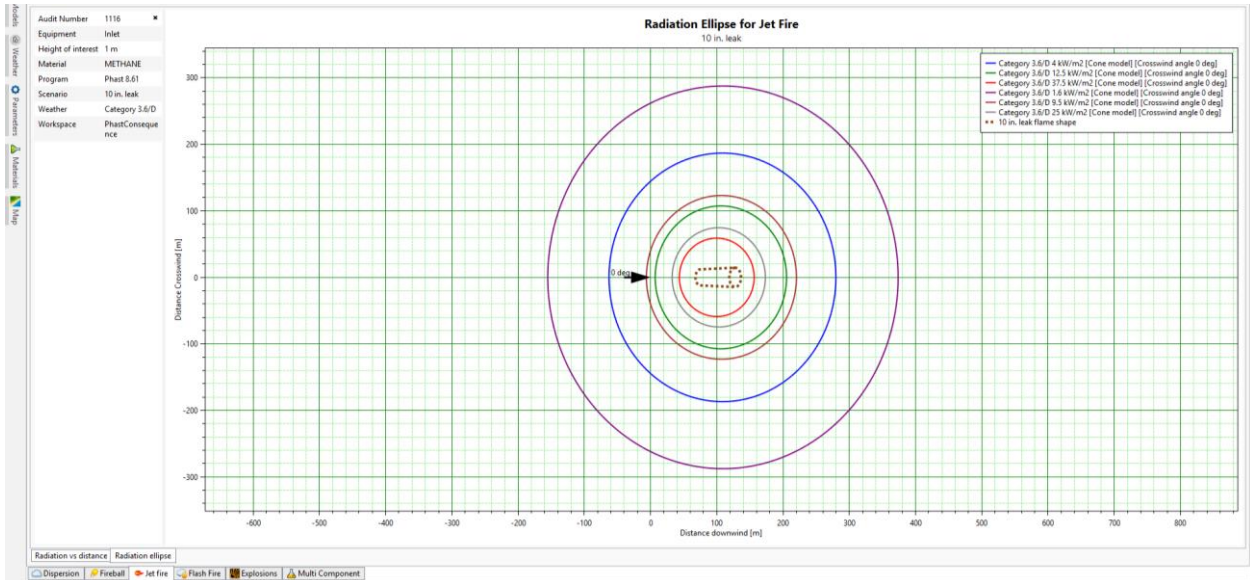

**Figure 17. Heat Radiation Contours from Jet Fire (10" Inlet Pipeline Full Rupture)**

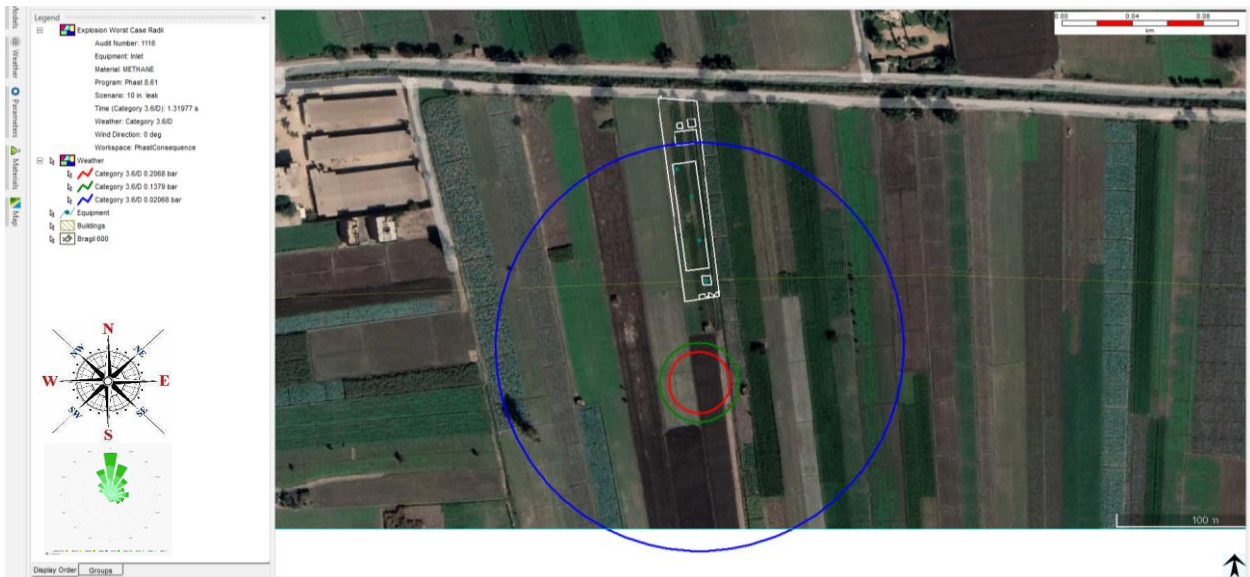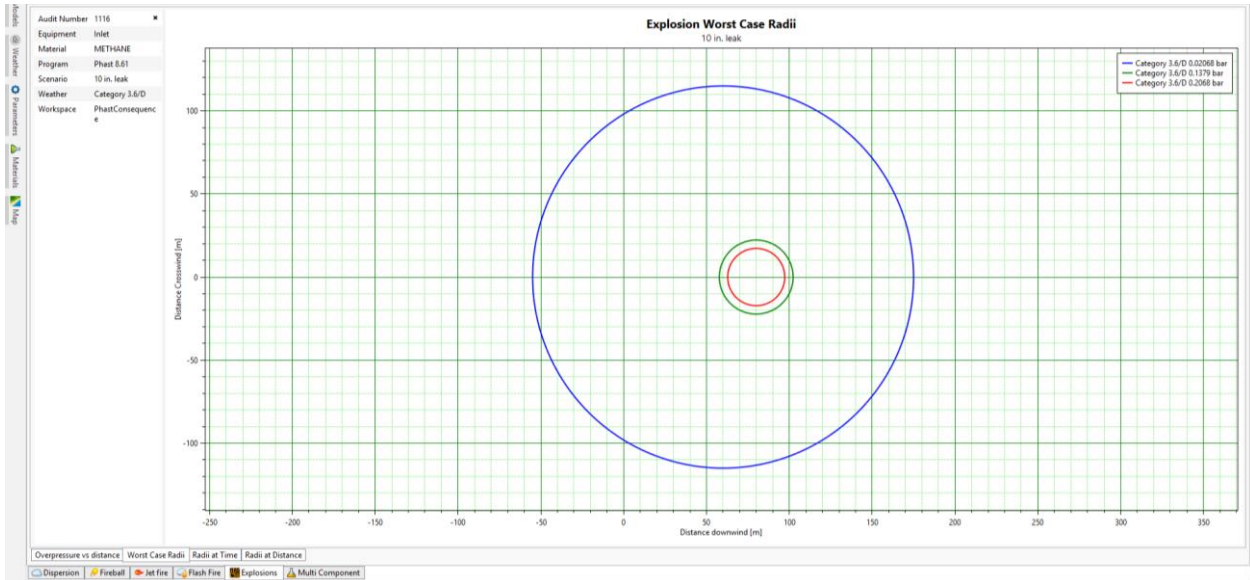

**Figure 18. Worst-Case Explosion Overpressure Waves (10" Inlet Pipeline Full Rupture)**



## 2.0. Pressure Reduction Station Outlet Pipeline (10 inch)

### 2/1- Consequence Modeling for 1 inch (Pin Hole) Gas Release


The following table no. (19) Shows that:

*Table 20. Dispersion Modeling for Outlet - 1" / 10" Gas Release*



| Gas Release (Outlet / PRV "Low Pressure") |                     |              |            |                 |
|---|---------------------|--------------|------------|-----------------|
| Wind Category                             | Flammability Limits | Distance (m) | Height (m) | Cloud Width (m) |
| 3.6 D                                     | UFL                 | 1.1          | 1.03       | 0.06 @ 0.9 m    |
|   | LFL                 | 3.2          | 1.15       | 0.3 @ 1.95 m    |
|   | 50 % LFL            | 5.6          | 1.3        | 0.6 @ 3.7 m     |

| Jet Fire      |                  |                                     |                       |                        |                     |
|---------------|------------------|-------------------------------------|-----------------------|------------------------|---------------------|
| Wind Category | Flame Length (m) | Heat Radiation (kW/m <sup>2</sup> ) | Distance Downwind (m) | Distance Crosswind (m) | Lethality Level (%) |
| 3.6 D         | 6                | 1.6                                 | 8.1                   | 4.6                    | 0                   |
|               |                  | 4                                   | 7.2                   | 2.7                    | 0                   |
|               |                  | 9.5                                 | 6.6                   | 1.4                    | 0                   |
|               |                  | 12.5                                | 6.4                   | 1.1                    | 20% /60 sec.        |
|               |                  | 25                                  | 5.9                   | 0.5                    | 80.34               |
|               |                  | 37.5                                | 5.2                   | 0.2                    | 98.74               |

| Unconfined Vapor Cloud Explosion - UVCE (Open Air) |                      |                                    |                                    |  |
|--|----------------------|------------------------------------|------------------------------------|--|
| Wind Category                                      | Pressure Value (bar) | Overpressure Worst-Case Radius (m) | Overpressure Waves Effect / Damage |  |
| 3.6 D  | 0.020                | N/D                                | 0.021 bar                          | Probability of serious damage beyond this point = 0.05 - 10 % glass broken |
|  | 0.137                | N/D                                | 0.137 bar                          | Some severe injuries, death unlikely                                       |
|  | 0.206                | N/D                                | 0.206 bar                          | Steel frame buildings distorted / pulled from foundation                   |

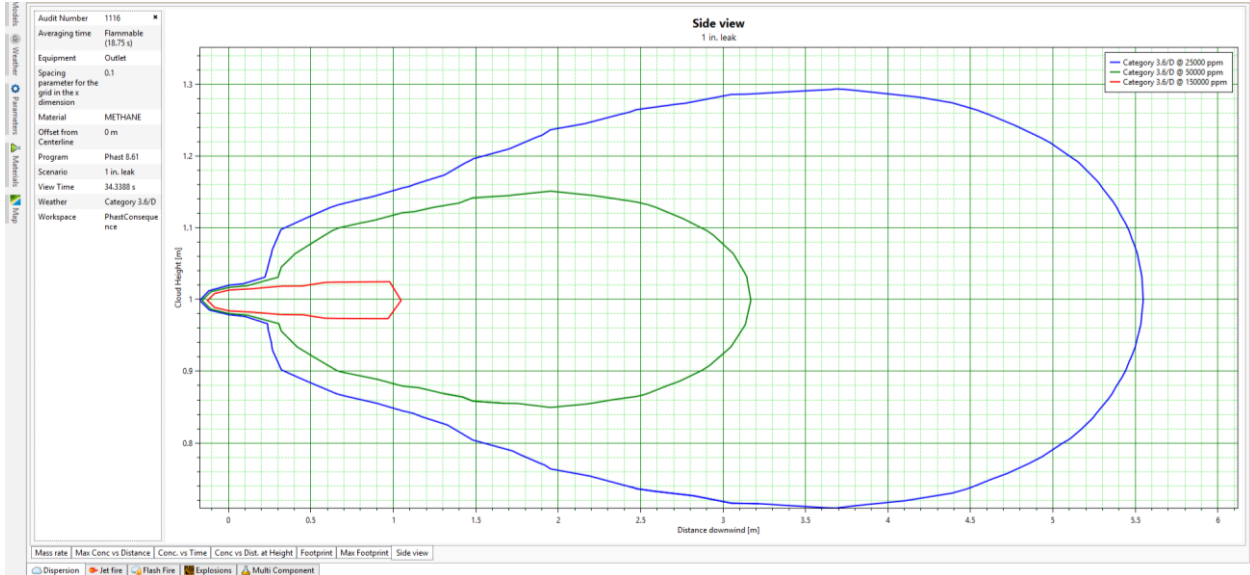

*Figure 19. Gas Cloud Side View (UFL/LFL) (1" hole in 10" Outlet Pipeline)*

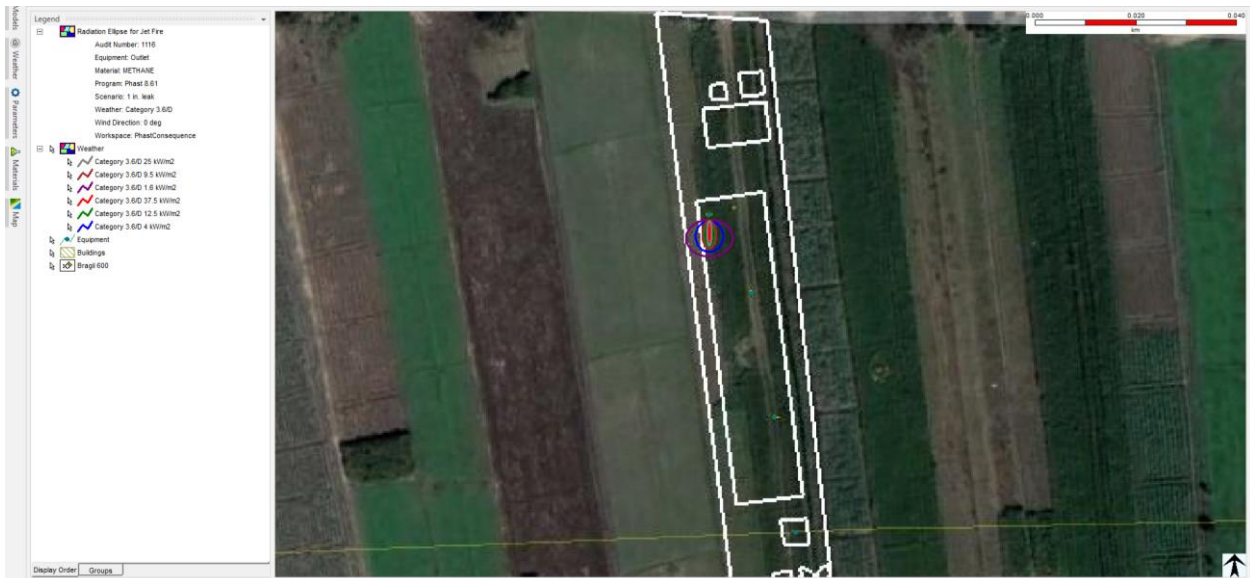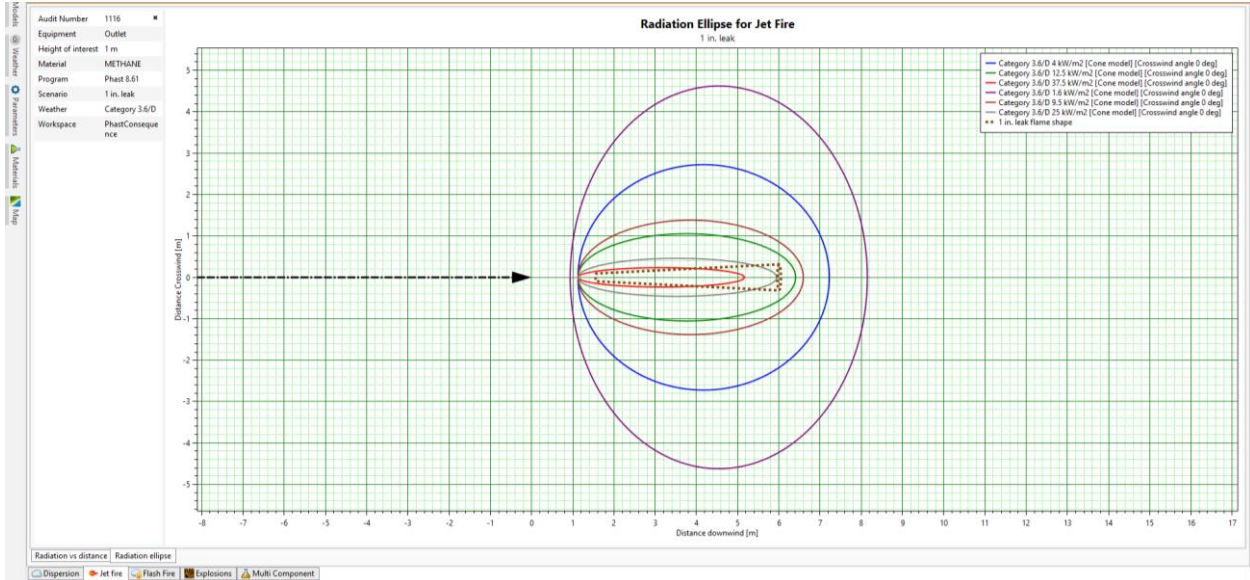

**Figure 20. Heat Radiation Contours from Jet Fire (1" hole in 10" Outlet Pipeline)**



## 2/2- Consequence Modeling for 4 inch (Half Rup.) Gas Release

The following table no. (20) Shows that:

*Table 21. Dispersion Modeling for Outlet - 4" / 10" Gas Release*


| Gas Release   |                     |              |            |                 |
|---------------|---------------------|--------------|------------|-----------------|
| Wind Category | Flammability Limits | Distance (m) | Height (m) | Cloud Width (m) |
| 3.6 D         | UFL                 | 5.1          | 1.25       | 0.5 @ 3 m       |
|               | LFL                 | 18.1         | 1.8        | 1.6 @ 11 m      |
|               | 50 % LFL            | 36.1         | 0 – 2.75   | 2.75 @ 20 m     |

| Jet Fire      |                  |                                     |                       |                        |                     |
|---------------|------------------|-------------------------------------|-----------------------|------------------------|---------------------|
| Wind Category | Flame Length (m) | Heat Radiation (kW/m <sup>2</sup> ) | Distance Downwind (m) | Distance Crosswind (m) | Lethality Level (%) |
| 3.6 D         | 26.8             | 1.6                                 | 54.7                  | 44.5                   | 0                   |
|               |                  | 4                                   | 43.1                  | 28.3                   | 0                   |
|               |                  | 9.5                                 | 36.5                  | 18.2                   | 0                   |
|               |                  | 12.5                                | 34.8                  | 15.7                   | 20% /60 sec.        |
|               |                  | 25                                  | 31.2                  | 10.3                   | 80.34               |
|               |                  | 37.5                                | 29.3                  | 7.6                    | 98.74               |


  

| Unconfined Vapor Cloud Explosion - UVCE (Open Air) |                      |                                    |                                    |  |
|--|----------------------|------------------------------------|------------------------------------|--|
| Wind Category                                      | Pressure Value (bar) | Overpressure Worst-Case Radius (m) | Overpressure Waves Effect / Damage |  |
| 3.6 D  | 0.020                | 54.8                               | 0.021 bar                          | Probability of serious damage beyond this point = 0.05 - 10 % glass broken |
|  | 0.137                | 34.4                               | 0.137 bar                          | Some severe injuries, death unlikely                                       |
|  | 0.206                | 33.4                               | 0.206 bar                          | Steel frame buildings distorted / pulled from foundation                   |

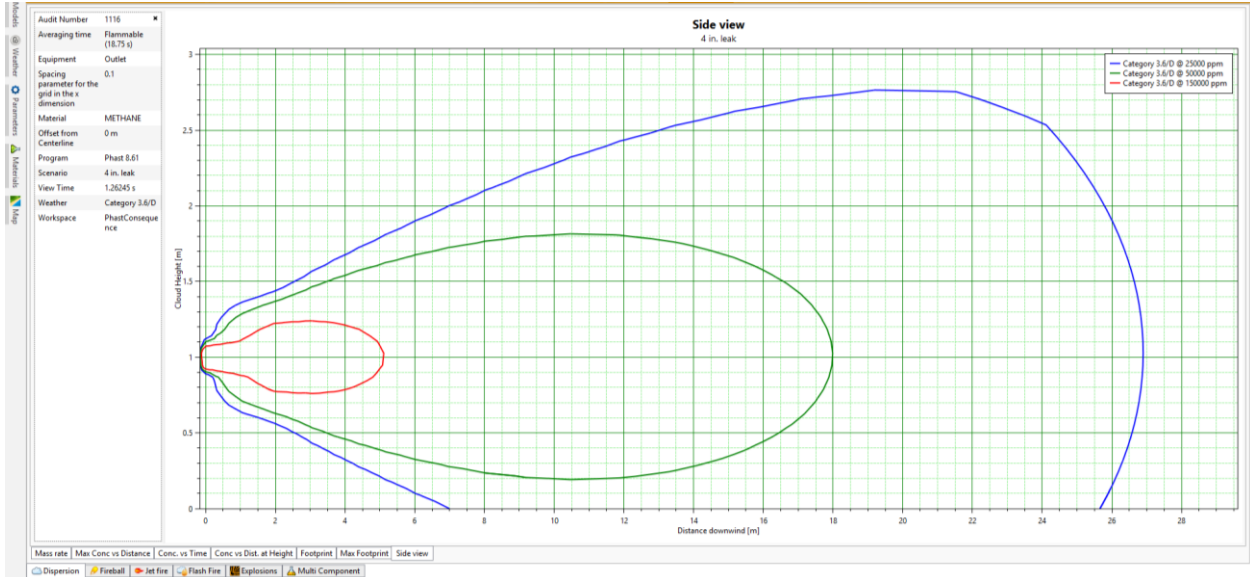


**Figure 21. Gas Cloud Side View (UFL/LFL) (4" hole in 10" Outlet Pipeline)**



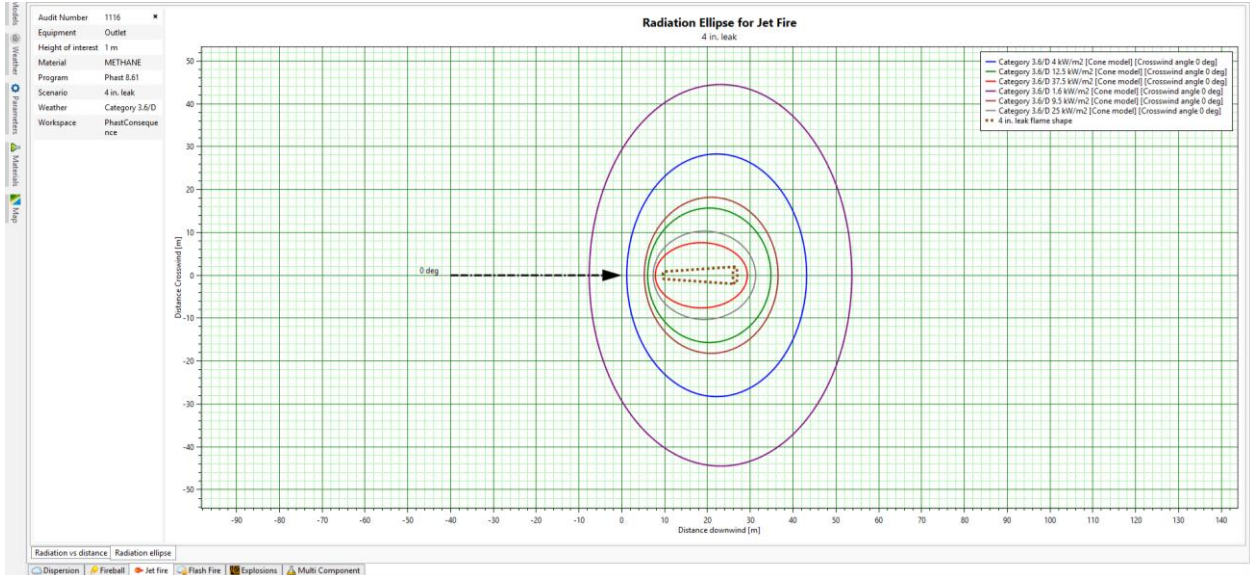

**Figure 22. Heat Radiation Contours from Jet Fire (4" hole in 10" Outlet Pipeline)**

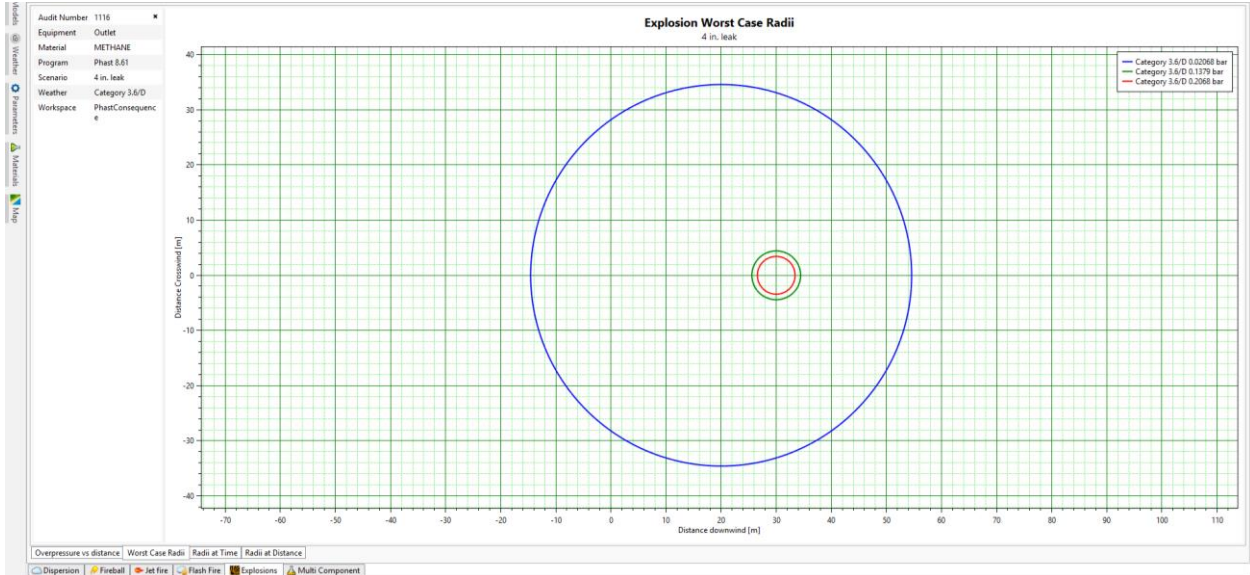

**Figure 23. Worst-Case Explosion Overpressure Waves (4" hole in 10" Outlet Pipeline)**



### 2/3- Consequence Modeling for 10 inch (Full Rup.) Gas Release

The following table no. (21) Shows that:


*Table 22. Dispersion Modeling for Outlet - 10" Gas Release*

| Gas Release   |                     |              |            |                 |
|---------------|---------------------|--------------|------------|-----------------|
| Wind Category | Flammability Limits | Distance (m) | Height (m) | Cloud Width (m) |
| 3.6 D         | UFL                 | 7.3          | 1.35       | 0.7 @ 4 m       |
|               | LFL                 | 27.1         | 0 – 2.1    | 2.1 @ 10.5 m    |
|               | 50 % LFL            | 46.1         | 0 – 2.55   | 2.55 @ 11.9 m   |



| Jet Fire      |                  |                                     |                       |                        |                     |
|---------------|------------------|-------------------------------------|-----------------------|------------------------|---------------------|
| Wind Category | Flame Length (m) | Heat Radiation (kW/m <sup>2</sup> ) | Distance Downwind (m) | Distance Crosswind (m) | Lethality Level (%) |
| 3.6 D         | 66.9             | 1.6                                 | 163.1                 | 135.3                  | 0                   |
|               |                  | 4                                   | 125.2                 | 87.1                   | 0                   |
|               |                  | 9.5                                 | 101.5                 | 56.8                   | 0                   |
|               |                  | 12.5                                | 95.7                  | 49.4                   | 20% /60 sec.        |
|               |                  | 25                                  | 83.2                  | 33.9                   | 80.34               |
|               |                  | 37.5                                | 76.6                  | 26.3                   | 98.74               |

| Unconfined Vapor Cloud Explosion - UVCE (Open Air) |                      |                                    |                                    |  |
|--|----------------------|------------------------------------|------------------------------------|--|
| Wind Category                                      | Pressure Value (bar) | Overpressure Worst-Case Radius (m) | Overpressure Waves Effect / Damage |  |
| 3.6 D  | 0.020                | 83.5                               | 0.021 bar                          | Probability of serious damage beyond this point = 0.05 - 10 % glass broken |
|  | 0.137                | 43.9                               | 0.137 bar                          | Some severe injuries, death unlikely                                       |
|  | 0.206                | 43                                 | 0.206 bar                          | Steel frame buildings distorted / pulled from foundation                   |


| Fireball      |                                     |              |  |
|---------------|-------------------------------------|--------------|--|
| Wind Category | Heat Radiation (kW/m <sup>2</sup> ) | Distance (m) | Heat Radiation (kW/m <sup>2</sup> ) Effects on People & Structures   |
| 3.6 D         | 4                                   | 42.3         | <u>12.5</u><br>20 % Chance of fatality for 60 sec exposure   |
|               | 12.5                                | 24           | <u>25</u><br>100 % Chance of fatality for continuous exposure<br>50 % Chance of fatality for 30 sec exposure |
|               | 37.5                                | 13.4         | <u>37.5</u><br>Sufficient of cause process equipment damage  |

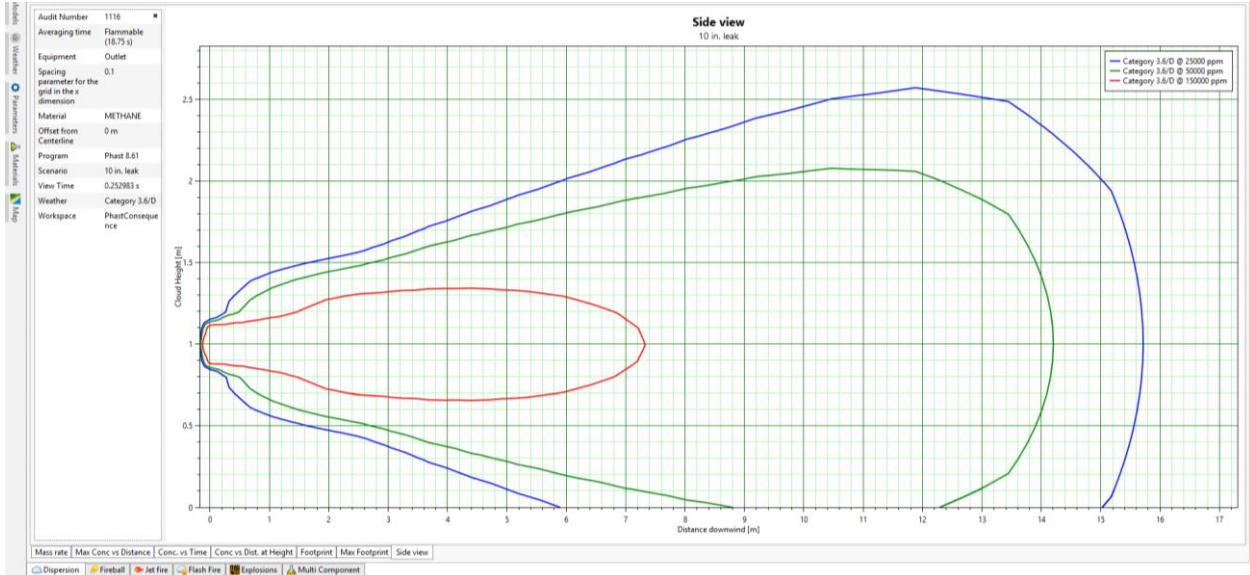


**Figure 24. Gas Cloud Side View (UFL/LFL) (10" Outlet Pipeline Full Rupture)**

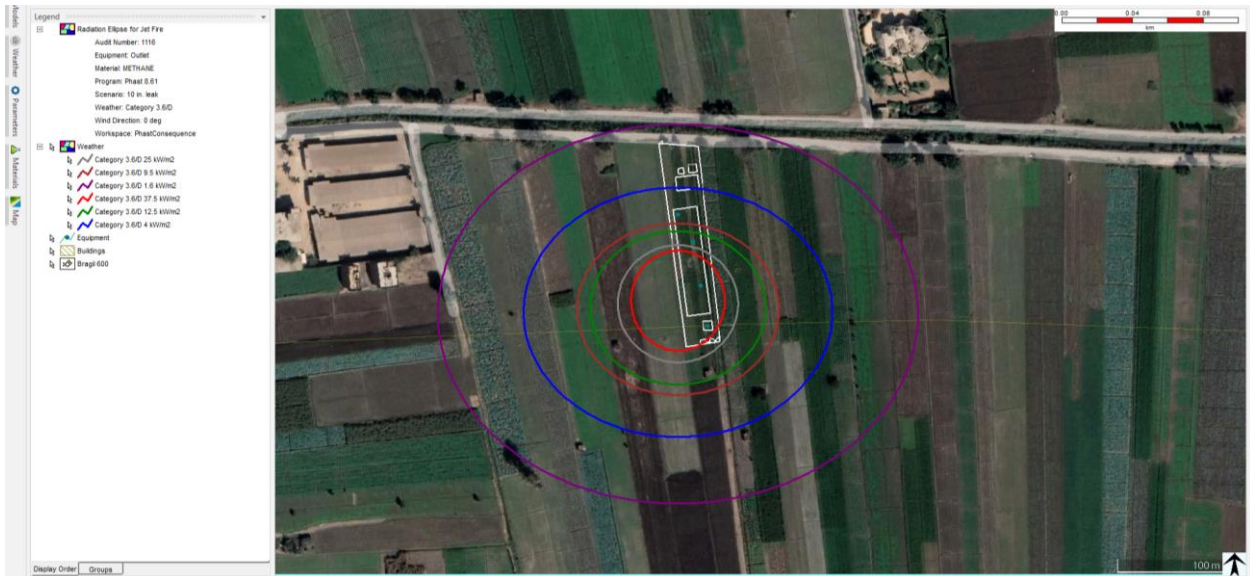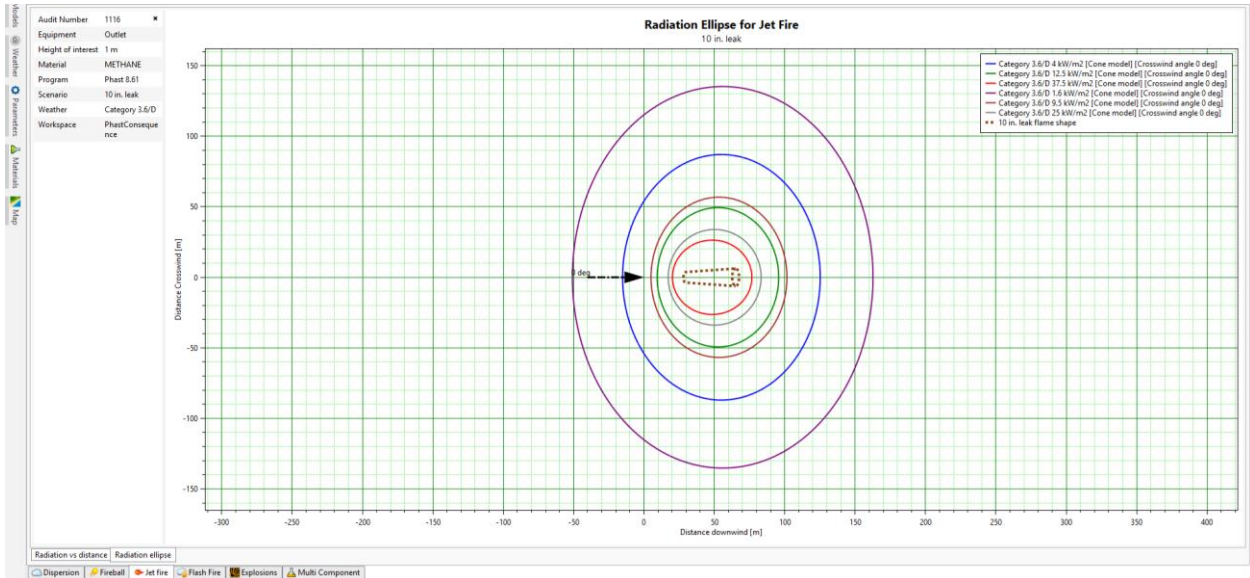

**Figure 25. Heat Radiation Contours from Jet Fire (10" Outlet Pipeline Full Rupture)**

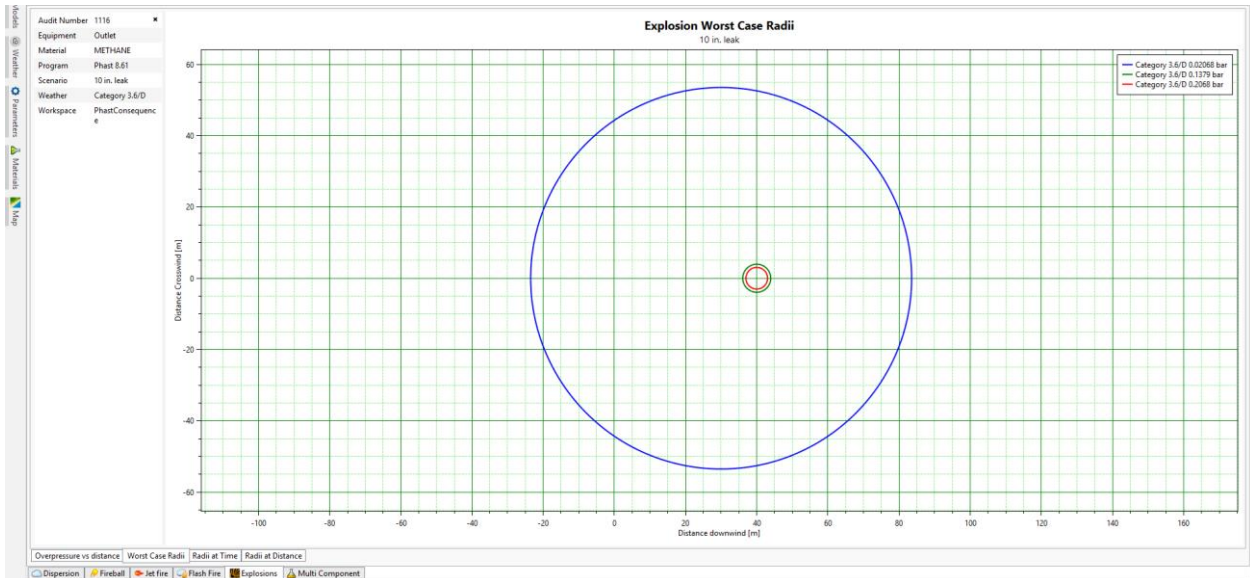

**Figure 26. Worst-Case Explosion Overpressure Waves (10" Outlet Pipeline Full Rupture)**

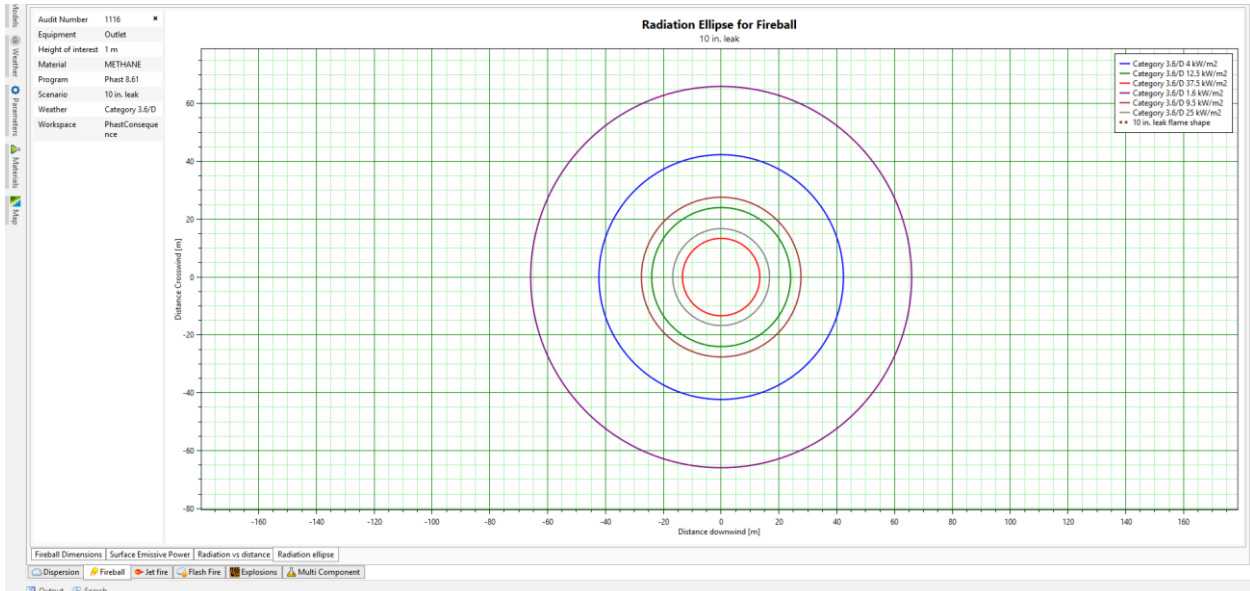

**Figure 27. Heat Radiation Contours from Fireball (10" Outlet Pipeline Full Rupture)**



### 3.0. Pressure Reduction Station Odorant Tank (Spotleak)

The following table no. (22) Shows 1" hole leak from odorant Modeling:


*Table 23. Dispersion Modeling for Odorant Tank*

| Gas Release   |                     |              |            |                 |
|---------------|---------------------|--------------|------------|-----------------|
| Wind Category | Flammability Limits | Distance (m) | Height (m) | Cloud Width (m) |
| 3.6 D         | UFL                 | 12.5         | 0 – 0.2    | 11              |
|               | LFL                 | 31.25        | 0 – 0.69   | 34              |
|               | 50 % LFL            | 56.2         | 0 – 1.065  | 46.5            |

| Jet Fire      |                  |                                     |                       |                        |                     |
|---------------|------------------|-------------------------------------|-----------------------|------------------------|---------------------|
| Wind Category | Flame Length (m) | Heat Radiation (kW/m <sup>2</sup> ) | Distance Downwind (m) | Distance Crosswind (m) | Lethality Level (%) |
| 3.6 D         | 15.7             | 1.6                                 | 26.7                  | 26.7                   | 0                   |
|               |                  | 4                                   | 16.9                  | 16.9                   | 0                   |
|               |                  | 9.5                                 | 12                    | 11.3                   | 0                   |
|               |                  | 12.5                                | 11.4                  | 9.8                    | 20% /60 sec.        |
|               |                  | 25                                  | 10.2                  | 6.2                    | 80.34               |
|               |                  | 37.5                                | 9.6                   | 4.1                    | 98.74               |

| Unconfined Vapor Cloud Explosion - UVCE (Open Air) |                      |                                    |                                    |   |
|--|----------------------|------------------------------------|------------------------------------|---|
| Wind Category                                      | Pressure Value (bar) | Overpressure Worst-Case Radius (m) | Overpressure Waves Effect / Damage |   |
| 3.6 D  | 0.020                | 99.4                               | <b>0.021 bar</b>                   | <i>Probability of serious damage beyond this point = 0.05 - 10 % glass broken</i> |
|  | 0.137                | 77.6                               | <b>0.137 bar</b>                   | <i>Some severe injuries, death unlikely</i>                                       |
|  | 0.206                | 75.9                               | <b>0.206 bar</b>                   | <i>Steel frame buildings distorted / pulled from foundation</i>                   |




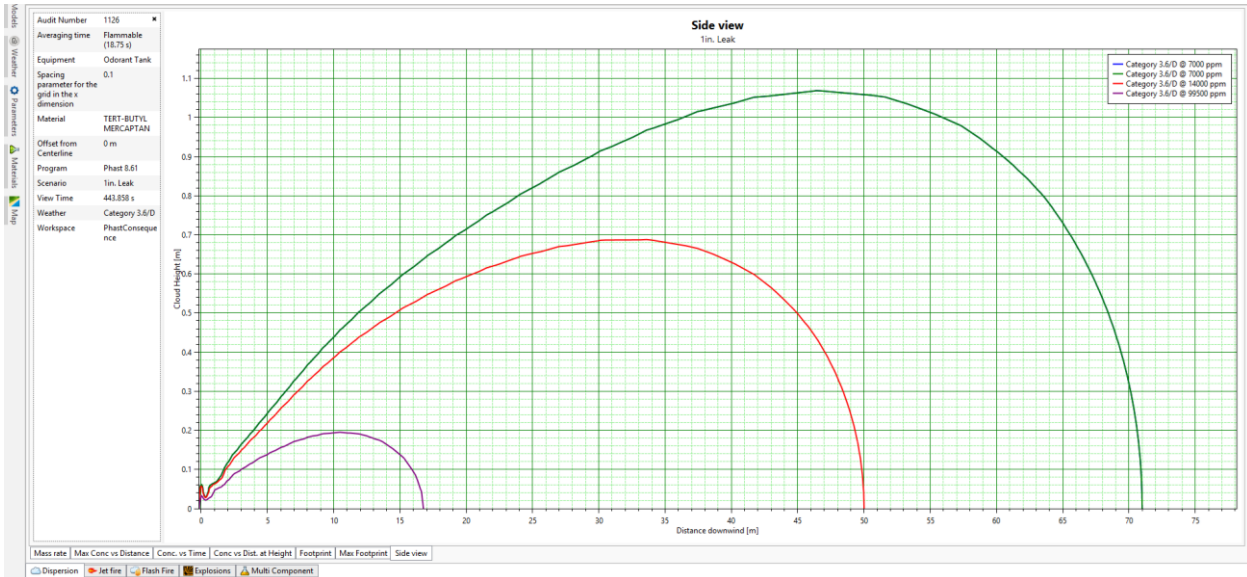

*Figure 28. Vapor Cloud (UFL/LFL) Side View Graph (Odorant leak)*




*Figure 29. Cloud Footprint (UFL/LFL) on site (Odorant leak)*

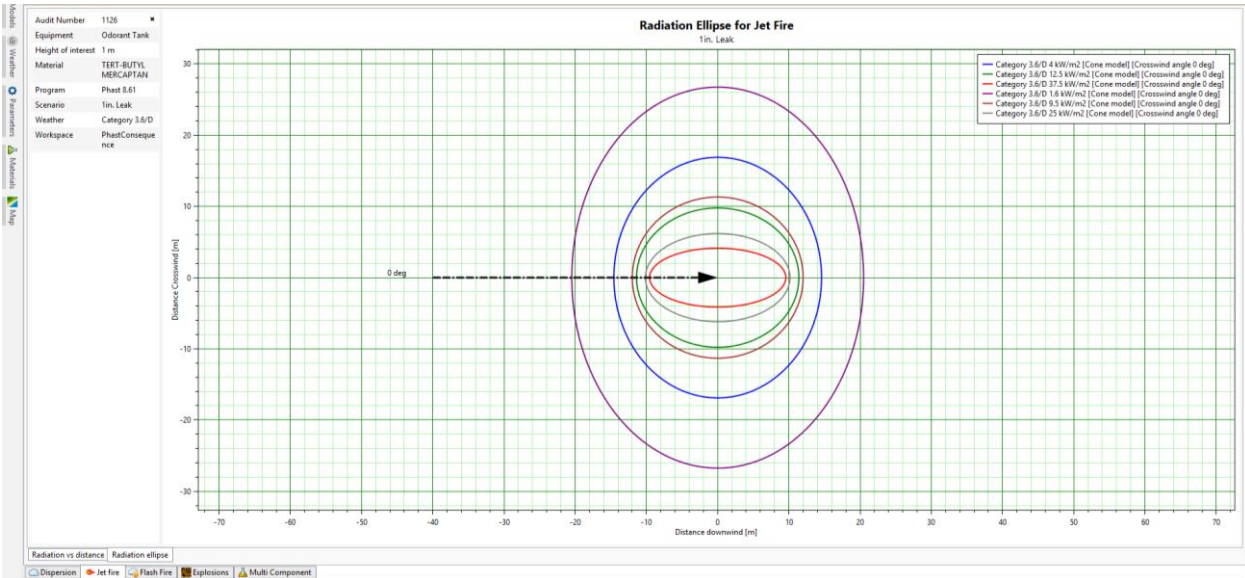

*Figure 30. Heat Radiation Contours - Jet Fire Graph (Odorant Leak)*



*Figure 31. Heat Radiation Contours - Jet Fire on Site (Odorant Leak)*

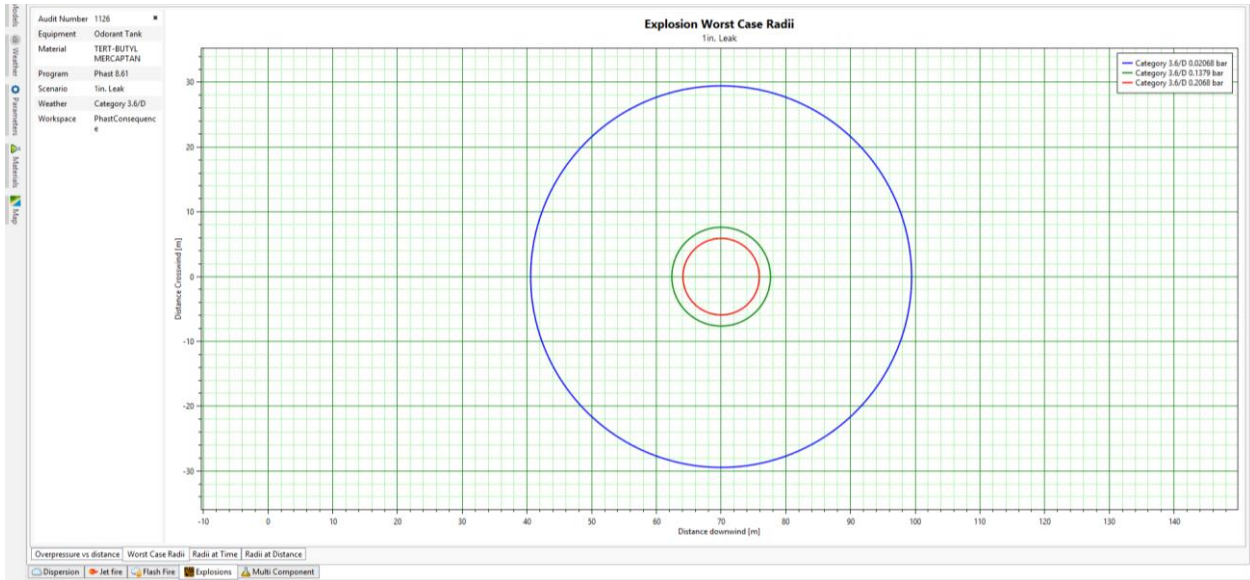

*Figure 32. Worst-Case Explosion Overpressure Waves Graph (Odorant Leak)*



*Figure 33. Worst-Case Explosion Overpressure Waves on Site (Odorant Leak)*



#### 4.0. Gas Heater (Water Bath Heating System)

The following table no. (23) Shows 1" hole leak from the heater Modeling:

*Table 24. Dispersion Modeling for Heater Tank*

| Gas Release  |                      |                                     |                                    |   |                     |
|--|----------------------|-------------------------------------|------------------------------------|---|---------------------|
| Wind Category                                      | Flammability Limits  | Distance (m)                        | Height (m)                         | Cloud Width (m)   |                     |
| 3.6 D  | UFL                  | 2.1                                 | 1.1                                | 0.2 @ 1.5 m   |                     |
|  | LFL                  | 6.5                                 | 1.3                                | 0.6 @ 4 m   |                     |
|  | 50 % LFL             | 12.8                                | 1.6                                | 1.2 @ 8 m   |                     |
| Jet Fire   |                      |                                     |                                    |   |                     |
| Wind Category                                      | Flame Length (m)     | Heat Radiation (kW/m <sup>2</sup> ) | Distance Downwind (m)              | Distance Crosswind (m)  | Lethality Level (%) |
| 3.6 D  | 12                   | 1.6                                 | 19.3                               | 14  | 0                   |
|  |                      | 4                                   | 16.3                               | 8.8   | 0                   |
|  |                      | 9.5                                 | 14.5                               | 5.4   | 0                   |
|  |                      | 12.5                                | 14                                 | 4.6   | 20% /60 sec.        |
|  |                      | 25                                  | 13                                 | 2.7   | 80.34               |
|  |                      | 37.5                                | 12.2                               | 1.7   | 98.74               |
| Unconfined Vapor Cloud Explosion - UVCE (Open Air) |                      |                                     |                                    |   |                     |
| Wind Category                                      | Pressure Value (bar) | Overpressure Worst-Case Radius (m)  | Overpressure Waves Effect / Damage |   |                     |
| 3.6 D  | 0.020                | 23.2                                | 0.021 bar                          | <i>Probability of serious damage beyond this point = 0.05 - 10 % glass broken</i> |                     |
|  | 0.137                | 13.4                                | 0.137 bar                          | <i>Some severe injuries, death unlikely</i>                                       |                     |
|  | 0.206                | 12.6                                | 0.206 bar                          | <i>Steel frame buildings distorted / pulled from foundation</i>                   |                     |


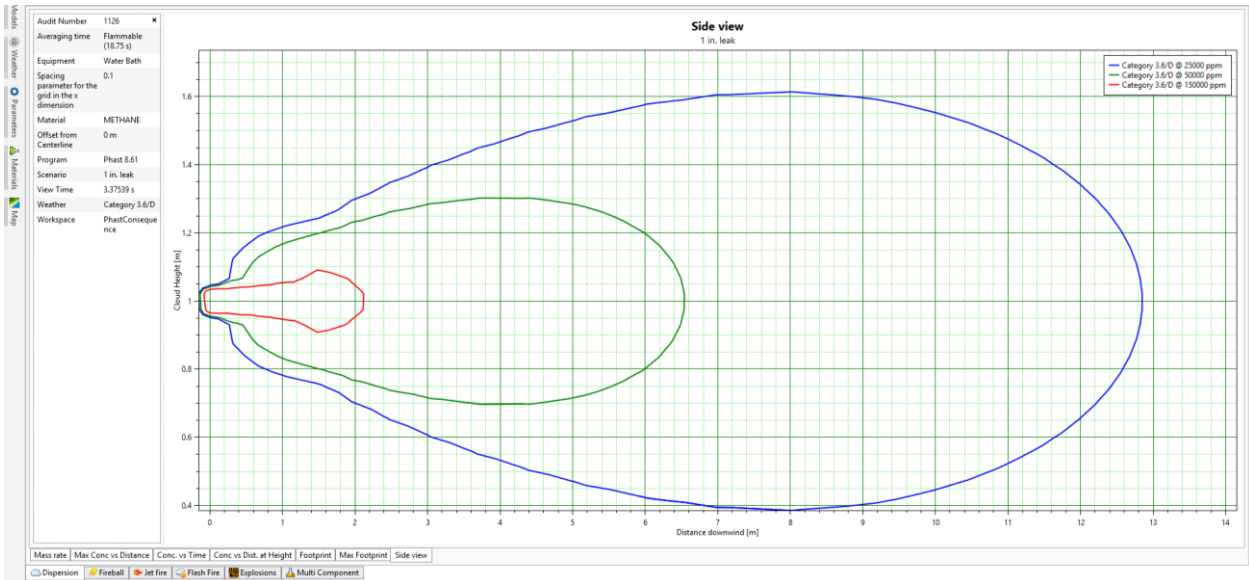


Figure 34. Vapor Cloud (UFL/LFL) Side View Graph (Gas Heater)




Figure 35. Cloud Footprint (UFL/LFL) on site (Gas Heater)

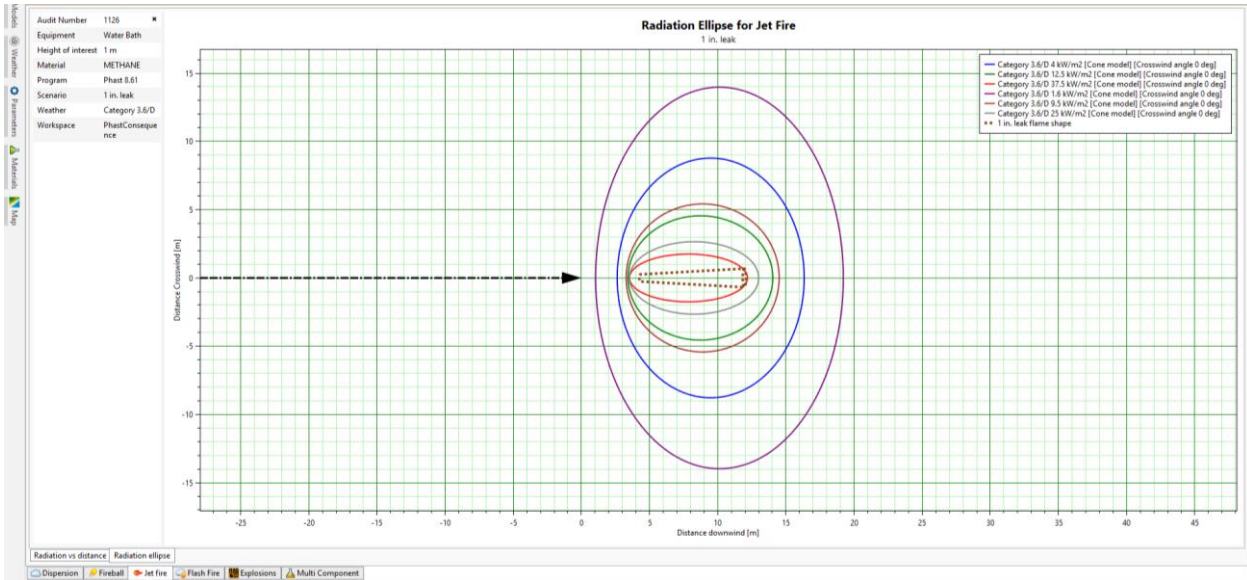

*Figure 36. Heat Radiation Contours - Fire Graph (Gas Heater)*



*Figure 37. Heat Radiation Contours - Fire on Site (Gas Heater)*

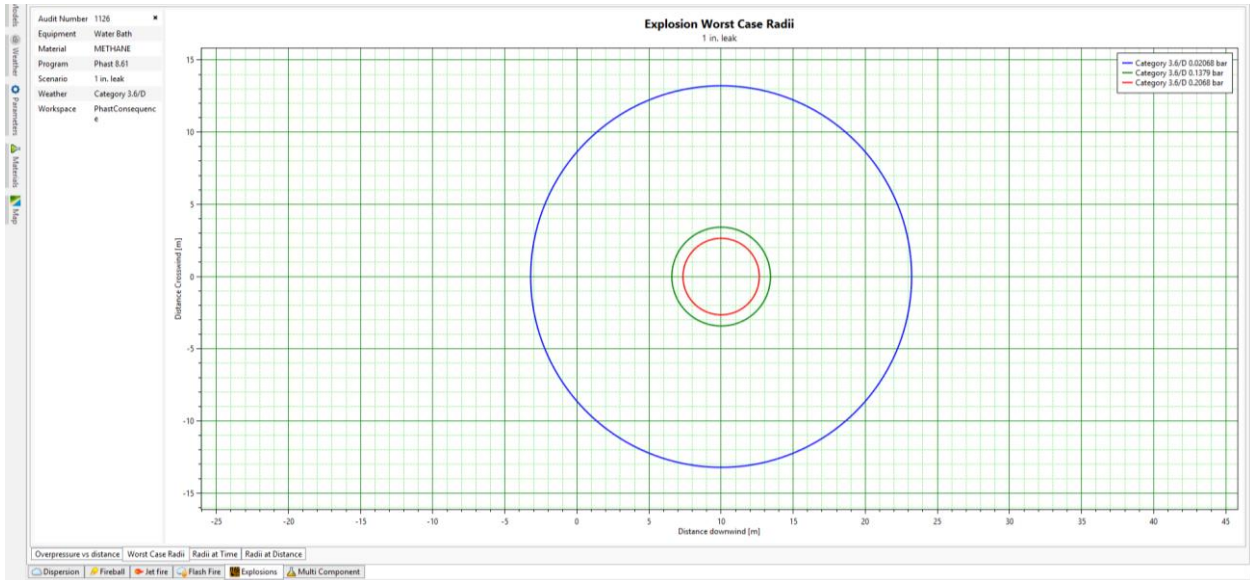

*Figure 38. Worst-Case Explosion Overpressure Waves Graph (Gas Heater)*



*Figure 39. Worst-Case Explosion Overpressure Waves on Site (Gas Heater)*



## 5.0. Pressure Reduction Station Off-Take Pipeline (10 inch)

### 5/1- Consequence Modeling for 1 inch (Pin Hole) Gas Release

The following table no. (24) Shows that:


*Table 25. Dispersion Modeling for Off-take - 1" / 10" Gas Release*

| Gas Release   |                     |              |            |                 |
|---------------|---------------------|--------------|------------|-----------------|
| Wind Category | Flammability Limits | Distance (m) | Height (m) | Cloud Width (m) |
| 3.6 D         | UFL                 | 0.15         | 1.7        | 0.2             |
|               | LFL                 | 0.21         | 4.9        | 0.54            |
|               | 50 % LFL            | 0.24         | 7.4        | 1.38            |


| Jet Fire      |                  |                                     |                       |                        |                     |
|---------------|------------------|-------------------------------------|-----------------------|------------------------|---------------------|
| Wind Category | Flame Length (m) | Heat Radiation (kW/m <sup>2</sup> ) | Distance Downwind (m) | Distance Crosswind (m) | Lethality Level (%) |
| 3.6 D         | 9.3              | 1.6                                 | 20.3                  | 19.3                   | 0                   |
|               |                  | 4                                   | 12.7                  | 11.3                   | 0                   |
|               |                  | 9.5                                 | 7                     | 5.3                    | 0                   |
|               |                  | 12.5                                | 5.1                   | 3.5                    | 20% /60 sec.        |
|               |                  | 25                                  | 1.1                   | 0.8                    | 80.34               |
|               |                  | 37.5                                | N/D                   | N/D                    | 98.74               |

| Unconfined Vapor Cloud Explosion - UVCE (Open Air) |                      |                                    |                                    |  |
|--|----------------------|------------------------------------|------------------------------------|--|
| Wind Category                                      | Pressure Value (bar) | Overpressure Worst-Case Radius (m) | Overpressure Waves Effect / Damage |  |
| 3.6 D  | 0.020                | N/D                                | 0.021 bar                          | Probability of serious damage beyond this point = 0.05 - 10 % glass broken |
|  | 0.137                | N/D                                | 0.137 bar                          | Some severe injuries, death unlikely                                       |
|  | 0.206                | N/D                                | 0.206 bar                          | Steel frame buildings distorted / pulled from foundation                   |



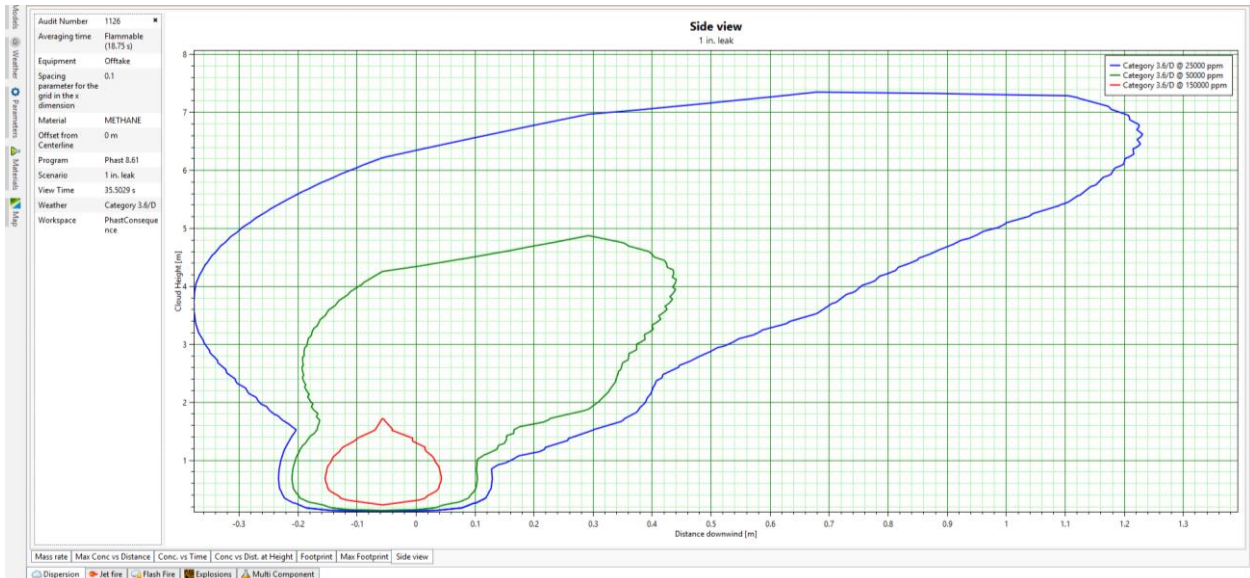

**Figure 40. Gas Cloud Side View (UFL/LFL) (1" hole in 10" off-take Pipeline)**

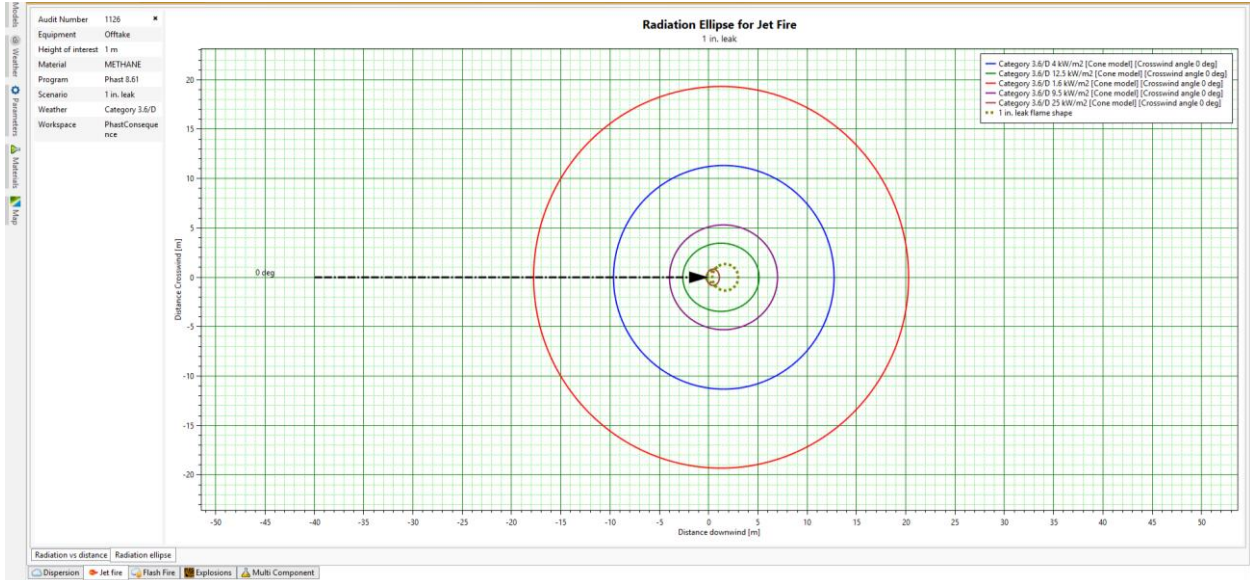

**Figure 41. Heat Radiation Contours from Jet Fire (1" hole in 10" off-take Pipeline)**



### 5/2- Consequence Modeling for 4 inch (Half Rup.) Gas Release

The following table no. (25) Shows that:

*Table 26. Dispersion Modeling for Off-take - 4" / 10" Gas Release*



| Gas Release   |                     |              |            |                 |  |
|---------------|---------------------|--------------|------------|-----------------|--|
| Wind Category | Flammability Limits | Distance (m) | Height (m) | Cloud Width (m) |  |
| 3.6 D         | UFL                 | 0.29         | 10         | 1.1             |  |
|               | LFL                 | 0.38         | 25         | 3.3             |  |
|               | 50 % LFL            | 0.42         | 35         | 7.1             |  |


| Jet Fire      |                  |                                     |                       |                        |                     |
|---------------|------------------|-------------------------------------|-----------------------|------------------------|---------------------|
| Wind Category | Flame Length (m) | Heat Radiation (kW/m <sup>2</sup> ) | Distance Downwind (m) | Distance Crosswind (m) | Lethality Level (%) |
| 3.6 D         | 42.7             | 1.6                                 | 103.6                 | 100.1                  | 0                   |
|               |                  | 4                                   | 63.9                  | 58.9                   | 0                   |
|               |                  | 9.5                                 | 33.5                  | 28.9                   | 0.72                |
|               |                  | 12.5                                | 23.4                  | 20.4                   | 20% /60 sec.        |
|               |                  | 25                                  | N/D                   | N/D                    | 80.34               |
|               |                  | 37.5                                | N/D                   | N/D                    | 98.74               |

| Unconfined Vapor Cloud Explosion - UVCE (Open Air) |                      |                                    |                                    |   |
|--|----------------------|------------------------------------|------------------------------------|---|
| Wind Category                                      | Pressure Value (bar) | Overpressure Worst-Case Radius (m) | Overpressure Waves Effect / Damage |   |
| 3.6 D  | 0.020                | N/D                                | <b>0.021 bar</b>                   | <i>Probability of serious damage beyond this point = 0.05 - 10 % glass broken</i> |
|  | 0.137                | N/D                                | <b>0.137 bar</b>                   | <i>Some severe injuries, death unlikely</i>                                       |
|  | 0.206                | N/D                                | <b>0.206 bar</b>                   | <i>Steel frame buildings distorted / pulled from foundation</i>                   |



**Figure 42. Gas Cloud Side View (UFL/LFL) (4" hole in 10" off-take Pipeline)**

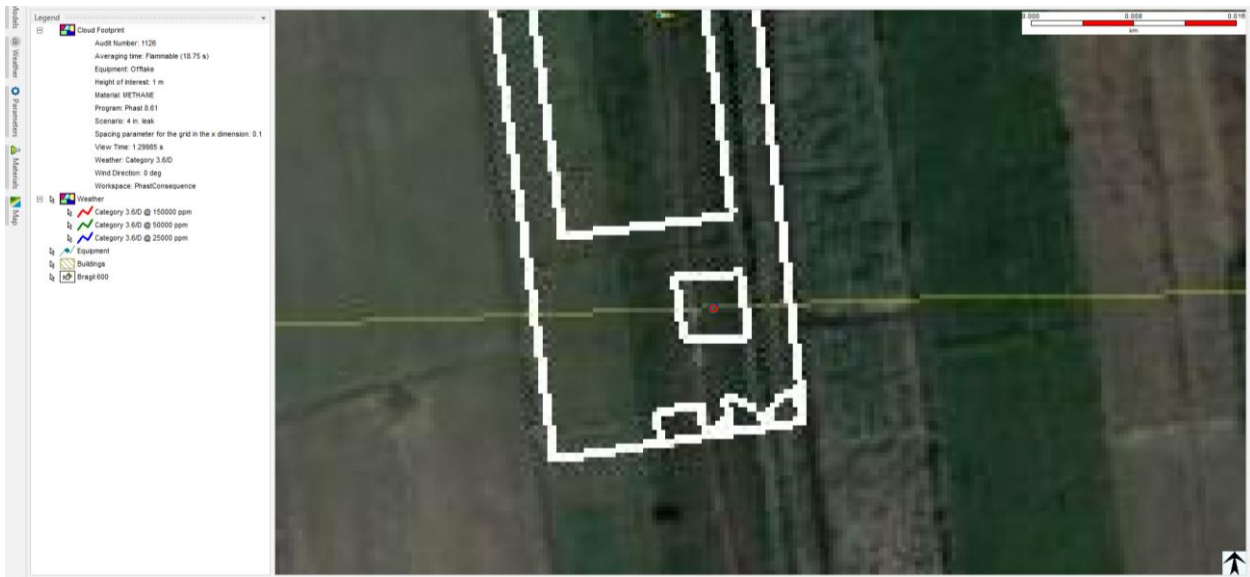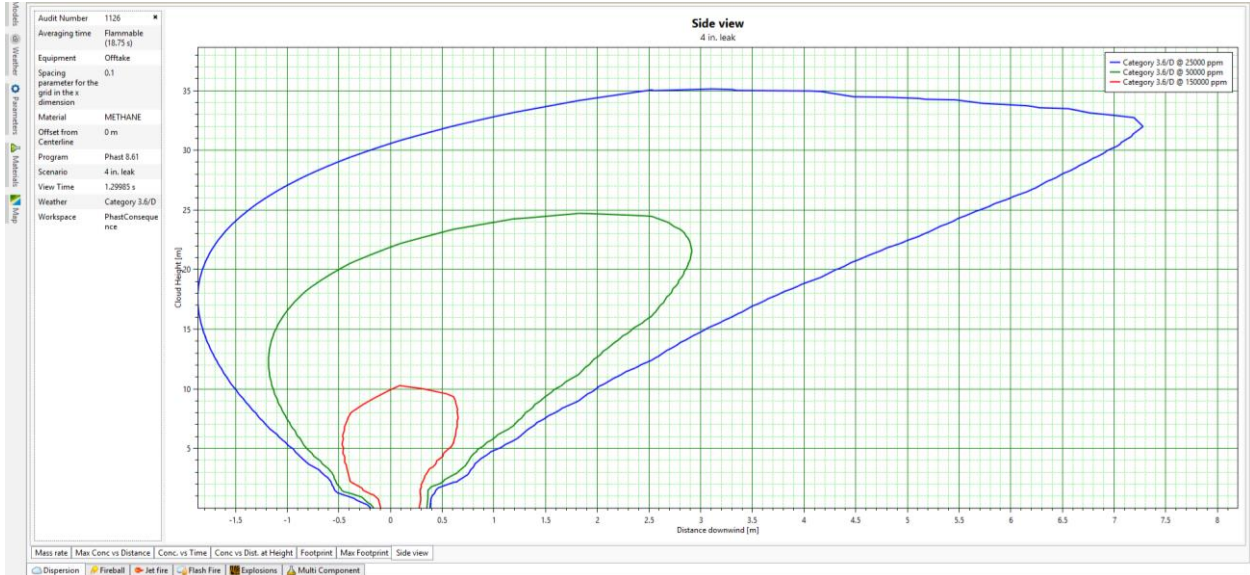

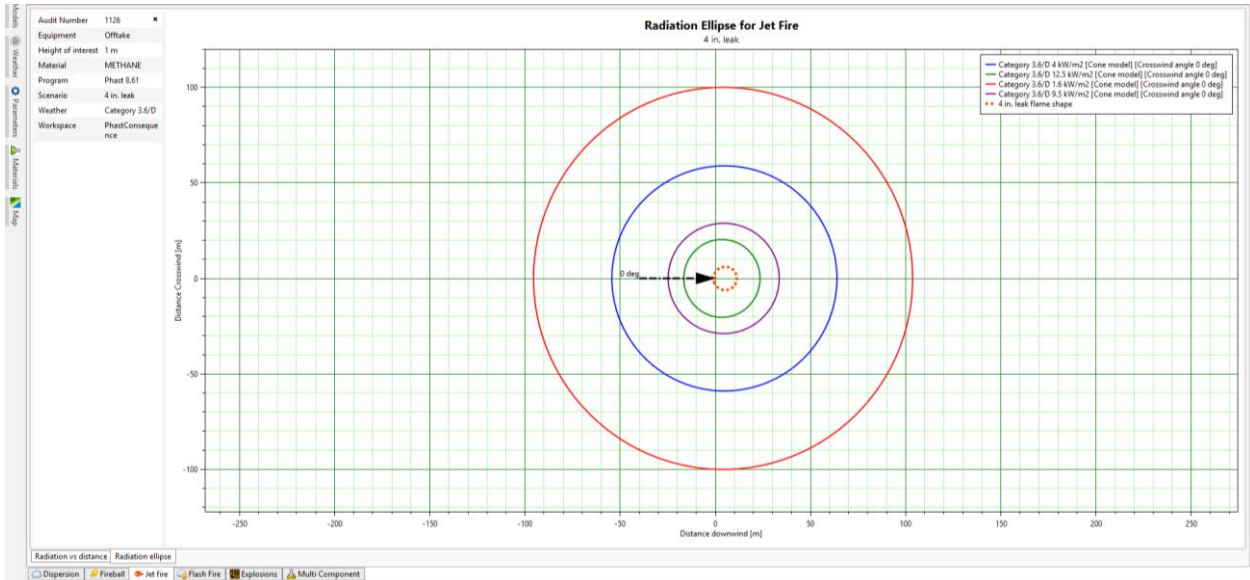**Figure 43. Heat Radiation Contours from Jet Fire (4" hole in 10" off-take Pipeline)**



### 5/3- Consequence Modeling for 10 inch (Full Rup.) Gas Release


The following table no. (26) Shows that:

*Table 27. Dispersion Modeling for Off-take - 10" Gas Release*



| Gas Release   |                     |              |            |                 |
|---------------|---------------------|--------------|------------|-----------------|
| Wind Category | Flammability Limits | Distance (m) | Height (m) | Cloud Width (m) |
| 3.6 D         | UFL                 | 0.37         | 15.25      | 1.65            |
|               | LFL                 | 0.47         | 21         | 5               |
|               | 50 % LFL            | 0.53         | 21.5       | 7               |

| Jet Fire      |                  |                                     |                       |                        |                     |
|---------------|------------------|-------------------------------------|-----------------------|------------------------|---------------------|
| Wind Category | Flame Length (m) | Heat Radiation (kW/m <sup>2</sup> ) | Distance Downwind (m) | Distance Crosswind (m) | Lethality Level (%) |
| 3.6 D         | 108.8            | 1.6                                 | 284.5                 | 277.3                  | 0                   |
|               |                  | 4                                   | 176.7                 | 166.8                  | 0                   |
|               |                  | 9.5                                 | 97.1                  | 88.3                   | 0                   |
|               |                  | 12.5                                | 73.1                  | 66.4                   | 20% /60 sec.        |
|               |                  | 25                                  | N/D                   | N/D                    | 80.34               |
|               |                  | 37.5                                | N/D                   | N/D                    | 98.74               |

| Unconfined Vapor Cloud Explosion - UVCE (Open Air) |                      |                                    |                                    |   |
|--|----------------------|------------------------------------|------------------------------------|---|
| Wind Category                                      | Pressure Value (bar) | Overpressure Worst-Case Radius (m) | Overpressure Waves Effect / Damage |   |
| 3.6 D  | 0.020                | 76.3                               | 0.021 bar                          | <i>Probability of serious damage beyond this point = 0.05 - 10 % glass broken</i> |
|  | 0.137                | 27.2                               | 0.137 bar                          | <i>Some severe injuries, death unlikely</i>                                       |
|  | 0.206                | 23.3                               | 0.206 bar                          | <i>Steel frame buildings distorted / pulled from foundation</i>                   |

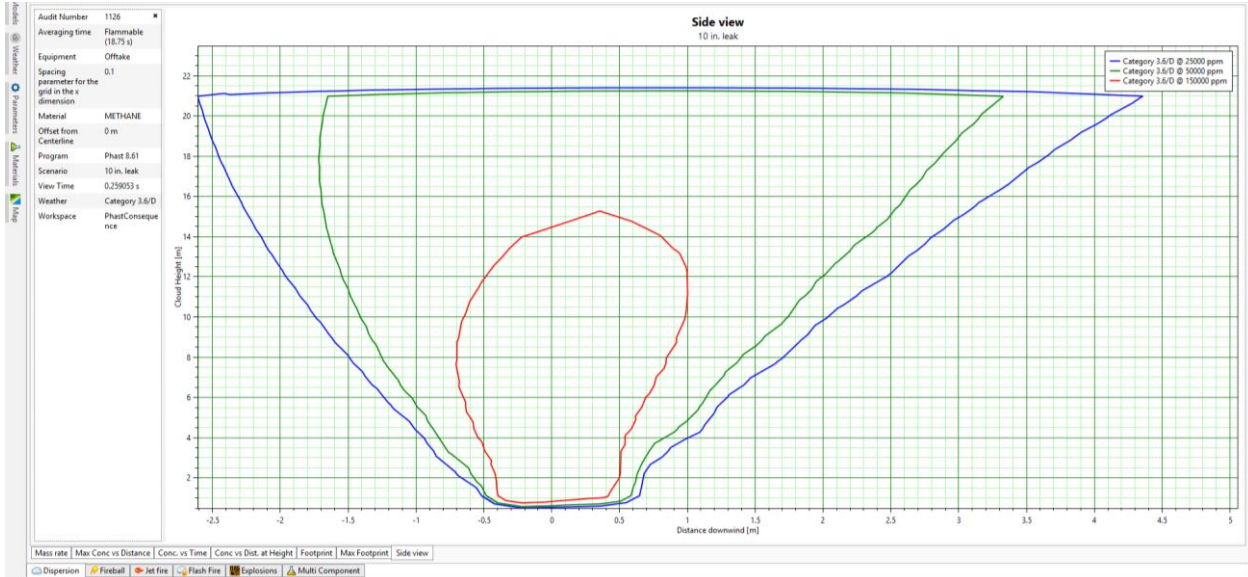


**Figure 44. Gas Cloud Side View (UFL/LFL) (10" off-take Pipeline Full Rupture)**

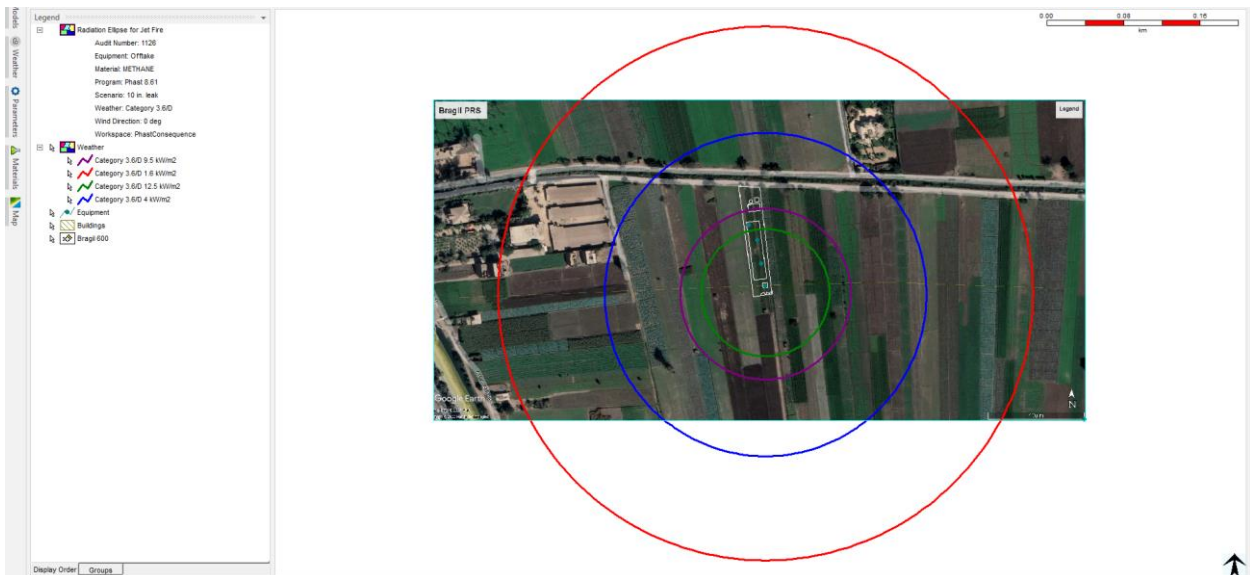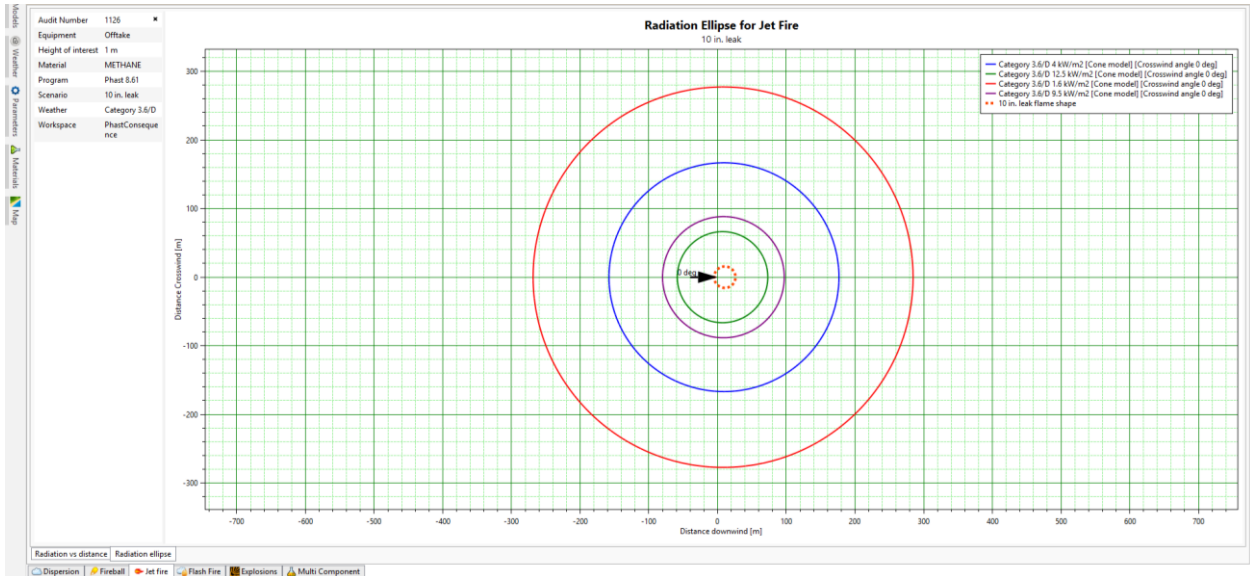

**Figure 45. Heat Radiation Contours from Jet Fire (10" off-take Pipeline Full Rupture)**



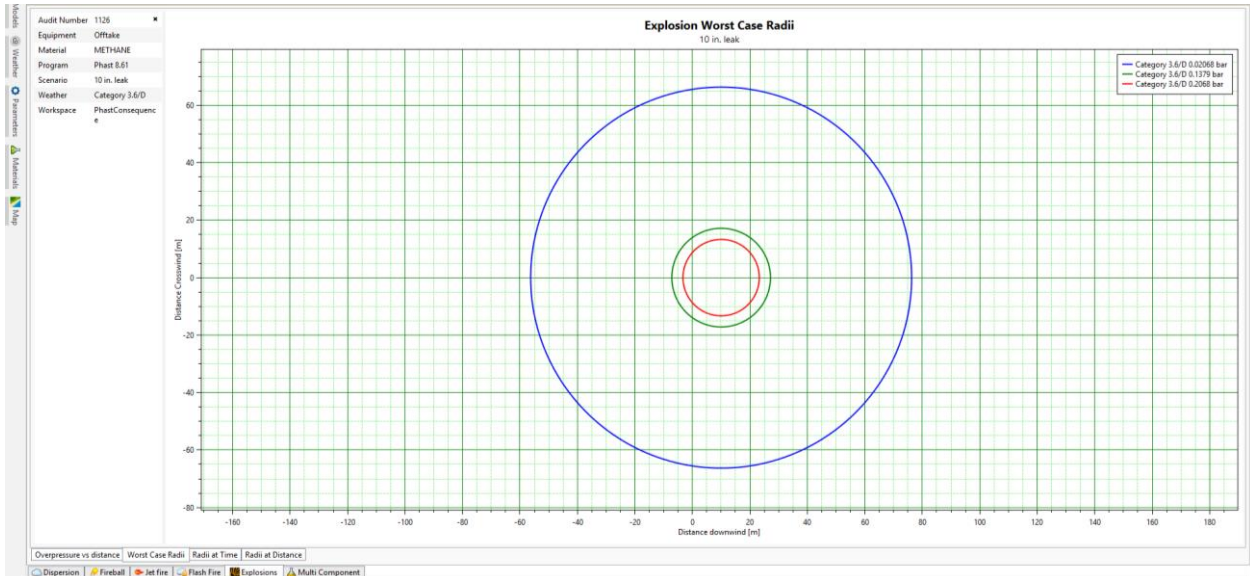

**Figure 46. Worst-Case Explosion Overpressure Waves (10" off-take Pipeline Full Rupture)**



## Individual Risk Evaluation

### *-Risk Calculation*

All identified hazards should be subject to an evaluation for risk potential. This means analyzing the hazard for its probability to actually progress to loss event, as well as likely consequences of this event.

There are four steps to calculate risk, which determined as follows:

- 1- *Identify failure frequency (International Data Base)*
- 2- *Calculating the frequency against control measures at site by using Event Tree Analysis "ETA".*
- 3- *Identify scenarios probability.*
- 4- *Calculated risk to people regarding to the vulnerability of life loses.*

Basically, risk will be calculated as presented in the following equation:

**Risk to people (Individual Risk – IR) =**

**Total Risk ( $\Sigma$  Frequency of fire/explosion) x Occupancy x Vulnerability**

Where:

- Total risk *Is the sum of contributions from all hazards exposed to (fire / explosion).*
- Occupancy *Is the proportion of time exposed to work hazards. (Expected that x man the most exposed person to fire/explosion hazards on site. He works 8 hours shift/day)*
- Vulnerability *Is the probability that exposure to the hazard will result in fatality.*

As shown in tables (5 & 6) – (Page: 30 & 31) the vulnerability of people to heat radiation starting from 12.5 kW/m<sup>2</sup> will lead to fatality accident for 60 sec. Exposure and for explosion over pressure starting from 0.137 bar.

The modeling of the different scenarios shows that the heat radiation and explosion overpressure waves would be a result from release scenarios for all sizes of crack and according to the space size for the PRMS, all of the sequence will be determined for three values release (small, medium and large).

Calculating frequencies needs a very comprehensive calculation which needs a lot of data collecting related to failure of equipment's and accident reporting with detailed investigation to know the failure frequency rates in order to calculate risks from scenarios.

In this study, it is decided to use an International Data Bank for major hazardous incident data.

The following table (28) shows the frequency for each failure that can be raised in pressure reduction station operations:



Table 28. Failure Frequency for Each Scenario

| Scenario  | Release Size  | Failure Cause           | Failure Rate                 |
|---|---------------|-------------------------|------------------------------|
| Gas Release from<br>1"/10" Pipeline &<br>1"/3" Gas Heater | <i>Small</i>  |                         |                              |
|   |               | Internal Corrosion      | $1.19E-05$                   |
|   |               | External Corrosion      | $3.55E-06$                   |
|   |               | Maintenance Error       | $2.28E-05$                   |
|   |               | Corrosive Liquid or Gas | $4.84E-04$                   |
|   |               | <b>Total</b>            | <b><math>5.22E-04</math></b> |
| Gas Release from<br>4"/10" Pipeline                       | <i>Medium</i> |                         |                              |
|   |               | Internal Corrosion      | $2.71E-05$                   |
|   |               | External Corrosion      | $8.24E-06$                   |
|   |               | Erosion                 | $4.85E-04$                   |
|   |               | <b>Total</b>            | <b><math>5.20E-04</math></b> |
| Gas Release from<br>10" Pipeline Full<br>Rupture          | <i>Large</i>  |                         |                              |
|   |               | Internal Corrosion      | $5.53E-06$                   |
|   |               | External Corrosion      | $1.61E-06$                   |
|   |               | Weld Crack              | $4.34E-06$                   |
|   |               | Earthquake              | $1.33E-07$                   |
|   |               | <b>Total</b>            | <b><math>1.16E-05</math></b> |
| Spotleak<br>(Odorant Tank)                                | <i>Medium</i> | <i>As a package</i>     | <b>Failure Rate</b>          |
|   |               |                         | <b><math>1.25E-05</math></b> |

Reference: Taylor Associates ApS - 2006

(Hazardous Materials Release and Accident Frequencies for Process Plant - Volume II / Process Unit Release Frequencies - Version 1 Issue 7)



### *-Event Tree Analysis*

An event tree is a graphical way of showing the possible outcomes of a hazardous event, such as a failure of equipment or human error.

An ETA involves determining the responses of systems and operators to the hazardous event in order to determine all possible alternative outcomes.

The result of the ETA is a series of scenarios arising from different sets of failures or errors.

These scenarios describe the possible accident outcomes in terms of the sequence of events (successes or failures of safety functions) that follow the initial hazardous event.

Event trees shall be used to identify the various escalation paths that can occur in the process. After these escalation paths are identified, the specific combinations of failures that can lead to defined outcomes can then be determined.

This allows identification of additional barriers to reduce the likelihood of such escalation.

The results of an ETA are the event tree models and the safety system successes or failures that lead to each defined outcome.

Accident sequences represents in an event tree represent logical and combinations of events; thus, these sequences can be put into the form of a fault tree model for further qualitative analysis.

These results may be used to identify design and procedural weaknesses, and normally to provide recommendations for reducing the likelihood and/or consequences of the analyzed potential accidents.

Using ETA requires knowledge of potential initiating events (that is, equipment failures or system upsets that can potentially cause an accident), and knowledge of safety system functions or emergency procedures that potentially mitigate the effects of each initiating event.

The equipment failures, system upsets and safety system functions shall be extracted from the likelihood data presented before.



In the case of hydrocarbon release, the event tree first branch is typically representing "Early Ignition". These events are represented in the risk analysis as jet fire events.

This is because sufficient time is unlikely to elapse before ignition for a gas/air mixture to accumulate and cause either a flash fire or a gas hazard.

Subsequent branches for these events represent gas detection, fire detection, inventory isolation (or ESD) or deluge activation.

Delayed ignitions are typically represented by the fifth branch event. This is because, in the time taken for an ignition to occur, sufficient time is more likely to elapse for gas detection and inventory isolation.

The scenario development shall be performed for the following cases:

- Without any control measures
- With control measures

The event tree analysis outcomes can be classified into three main categories as follows:

|                                 |   |
|---------------------------------|---|
| <b>"Limited Consequence"</b>    | <i>Indicates that the release has been detected and the inventory source has been isolated automatically.</i>                       |
| <b>"Controlled Consequence"</b> | <i>Indicates that the release has been detected but the source has not been isolated automatically. [Needs human intervention].</i> |
| <b>"Escalated Consequence"</b>  | <i>Indicates that the release has not been detected and consequently the source has not been isolated.</i>                          |

The event trees analysis for each scenario are presented in the below pages:



Document Title: Quantitative Risk Assessment "QRA" Study for El-Baragil Pressure Reduction & Metering Station

Table (29) Inlet 10" / Outlet 10" / Off-Take 10" / Waterbath 3" Pipeline Scenarios (Pin Hole Crack – 1" Release) – Event Tree Analysis

| Release of Flammable Materials <sup>(1)</sup> | Immediate Ignition <sup>(2)</sup> | Fire Detection <sup>(3)</sup> | ESD System <sup>(3)</sup> | Fire Protec. <sup>(3)</sup> | Delayed Ignition <sup>(2)</sup> | Outcomes                | Frequency          |                   |
|---|-----------------------------------|-------------------------------|---------------------------|-----------------------------|---------------------------------|-------------------------|--------------------|-------------------|
| 5.22E-04                                      | 0.02                              | 0.6                           | 0.978                     | 0.97                        | 0.02                            |                         |                    |                   |
| 5.22E-04                                      | Yes 0.02                          | Yes 0.6                       | Yes 0.978                 | Yes 0.97                    | No 0.02                         | Controlled Jet fire     | 1.01E-05           |                   |
|   |                                   |                               |                           | No 0.03                     |                                 | Not controlled jet fire | 3.13E-07           |                   |
|   |                                   | No 0.4                        | Yes 0.978                 | No 0.022                    | Yes 0.02                        | No 0.98                 | Escalated jet fire | 4.18E-06          |
|   |                                   |                               |                           |                             |                                 |                         | Limited release    | -----             |
|   |                                   | No 0.98                       | Yes 0.978                 | No 0.022                    | Yes 0.02                        | No 0.98                 | Large release      | 1.13E-05          |
|   |                                   |                               |                           |                             |                                 |                         | Escalated jet fire | 1.02E-05          |
|   |                                   |                               |                           |                             |                                 |                         |                    | Escalated release |
| <b>TOTAL</b>                                  |                                   |                               |                           |                             |                                 |                         | <b>1.47E-05</b>    |                   |

(1) Refer to QRA Study Page 94. (Taylor Associates ApS - 2006)

(2) Ref. Handbook Failure Frequencies 2009.

(3) Ref. OGP – Report No. 434 – A1 / 2010.



Document Title: Quantitative Risk Assessment "QRA" Study for El-Baragil Pressure Reduction & Metering Station

Table (30) Inlet 10" / Off-Take 10" Pipeline Scenarios (Half Rupture – 4" Release) – Event Tree Analysis

| Release of Flammable Materials <sup>(1)</sup>                  | Immediate Ignition <sup>(2)</sup> | Fire Detection <sup>(3)</sup> | ESD System <sup>(3)</sup> | Fire Protec. <sup>(3)</sup> | Delayed Ignition <sup>(2)</sup> | Outcomes            | Frequency               |
|--|-----------------------------------|-------------------------------|---------------------------|-----------------------------|---------------------------------|---------------------|-------------------------|
| 5.20E-04   | 0.04                              | 0.6                           | 0.978                     | 0.97                        | 0.04                            |                     |                         |
| 5.20E-04   | Yes 0.04                          | Yes 0.6                       | Yes 0.978                 | Yes 0.97                    | No 0.03                         | Controlled Jet fire | 2.02E-05                |
|  |                                   |                               |                           |                             |                                 | No 0.03             | Not controlled jet fire |
|  |                                   | No 0.4                        |                           | Escalated jet fire          | 8.32E-06                        |                     |                         |
|  |                                   |                               |                           |                             | Limited release                 | -----               |                         |
|  |                                   | No 0.96                       |                           | No 0.022                    | Large release                   | 1.10E-05            |                         |
|  |                                   |                               |                           |                             |                                 | Yes 0.04            | Escalated jet fire      |
|  |                                   |                               |                           | No 0.96                     | Escalated release               |                     |                         |
| <b>TOTAL</b>   |                                   |                               |                           |                             |                                 |                     | <b>2.89E-05</b>         |
| (1) Refer to QRA Study Page 94. (Taylor Associates ApS - 2006) |                                   |                               |                           |                             |                                 |                     |                         |
| (2) Ref. Handbook Failure Frequencies 2009.                    |                                   |                               |                           |                             |                                 |                     |                         |
| (3) Ref. OGP – Report No. 434 – A1 / 2010.                     |                                   |                               |                           |                             |                                 |                     |                         |





Document Title: Quantitative Risk Assessment "QRA" Study for El-Baragil Pressure Reduction & Metering Station

Table (31) Outlet 10" Pipeline Scenario (Half Rupture – 4" Release) – Event Tree Analysis

| Release of Flammable Materials <sup>(1)</sup> | Immediate Ignition <sup>(2)</sup> | Fire Detection <sup>(3)</sup> | ESD System <sup>(3)</sup> | Fire Protec. <sup>(3)</sup> | Delayed Ignition <sup>(2)</sup> | Outcomes                | Frequency       |
|---|-----------------------------------|-------------------------------|---------------------------|-----------------------------|---------------------------------|-------------------------|-----------------|
| 5.20E-04                                      | 0.02                              | 0.6                           | 0.978                     | 0.97                        | 0.02                            |                         |                 |
| 5.20E-04                                      | Yes 0.02                          | Yes 0.6                       | Yes 0.978                 | Yes 0.97                    | 0.02                            | Controlled Jet fire     | 1.01E-05        |
|   |                                   |                               |                           | No 0.03                     |                                 | Not controlled jet fire | 3.12E-07        |
|   |                                   | No 0.4                        | Yes 0.978                 | 0.02                        | Escalated jet fire              | 4.16E-06                |                 |
|   |                                   |                               |                           |                             | Limited release                 | -----                   |                 |
|   |                                   | No 0.98                       | No 0.022                  | 0.02                        | Large release                   | 1.12E-05                |                 |
|   |                                   |                               |                           |                             | Yes 0.02                        | Escalated jet fire      | 1.02E-05        |
|   |                                   |                               |                           |                             | No 0.98                         | Escalated release       | 4.99E-04        |
|   |                                   |                               |                           |                             |                                 | <b>TOTAL</b>            | <b>1.47E-05</b> |

(1) Refer to QRA Study Page 94. (Taylor Associates ApS - 2006)

(2) Ref. Handbook Failure Frequencies 2009.

(3) Ref. OGP – Report No. 434 – A1 / 2010.



Document Title: Quantitative Risk Assessment "QRA" Study for El-Baragil Pressure Reduction & Metering Station

Table (32) Inlet 10" / Off-Take 10" Pipeline Scenarios (Full rupture Release) – Event Tree Analysis

| Release of Flammable Materials <sup>(1)</sup>                  | Immediate Ignition <sup>(2)</sup> | Fire Detection <sup>(3)</sup> | ESD System <sup>(3)</sup> | Fire Protec. <sup>(3)</sup> | Delayed Ignition <sup>(2)</sup> | Outcomes                | Frequency       |
|--|-----------------------------------|-------------------------------|---------------------------|-----------------------------|---------------------------------|-------------------------|-----------------|
| 1.16E-05   | 0.09                              | 0.6                           | 0.978                     | 0.97                        | 0.1                             |                         |                 |
|  | Yes 0.09                          | Yes 0.6                       | Yes 0.978                 | Yes 0.97                    |                                 | Controlled Jet fire     | 1.01E-06        |
|  |                                   | No 0.4                        | No 0.022                  | No 0.03                     |                                 | Not controlled jet fire | 3.13E-08        |
|  |                                   |                               |                           |                             |                                 | Escalated jet fire      | 4.18E-07        |
| 1.16E-05   | No 0.91                           |                               |                           |                             |                                 | Limited release         | -----           |
|  |                                   |                               |                           |                             |                                 | Large release           | 2.32E-07        |
|  |                                   |                               |                           | Yes 0.1                     |                                 | Escalated jet fire      | 1.06E-06        |
|  |                                   |                               |                           | No 0.9                      |                                 | Escalated release       | 9.50E-06        |
| <b>TOTAL</b>   |                                   |                               |                           |                             |                                 |                         | <b>1.50E-06</b> |
| (1) Refer to QRA Study Page 94. (Taylor Associates ApS - 2006) |                                   |                               |                           |                             |                                 |                         |                 |
| (2) Ref. Handbook Failure Frequencies 2009.                    |                                   |                               |                           |                             |                                 |                         |                 |
| (3) Ref. OGP – Report No. 434 – A1 / 2010.                     |                                   |                               |                           |                             |                                 |                         |                 |



Document Title: Quantitative Risk Assessment "QRA" Study for El-Baragil Pressure Reduction & Metering Station

Table (33) Outlet 10" Pipeline Scenarios (Full rupture Release) – Event Tree Analysis

| Release of Flammable Materials <sup>(1)</sup> | Immediate Ignition <sup>(2)</sup> | Fire Detection <sup>(3)</sup> | ESD System <sup>(3)</sup> | Fire Protec. <sup>(3)</sup> | Delayed Ignition <sup>(2)</sup> | Outcomes                | Frequency       |
|---|-----------------------------------|-------------------------------|---------------------------|-----------------------------|---------------------------------|-------------------------|-----------------|
| 1.16E-05                                      | 0.04                              | 0.6                           | 0.978                     | 0.97                        | 0.04                            |                         |                 |
| 1.16E-05                                      | Yes 0.04                          | Yes 0.6                       | Yes 0.978                 | Yes 0.97                    | 0.04                            | Controlled Jet fire     | 4.50E-07        |
|   |                                   |                               |                           | No 0.03                     |                                 | Not controlled jet fire | 1.39E-08        |
|   |                                   | No 0.4                        |                           | Escalated jet fire          | 1.86E-07                        |                         |                 |
|   |                                   |                               |                           | Limited release             | -----                           |                         |                 |
|   |                                   | No 0.96                       |                           | No 0.022                    | Large release                   | 2.45E-07                |                 |
|   |                                   |                               |                           | Yes 0.04                    | Escalated jet fire              | 4.45E-07                |                 |
|   |                                   |                               |                           |                             | No 0.96                         | Escalated release       | 1.07E-05        |
| <b>TOTAL</b>                                  |                                   |                               |                           |                             |                                 |                         | <b>6.45E-07</b> |

(1) Refer to QRA Study Page 94. (Taylor Associates ApS - 2006)

(2) Ref. Handbook Failure Frequencies 2009.

(3) Ref. OGP – Report No. 434 – A1 / 2010.



Document Title: Quantitative Risk Assessment "QRA" Study for El-Baragil Pressure Reduction & Metering Station

Table (34) Odorant Tank Release – Event Tree Analysis

| Release of Flammable Materials <sup>(1)</sup> | Immediate Ignition <sup>(2)</sup> | Fire Detection <sup>(3)</sup>  | ESD System <sup>(3)</sup> | Fire Protec. <sup>(3)</sup> | Delayed Ignition <sup>(2)</sup> | Outcomes            | Frequency       |
|---|-----------------------------------|--|---------------------------|-----------------------------|---------------------------------|---------------------|-----------------|
| 1.25E-05                                      | 0.065                             | 0.6  | 0.978                     | 0.97                        | 0.07                            |                     |                 |
| 1.25E-05                                      | Yes 0.065                         | Yes 0.6  | Yes 0.978                 | Yes 0.97                    | No 0.07                         | Controlled Jet fire | 7.88E-07        |
|   |                                   |  |                           | No 0.03                     |                                 | Large fire          | 2.44E-08        |
|   |                                   | No 0.4   | No 0.022                  | Yes 0.07                    | Escalated jet fire              | 3.25E-07            |                 |
|   |                                   |  |                           |                             | No 0.93                         | Escalated leak      | 1.09E-05        |
|   |                                   | Yes 0.978  | Limited leak              | -----                       |                                 |                     |                 |
|   |                                   |  | Large leak                | 2.57E-07                    |                                 |                     |                 |
|   |                                   | <p>(1) Refer to QRA Study Page 94. (Taylor Associates ApS - 2006)</p> <p>(2) Ref. Handbook Failure Frequencies 2009.</p> <p>(3) Ref. OGP – Report No. 434 – A1 / 2010.</p> |                           |                             |                                 |                     |                 |
| <b>TOTAL</b>                                  |                                   |  |                           |                             |                                 |                     | <b>1.23E-05</b> |



The following table (35) shows the total frequency for each scenario from ETA - Tables (29 to 34):

*Table 35. Total Frequencies for Each Scenario*

| Source of Release              | Total Frequency (ETA) |
|--------------------------------|-----------------------|
| Inlet Pipeline Pin Hole        | <i>1.47E-05</i>       |
| Off-Take Pipeline Pin Hole     |                       |
| Outlet Pipeline Pin Hole       |                       |
| Gas Heater Pin Hole            |                       |
| Inlet Pipeline Half Rupture    | <i>2.89E-05</i>       |
| Off-Take Pipeline Half Rupture |                       |
| Outlet Pipeline Half Rupture   | <i>1.47E-05</i>       |
| Inlet Pipeline Full Rupture    | <i>1.50E-06</i>       |
| Off-Take Pipeline Full Rupture |                       |
| Outlet Pipeline Full Rupture   | <i>6.45E-07</i>       |
| Odorant Tank 1" hole Leak      | <i>1.23E-05</i>       |

The following table (36) summarize the risk events on workers / public, and according to the site visit of Petrosafe team to the PRMS premises; it will be assumed that:

- Five Persons "as Workers" are available in the PRS for 24 hrs/ day (Three operators in control room and admin building + Two persons in the security room).
- One of the operators will be available around the PRS components for Maintenance/ Operation for 1 hour / day light.
- One person "as public" is present in the agricultural areas neighboring to the PRS for 2 hours / day light.
- Five Persons "as public" are available in the residential building for 8 hrs/ day.

*Table 36. Summarization of Risk on Workers / Public (Occupancy)*

| <i>Inlet 10" Pipeline Release Scenarios</i>  |       |  |  |                                    |                         |
|--|-------|--|--|------------------------------------|-------------------------|
| Event Exposure                               | Event | Jet / Fireball (12.5 kW/m <sup>2</sup> )     |  | Explosion Overpressure (0.137 bar) |                         |
|  |       | Workers                                      | Public   | Workers                            | Public                  |
| Pin Hole                                     | 1"    | <i>1 for 1 h (0.04)</i>                      | <i>None</i>                                    | <i>1 for 1 h (0.04)</i>            | <i>None</i>             |
| Half Rupture                                 | 4"    | <i>1 for 1 h (0.04)<br/>+ 2 for 24 h (2)</i> | <i>1 for 2 h (0.08)</i>                        | <i>None</i>                        | <i>1 for 2 h (0.08)</i> |
| Full Rupture                                 | 10"   | <i>1 for 1 h (0.04)<br/>+ 2 for 24 h (2)</i> | <i>1 for 2 h (0.08)<br/>+ 5 for 8 h (1.67)</i> | <i>None</i>                        | <i>1 for 2 h (0.08)</i> |
| <i>Outlet 10" Pipeline Release Scenarios</i> |       |  |  |                                    |                         |
| Pin Hole                                     | 1"    | <i>None</i>                                  | <i>None</i>                                    | <i>None</i>                        | <i>None</i>             |
| Half Rupture                                 | 4"    | <i>1 for 1 h (0.04)<br/>+ 3 for 24 h (3)</i> | <i>1 for 2 h (0.08)</i>                        | <i>1 for 1 h (0.04)</i>            | <i>1 for 2 h (0.08)</i> |

|  |     |  |                  |                  |                  |
|--|-----|--|------------------|------------------|------------------|
| Full Rupture                                   | 10" | 1 for 1 h (0.04)<br>+ 2 for 24 h (2)<br>+ 3 for 24 h (3) | 1 for 2 h (0.08) | 1 for 1 h (0.04) | 1 for 2 h (0.08) |
| <b>Odorant Tank Release Scenario</b>           |     |  |                  |                  |                  |
| Small Leak                                     | 1"  | 1 for 1 h (0.04)   | None             | 2 for 24 h (2)   | 1 for 2 h (0.08) |
| <b>Gas heater (water bath heating system)</b>  |     |  |                  |                  |                  |
| Pin Hole                                       | 1"  | 1 for 1 h (0.04)   | None             | 1 for 1 h (0.04) | None             |
| <b>Off-Take 10" Pipeline Release Scenarios</b> |     |  |                  |                  |                  |
| Pin Hole                                       | 1"  | 1 for 1 h (0.04)   | None             | None             | None             |
| Half Rupture                                   | 4"  | 1 for 1 h (0.04) +<br>2 for 24 h (2)                     | 1 for 2 h (0.08) | None             | None             |
| Full Rupture                                   | 10" | 1 for 1 h (0.04) +<br>2 for 24 h (2)                     | 1 for 2 h (0.08) | 2 for 24 h (2)   | 1 for 2 h (0.08) |

Therefore, the risk calculation will depend on total risk from these scenarios, and as per the equation page (89):

**Risk to People (Individual Risk – IR) =**

**Total Risk (Σ Frequency of fire/explosion) x Occupancy x Vulnerability**

Where:

- Total risk - is the sum of contributions from all hazards exposed to (fire / explosion).

**(Frequencies of Scenarios from Table-35)**

- Occupancy - is the proportion of time exposed to work hazards. (Expected that X man the most exposed person to fire/explosion hazards on site. He works 8 hours "shift/day").

**(Ref. to Table-36)**

- Vulnerability - is the probability that exposure to the hazard will result in fatality.

**(Reference: Report No./DNV Reg. No.: 2013-4091/1/17 TLT 29-6 – Rev. 1)**

As per modeling, the IR will be calculated for the workers and the public around the PRMS and Off-Take Point as per the following tables (37 & 38):



Table 37. Individual Risk (IR) Calculation for the Workers Near to the PRMS

| Source of Event   | Frequency<br>1 | Heat Radiation<br>(kW/m <sup>2</sup> ) &<br>Overpressure<br>(Bar) | Vulnerability<br>2 | Time<br>Exposed<br>3   | IR =<br>1 x 2 x 3 |
|---|----------------|---|--------------------|------------------------|-------------------|
| Gas release from<br>1"/10" Inlet<br>Pipeline                              | 1.47E-05       | Jet Fire<br>12.5  | 0.7<br>(Outdoor)   | 0.04 <sup>1 Pers</sup> | 4.12E-07          |
|   |                | Explosion<br>0.137  | 0.3<br>(Outdoor)   |                        | 1.76E-07          |
| Gas release from<br>heater  | 1.47E-05       | Jet Fire<br>12.5  | 0.7<br>(Outdoor)   | 0.04 <sup>1 Pers</sup> | 4.12E-07          |
|   |                | Explosion<br>0.137  | 0.3<br>(Outdoor)   |                        | 1.76E-07          |
| Gas Release from<br>4"/10" Inlet<br>pipeline 4"/10" Off-<br>take pipeline | 2.89E-05       | Jet Fire<br>12.5  | 0.7<br>(Outdoor)   | 0.04 <sup>1 Pers</sup> | 8.09E-07          |
|   |                | Jet Fire<br>12.5  | 0.1<br>(Indoor)    | 2.00 <sup>2 Pers</sup> | 5.78E-06          |
| Gas Release from<br>4"/10" Outlet<br>pipeline                             | 1.47E-05       | Jet Fire<br>12.5  | 0.7<br>(Outdoor)   | 0.04 <sup>1 Pers</sup> | 4.12E-07          |
|   |                | Explosion<br>0.137  | 0.3<br>(Outdoor)   |                        | 1.76E-07          |
|   |                | Jet Fire<br>12.5  | 0.1<br>(Indoor)    | 3.00 <sup>3 Pers</sup> | 4.41E-06          |
| Gas Release from<br>10" Inlet pipeline &<br>10" Off-take<br>pipeline      | 1.50E-06       | Jet Fire<br>12.5  | 0.7<br>(Outdoor)   | 0.04 <sup>1 Pers</sup> | 4.20E-08          |
|   |                | Jet Fire<br>12.5  | 0.1<br>(Indoor)    | 2.00 <sup>2 Pers</sup> | 3.00E-07          |
|   |                | Explosion<br>0.137  | 1<br>(Indoor)      | 2.00 <sup>2 Pers</sup> | 3.00E-06          |
| Gas Release from<br>10" Outlet pipeline                                   | 6.45E-07       | Jet Fire<br>12.5  | 0.1<br>(Indoor)    | 5.00 <sup>5 Pers</sup> | 3.23E-07          |
|   |                | Jet Fire<br>12.5  | 0.7<br>(Outdoor)   | 0.04 <sup>1 Pers</sup> | 1.81E-08          |
|   |                | Fireball<br>12.5  | 0.7<br>(Outdoor)   |                        | 1.81E-08          |
|   |                | Explosion<br>0.137  | 0.3<br>(Outdoor)   | 7.74E-09               |                   |
| Odorant tank 1"<br>leak   | 1.23E-05       | Jet Fire<br>12.5  | 0.7<br>(Outdoor)   | 0.04 <sup>1 Pers</sup> | 3.44E-07          |
|   |                | Explosion<br>0.137  | 1<br>(Indoor)      | 2.00 <sup>2 Pers</sup> | 2.46E-05          |
| <b>TOTAL Risk for the Workers</b>   |                |   |                    |                        | <b>4.14E-05</b>   |



Table 38. Individual Risk (IR) Calculation for the Public Near to the PRMS

| Source of Event                           | Frequency<br><b>1</b> | Heat Radiation (kW/m <sup>2</sup> ) & Overpressure (Bar) | Vulnerability<br><b>2</b> | Time Exposed<br><b>3</b>      | IR =<br><b>1 x 2 x 3</b>      |
|---|-----------------------|--|---------------------------|-------------------------------|-------------------------------|
| Gas Release from 4"/10" Off-take pipeline | <b>2.89E-05</b>       | Jet Fire<br>12.5   | <b>0.7</b><br>(Outdoor)   | <b>0.08</b> <sup>1 Pers</sup> | <b>1.62E-06</b>               |
| Gas Release from 4"/10" Inlet pipeline    |                       | Jet Fire<br>12.5   | <b>0.7</b><br>(Outdoor)   |                               | <b>0.08</b> <sup>1 Pers</sup> |
|   |                       | Explosion<br>0.137                                       | <b>0.3</b><br>(Outdoor)   |                               |                               |
| Gas Release from 4"/10" Outlet pipeline   | <b>1.47E-05</b>       | Jet Fire<br>12.5   | <b>0.7</b><br>(Outdoor)   | <b>0.08</b> <sup>1 Pers</sup> | <b>8.23E-07</b>               |
|   |                       | Explosion<br>0.137                                       | <b>0.3</b><br>(Outdoor)   |                               | <b>3.53E-07</b>               |
| Gas Release from 10" Off-take pipeline    | <b>1.50E-06</b>       | Jet Fire<br>12.5   | <b>0.7</b><br>(Outdoor)   | <b>0.08</b> <sup>1 Pers</sup> | <b>8.40E-08</b>               |
|   |                       | Explosion<br>0.137                                       | <b>0.3</b><br>(Outdoor)   |                               | <b>3.60E-08</b>               |
| Gas Release from 10" Inlet pipeline       | <b>1.50E-06</b>       | Jet Fire<br>12.5   | <b>0.7</b><br>(Indoor)    | <b>1.67</b> <sup>1 Pers</sup> | <b>2.51E-07</b>               |
|   |                       | Jet Fire<br>12.5   | <b>0.7</b><br>(Outdoor)   | <b>0.08</b> <sup>1 Pers</sup> | <b>8.40E-08</b>               |
|   |                       | Explosion<br>0.137                                       | <b>0.3</b><br>(Outdoor)   |                               | <b>3.60E-08</b>               |
| Gas Release from 10" Outlet pipeline      | <b>6.45E-07</b>       | Jet Fire<br>12.5   | <b>0.7</b><br>(Outdoor)   | <b>0.08</b> <sup>1 Pers</sup> | <b>3.61E-08</b>               |
|   |                       | Explosion<br>0.137                                       | <b>0.3</b><br>(Outdoor)   |                               | <b>1.55E-08</b>               |
| Odorant tank 1" leak                      | <b>1.23E-05</b>       | Explosion<br>0.137                                       | <b>0.3</b><br>(Outdoor)   | <b>0.08</b> <sup>1 Pers</sup> | <b>2.95E-07</b>               |
| <b>TOTAL Risk for the Public (PRMS)</b>   |                       |  |                           |                               | <b>5.94E-06</b>               |



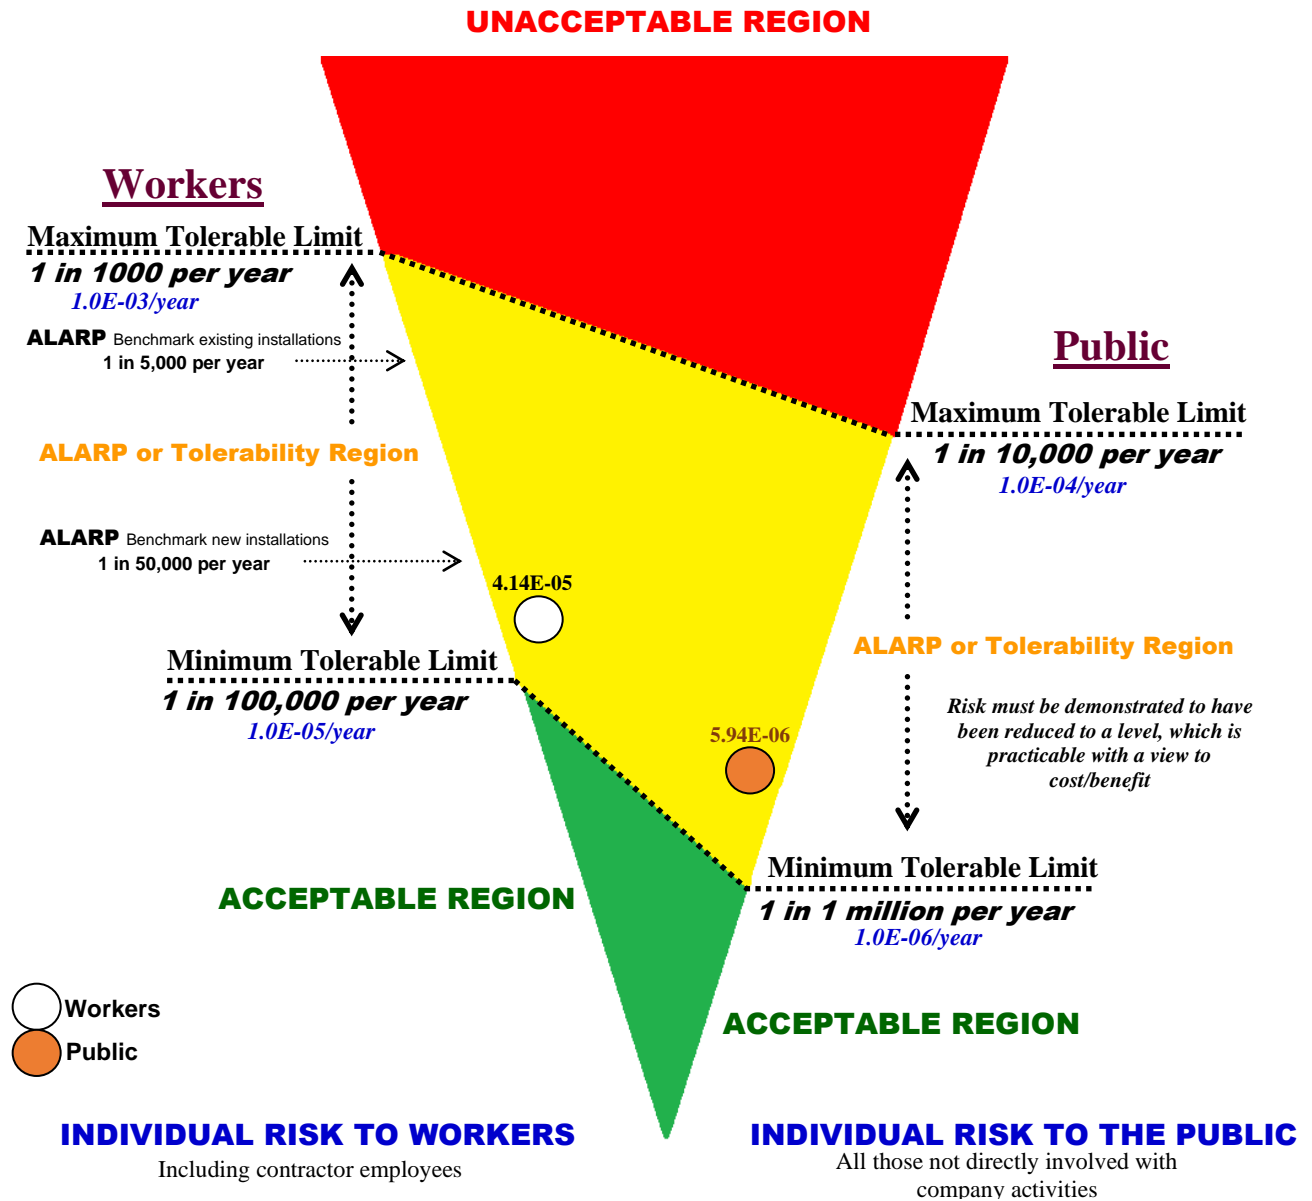


Figure (47) Evaluation of Individual Risk

The level of Individual Risk to the exposed Workers at El-Baragil PRMS, based on the risk tolerability criterion used is **ALARP**.

The level of Individual Risk to the exposed Public at El-Baragil PRMS area, based on the risk tolerability criterion used is **ALARP**.



## Summary of Modelling Results and Conclusion

As per results from modeling the consequences of each scenario, the following table summarize the study, and as follows:

| Event   | Scenario   | Effects   |
|---|--|---|
| <b>Pin hole (1") gas release 10" inlet pipeline</b>     |  |   |
|   | Gas cloud<br>UFL<br>LFL<br>50 % LFL  | <i>The modeling shows that the gas cloud effects will be limited inside the PRMS fence.</i>   |
|   | Heat radiation / Jet fire<br>9.5 kW/m <sup>2</sup><br>12.5 kW/m <sup>2</sup> | <i>The modeling shows that the heat radiation values will be limited inside the PRMS fence with no effects outside; while may affect operator if exist.</i>   |
|   | Worst-Case explosion<br>0.020 bar<br>0.137 bar<br>0.206 bar                  | <i>The modeling shows that the value of 0.020, 0.137 &amp; 0.206 bar will not extend outside the PRMS fence; i.e. no effects outside; while may affect operator if exist.</i>   |
| <b>Half Rupture (4") gas release 10" inlet pipeline</b> |  |   |
|   | Gas cloud<br>UFL<br>LFL<br>50 % LFL  | <i>The modeling shows that the gas clouds 50 % LFL &amp; LFL will extend to reach the southern fence and extend outside. The UFL will be limited inside the PRS boundary.</i>   |
|   | Heat radiation / Jet fire<br>9.5 kW/m <sup>2</sup><br>12.5 kW/m <sup>2</sup> | <i>The modeling shows that the values of 9.5, 12.5, 25 &amp; 37.5 kW/m<sup>2</sup> will extend outside the PRMS southern fence with no effects outside; while may affect operator if exist; in addition to security building.</i>                         |
|   | Worst-Case explosion<br>0.020 bar<br>0.137 bar<br>0.206 bar                  | <i>The modeling shows that the value of 0.020, 0.137 &amp; 0.206 bar will extend outside the PRMS southern fence with no effects outside.</i>   |
| <b>Full Rupture gas release 10" inlet pipeline</b>      |  |   |
|   | Gas cloud<br>UFL<br>LFL<br>50 % LFL  | <i>The modeling shows that the gas cloud effects (LFL &amp; 50 % LFL) will not reach southern fence; i.e. no effects outside.</i>   |
|   | Heat radiation / Jet fire<br>9.5 kW/m <sup>2</sup><br>12.5 kW/m <sup>2</sup> | <i>The modeling shows that the heat radiation values 9.5, 12.5, 25 &amp; 37.5 kW/m<sup>2</sup> will extend outside the PRMS southern fence, with no effects on the neighboring; while may affect operator if exist; in addition to security building.</i> |
|   | Worst-Case explosion<br>0.020 bar<br>0.137 bar                               | <i>The modeling shows that the value of 0.020, 0.137 &amp; 0.206 bar will extend outside the PRMS southern fence with no effects outside.</i>   |



| Event  | Scenario   | Effects   |
|--|--|---|
|  | 0.206 bar  |   |
| <b>Pin hole (1") gas release 10" outlet pipeline</b>     |  |   |
|  | Gas cloud<br>UFL<br>LFL<br>50 % LFL  | <i>The modeling shows that the gas cloud will be limited inside the PRS boundary.</i>   |
|  | Heat radiation / Jet fire<br>9.5 kW/m <sup>2</sup><br>12.5 kW/m <sup>2</sup> | <i>The modeling shows that the heat radiation value 1.6, 4, 9.5, 12.5, 25 &amp; 37.5 kW/m<sup>2</sup> effects will be limited inside the PRS boundary with no effect on the surroundings, while may affect operator if exist.</i>                                       |
|  | Worst-Case explosion<br>0.020 bar<br>0.137 bar<br>0.206 bar                  | <i>N/D.</i>   |
| <b>Half Rupture (4") gas release 10" outlet pipeline</b> |  |   |
|  | Gas cloud<br>UFL<br>LFL<br>50 % LFL  | <i>The modeling shows that the gas cloud will be limited inside the PRS boundary.</i>   |
|  | Heat radiation / Jet fire<br>9.5 kW/m <sup>2</sup><br>12.5 kW/m <sup>2</sup> | <i>The modeling shows that the heat radiation values of 9.5, 12.5, 25 &amp; 37.5 kW/m<sup>2</sup> will extend outside the PRMS eastern and western fences with no effect on the surroundings; while may affect operator if exist.</i>                                   |
|  | Worst-Case explosion<br>0.020 bar<br>0.137 bar<br>0.206 bar                  | <i>The modeling shows that the overpressure values will extend outside the PRMS western fence; with no effect on the surroundings; while may affect operator if exist.</i>  |
| <b>Full Rupture gas release 10" outlet pipeline</b>      |  |   |
|  | Gas cloud<br>UFL<br>LFL<br>50 % LFL  | <i>The modeling shows that the gas cloud effects will be limited inside the PRS boundary.</i>   |
|  | Heat radiation / Jet fire<br>9.5 kW/m <sup>2</sup><br>12.5 kW/m <sup>2</sup> | <i>The modeling shows that the heat radiation values of 9.5, 12.5, 25 &amp; 37.5 kW/m<sup>2</sup> will extend outside the PRMS eastern and western fences with no effect on the surroundings; while may affect operator if exist; in addition to security building.</i> |
|  | Worst-Case explosion<br>0.020 bar<br>0.137 bar<br>0.206 bar                  | <i>The modeling shows that the overpressure values will extend outside the PRMS western fence; with no effect on the surroundings; while may affect operator if exist.</i>  |



| Event  | Scenario  | Effects   |
|--|---|---|
|  | Heat radiation /<br>Fireball<br>9.5 kW/m <sup>2</sup><br>12.5 kW/m <sup>2</sup> | <i>The modeling shows that the heat radiation values of 9.5, 12.5, 25 &amp; 37.5 kW/m<sup>2</sup> will extend outside the PRMS eastern and western fences with no effect on the surroundings; while may affect operator if exist; in addition to Control Room building.</i> |
| <b>Odorant tank 1" leak</b>                            |   |   |
|  | Gas cloud<br>UFL<br>LFL<br>50 % LFL   | <i>The modeling shows that the vapor cloud will be limited inside the PRS fence.</i>  |
|  | Heat radiation / Jet fire<br>9.5 kW/m <sup>2</sup><br>12.5 kW/m <sup>2</sup>    | <i>The modeling shows that all values of heat radiation 9.5, 12.5, 25 &amp; 37.5 kW/m<sup>2</sup> will be limited inside the PRS boundary down and crosswind; i.e. no effect on the surroundings; while may affect operator if exist.</i>                                   |
|  | Worst-Case explosion<br>0.020 bar<br>0.137 bar<br>0.206 bar                     | <i>The modeling shows that the values of 0.137 &amp; 0.206 bar will extend outside the PRS boundary; with no effect on the surroundings; while may affect operator if exist; in addition to security building.</i>  |
| <b>Gas heater (water bath heating system)</b>          |   |   |
|  | Gas cloud<br>UFL<br>LFL<br>50 % LFL   | <i>The modeling shows that the vapor cloud will be limited inside the PRS boundary downwind.</i>  |
|  | Heat radiation / Jet fire<br>9.5 kW/m <sup>2</sup><br>12.5 kW/m <sup>2</sup>    | <i>The modeling shows that the heat radiation values 4, 9.5, 12.5, 25 &amp; 37.5 kW/m<sup>2</sup> effects will be limited inside the PRS boundary affecting the PRMS components; i.e. may affect operator if exist.</i>   |
|  | Worst-Case explosion<br>0.020 bar<br>0.137 bar<br>0.206 bar                     | <i>The modeling shows that the overpressure values will be limited inside the PRMS boundary; i.e. no effects outside; while may affect operator if exist.</i>   |
| <b>Pin hole (1") gas release 10" off-take pipeline</b> |   |   |
|  | Gas cloud<br>UFL<br>LFL<br>50 % LFL   | <i>The modeling shows that the gas cloud effects will be limited inside the PRS boundary.</i>   |
|  | Heat radiation / Jet fire<br>9.5 kW/m <sup>2</sup><br>12.5 kW/m <sup>2</sup>    | <i>The modeling shows that the heat radiation values 9.5, 12.5 &amp; 25 kW/m<sup>2</sup> are limited inside the PRS and may affect operator if exist; while heat</i>  |



| Event  | Scenario   | Effects  |
|--|--|--|
|  |  | <i>radiation values 1.6 &amp; 4 kW/m<sup>2</sup> extend outside the fence with no effects.</i>   |
|  | Worst-Case explosion<br>0.020 bar<br>0.137 bar<br>0.206 bar                  | N/D  |
| <b>Half Rupture (4") gas release 10" off-take pipeline</b> |  |  |
|  | Gas cloud<br>UFL<br>LFL<br>50 % LFL  | <i>The modeling shows that the gas cloud effects will be limited inside the PRS boundary.</i>  |
|  | Heat radiation / Jet fire<br>9.5 kW/m <sup>2</sup><br>12.5 kW/m <sup>2</sup> | <i>The modeling shows that the heat radiation values of 9.5 &amp; 12.5 kW/m<sup>2</sup> will cover the PRS boundary and may affect operator if exist; in addition to security building. Also, it will extend outside the PRS fence and may affect the neighboring person in the agricultural area "if any".<br/>The values of 25 &amp; 37.5 kW/m<sup>2</sup> are not determined.</i> |
|  | Worst-Case explosion<br>0.020 bar<br>0.137 bar<br>0.206 bar                  | N/D  |
| <b>Full Rupture gas release 10" off-take pipeline</b>      |  |  |
|  | Gas cloud<br>UFL<br>LFL<br>50 % LFL  | <i>The modeling shows that the gas cloud will be limited inside the PRS boundary.</i>  |
|  | Heat radiation / Jet fire<br>9.5 kW/m <sup>2</sup><br>12.5 kW/m <sup>2</sup> | <i>The modeling shows that the heat radiation values of 9.5 &amp; 12.5 kW/m<sup>2</sup> will cover the PRS boundary and may affect operator if exist; in addition to security building. Also, it will extend outside the PRS fence and may affect the neighboring person in the agricultural area "if any".<br/>The values of 25 &amp; 37.5 kW/m<sup>2</sup> are not determined.</i> |
|  | Worst-Case explosion<br>0.020 bar<br>0.137 bar<br>0.206 bar                  | <i>The modeling shows that the overpressure values will extend outside the PRMS southern fence; and may affect on the neighboring person in the agricultural area "if any"; in addition, may affect operator if exist.</i>   |

The previous table shows that there are some of potential hazards with heat radiation (12.5 kW/m<sup>2</sup>) resulting from jet fire and explosion overpressure waves (0.137 bar) from explosion events.



These risks (Jet fire, Fireball & overpressure waves) will affect the workers at the PRMS, and reach the surrounding near to the station.

The major hazards that extend over site boundary and/or effect on workers / public were used for Risk Calculations.



## Recommendations

Regarding to the modeling scenarios and risk calculations to workers / public which find that the risk to Workers and Public is in the **ALARP region**, therefore there are some points need to be considered to maintain the risk tolerability in its region and this will be described in the following recommendations:

| Recommendation   | Timeline Phases | Town Gas Remarks |
|--|-----------------|------------------|
| <ul style="list-style-type: none"> <li>• Ensure that:               <ul style="list-style-type: none"> <li>- All PRMS facilities specifications referred to the national and international codes and standards.</li> <li>- Inspection and maintenance plans and programs are according to the manufacturers guidelines to keep all facility parts in a good condition.</li> <li>- All operations are according to standard operating procedures for the PRMS operations and training programs in-place for operators.</li> <li>- Emergency shutdown detailed procedure including emergency gas isolation points at the PRMS and Off-Take Point in place.</li> <li>- Surface drainage system is suitable for containment any odorant spillage.</li> </ul> </li> </ul> |                 |                  |
| <ul style="list-style-type: none"> <li>• Considering that all electrical equipment, facilities and connections are according to the hazardous area classification for natural gas facilities.</li> </ul>   | Design          |                  |
| <ul style="list-style-type: none"> <li>• Updating the emergency response plan for the PRS to include all scenarios in this study and other needs like:               <ul style="list-style-type: none"> <li>- Firefighting brigades, mutual aids, emergency communications and fire detection / protection systems.</li> <li>- Dealing with the external road in case of major fires.</li> </ul> </li> </ul>   | Operation       |                  |
|  | Operation       |                  |
|  | Operation       |                  |



| Recommendation  | Timeline Phases                   | Town Gas Remarks |
|---|-----------------------------------|------------------|
| - Safe exits in building according to the modeling in this study, and to the PRS from other side beside the designed exit in layout.  | Design                            |                  |
| • Provide the site with SCBA "Self-Contained Breathing Apparatus (at least two sets) and arrange training programs for operators.   | Operation                         |                  |
| • Cooperation should be done with the concerned parties before planning for housing projects around the PRMS area.  | Operation / Design / Construction |                  |
| • Study to relocate the security building (G.R.) to be upwind of the PRS facilities (i.e. at the north of the PRS), to avoid the effect of most of scenarios.   | Design / Construction             |                  |
| • Ensure that emergency exit for the control room (office building) to the north for safe exit to the workers. In addition, emergency exit for the security building shall not facing the PRS facilities. | Design / Construction             |                  |



Prepared By:

PETROSAFE



Egyptian Natural Gas Holding Company "EGAS"

Annex "1"

Date: June 2022

Document Title: **Quantitative Risk Assessment "QRA" Study for El-Baragil Pressure Reduction & Metering Station**

## Annex "1"

# Results of Consequence Modelling Low Wind Scenario



## Results of Consequence Modelling

### Low Wind Scenario

#### 1.0. Pressure Reduction Station Inlet Pipeline (10 inch)

##### 1/1- Consequence Modeling for 1 inch (Pin Hole) Gas Release

The following table no. (A.1) Shows that:

*Table (A.1) Dispersion Modeling for Inlet - 1" / 10" Gas Release*

| Gas Release (Inlet / PRV "High Pressure") |                     |              |            |                 |
|---|---------------------|--------------|------------|-----------------|
| Wind Category                             | Flammability Limits | Distance (m) | Height (m) | Cloud Width (m) |
| 2 F                                       | UFL                 | 2.3          | 1.1        | 0.2 @ 1.5 m     |
|   | LFL                 | 7.2          | 1.32       | 0.64 @ 4.4 m    |
|   | 50 % LFL            | 14.7         | 1.65       | 1.4 @ 9 m       |

| Jet Fire      |                  |                                     |                       |                        |                     |
|---------------|------------------|-------------------------------------|-----------------------|------------------------|---------------------|
| Wind Category | Flame Length (m) | Heat Radiation (kW/m <sup>2</sup> ) | Distance Downwind (m) | Distance Crosswind (m) | Lethality Level (%) |
| 2 F           | 12.4             | 1.6                                 | 20.6                  | 15.1                   | 0                   |
|               |                  | 4                                   | 17.3                  | 9.5                    | 0                   |
|               |                  | 9.5                                 | 15.2                  | 5.9                    | 0                   |
|               |                  | 12.5                                | 14.7                  | 5                      | 20% /60 sec.        |
|               |                  | 25                                  | 13.5                  | 2.97                   | 80.34               |
|               |                  | 37.5                                | 12.6                  | 1.97                   | 98.74               |

| Unconfined Vapor Cloud Explosion - UVCE (Open Air) |                      |                                   |                                    |  |
|--|----------------------|-----------------------------------|------------------------------------|--|
| Wind Category                                      | Pressure Value (bar) | Explosion Overpressure Radius (m) | Overpressure Waves Effect / Damage |  |
| 2 F  | 0.020                | 24.6                              | 0.021 bar                          | Probability of serious damage beyond this point = 0.05 - 10 % glass broken |
|  | 0.137                | 13.8                              | 0.137 bar                          | Some severe injuries, death unlikely                                       |
|  | 0.206                | 12.9                              | 0.206 bar                          | Steel frame buildings distorted / pulled from foundation                   |

### *1/2- Consequence Modeling for 4 inch (Half Rup.) Gas Release*

The following table no. (A.2) Shows that:

*Table (A.2) Dispersion Modeling for Inlet - 4" / 10" Gas Release*

| Gas Release (Inlet / PRV "High Pressure") |                     |              |            |                 |
|---|---------------------|--------------|------------|-----------------|
| Wind Category                             | Flammability Limits | Distance (m) | Height (m) | Cloud Width (m) |
| 2 F                                       | UFL                 | 12.7         | 1.6        | 1.2 @ 7 m       |
|   | LFL                 | 36.1         | 0 – 3.05   | 3.05 @ 22 m     |
|   | 50 % LFL            | 52.9         | 0 – 4.2    | 4.2 @ 29 m      |

| Jet Fire      |                  |                                     |                       |                        |                     |
|---------------|------------------|-------------------------------------|-----------------------|------------------------|---------------------|
| Wind Category | Flame Length (m) | Heat Radiation (kW/m <sup>2</sup> ) | Distance Downwind (m) | Distance Crosswind (m) | Lethality Level (%) |
| 2 F           | 55.6             | 1.6                                 | 137.1                 | 112.9                  | 0                   |
|               |                  | 4                                   | 105.2                 | 72.6                   | 0                   |
|               |                  | 9.5                                 | 85.2                  | 47.3                   | 0                   |
|               |                  | 12.5                                | 80.2                  | 41.2                   | 20% /60 sec.        |
|               |                  | 25                                  | 69.6                  | 28.3                   | 80.34               |
|               |                  | 37.5                                | 64.1                  | 22.1                   | 98.74               |

| Unconfined Vapor Cloud Explosion - UVCE (Open Air) |                      |                                   |                                    |   |
|--|----------------------|-----------------------------------|------------------------------------|---|
| Wind Category                                      | Pressure Value (bar) | Explosion Overpressure Radius (m) | Overpressure Waves Effect / Damage |   |
| 2 F  | 0.020                | 137.7                             | <b>0.021 bar</b>                   | <i>Probability of serious damage beyond this point = 0.05 - 10 % glass broken</i> |
|  | 0.137                | 72.7                              | <b>0.137 bar</b>                   | <i>Some severe injuries, death unlikely</i>                                       |
|  | 0.206                | 67.5                              | <b>0.206 bar</b>                   | <i>Steel frame buildings distorted / pulled from foundation</i>                   |

### 1/3- Consequence Modeling for 10 inch (Full Rupture) Gas Release

The following table no. (A.3) Shows that:

*Table (A.3) Dispersion Modeling for Inlet - 10" Gas Release*

| Gas Release   |                     |              |            |                 |
|---------------|---------------------|--------------|------------|-----------------|
| Wind Category | Flammability Limits | Distance (m) | Height (m) | Cloud Width (m) |
| 2 F           | UFL                 | 19.2         | 1.85       | 1.7 @ 9.5 m     |
|               | LFL                 | 46.5         | 0 – 2.85   | 2.85 @ 15 m     |
|               | 50 % LFL            | 65.1         | 0 – 3.5    | 3.5 @ 17 m      |

| Jet Fire      |                  |                                     |                       |                        |                     |
|---------------|------------------|-------------------------------------|-----------------------|------------------------|---------------------|
| Wind Category | Flame Length (m) | Heat Radiation (kW/m <sup>2</sup> ) | Distance Downwind (m) | Distance Crosswind (m) | Lethality Level (%) |
| 2 F           | 130.7            | 1.6                                 | 377.2                 | 287.2                  | 0                   |
|               |                  | 4                                   | 280.4                 | 186.4                  | 0                   |
|               |                  | 9.5                                 | 218.6                 | 122.7                  | 0                   |
|               |                  | 12.5                                | 203.2                 | 106.9                  | 20 %/60 sec.        |
|               |                  | 25                                  | 169.4                 | 73.9                   | 80.34               |
|               |                  | 37.5                                | 155.2                 | 58.2                   | 98.74               |

| Unconfined Vapor Cloud Explosion - UVCE (Open Air) |                      |                                   |                                    |   |
|--|----------------------|-----------------------------------|------------------------------------|---|
| Wind Category                                      | Pressure Value (bar) | Explosion Overpressure Radius (m) | Overpressure Waves Effect / Damage |   |
| 2 F  | 0.020                | 180.5                             | <b>0.021 bar</b>                   | <i>Probability of serious damage beyond this point = 0.05 - 10 % glass broken</i> |
|  | 0.137                | 91.2                              | <b>0.137 bar</b>                   | <i>Some severe injuries, death unlikely</i>                                       |
|  | 0.206                | 84.1                              | <b>0.206 bar</b>                   | <i>Steel frame buildings distorted / pulled from foundation</i>                   |